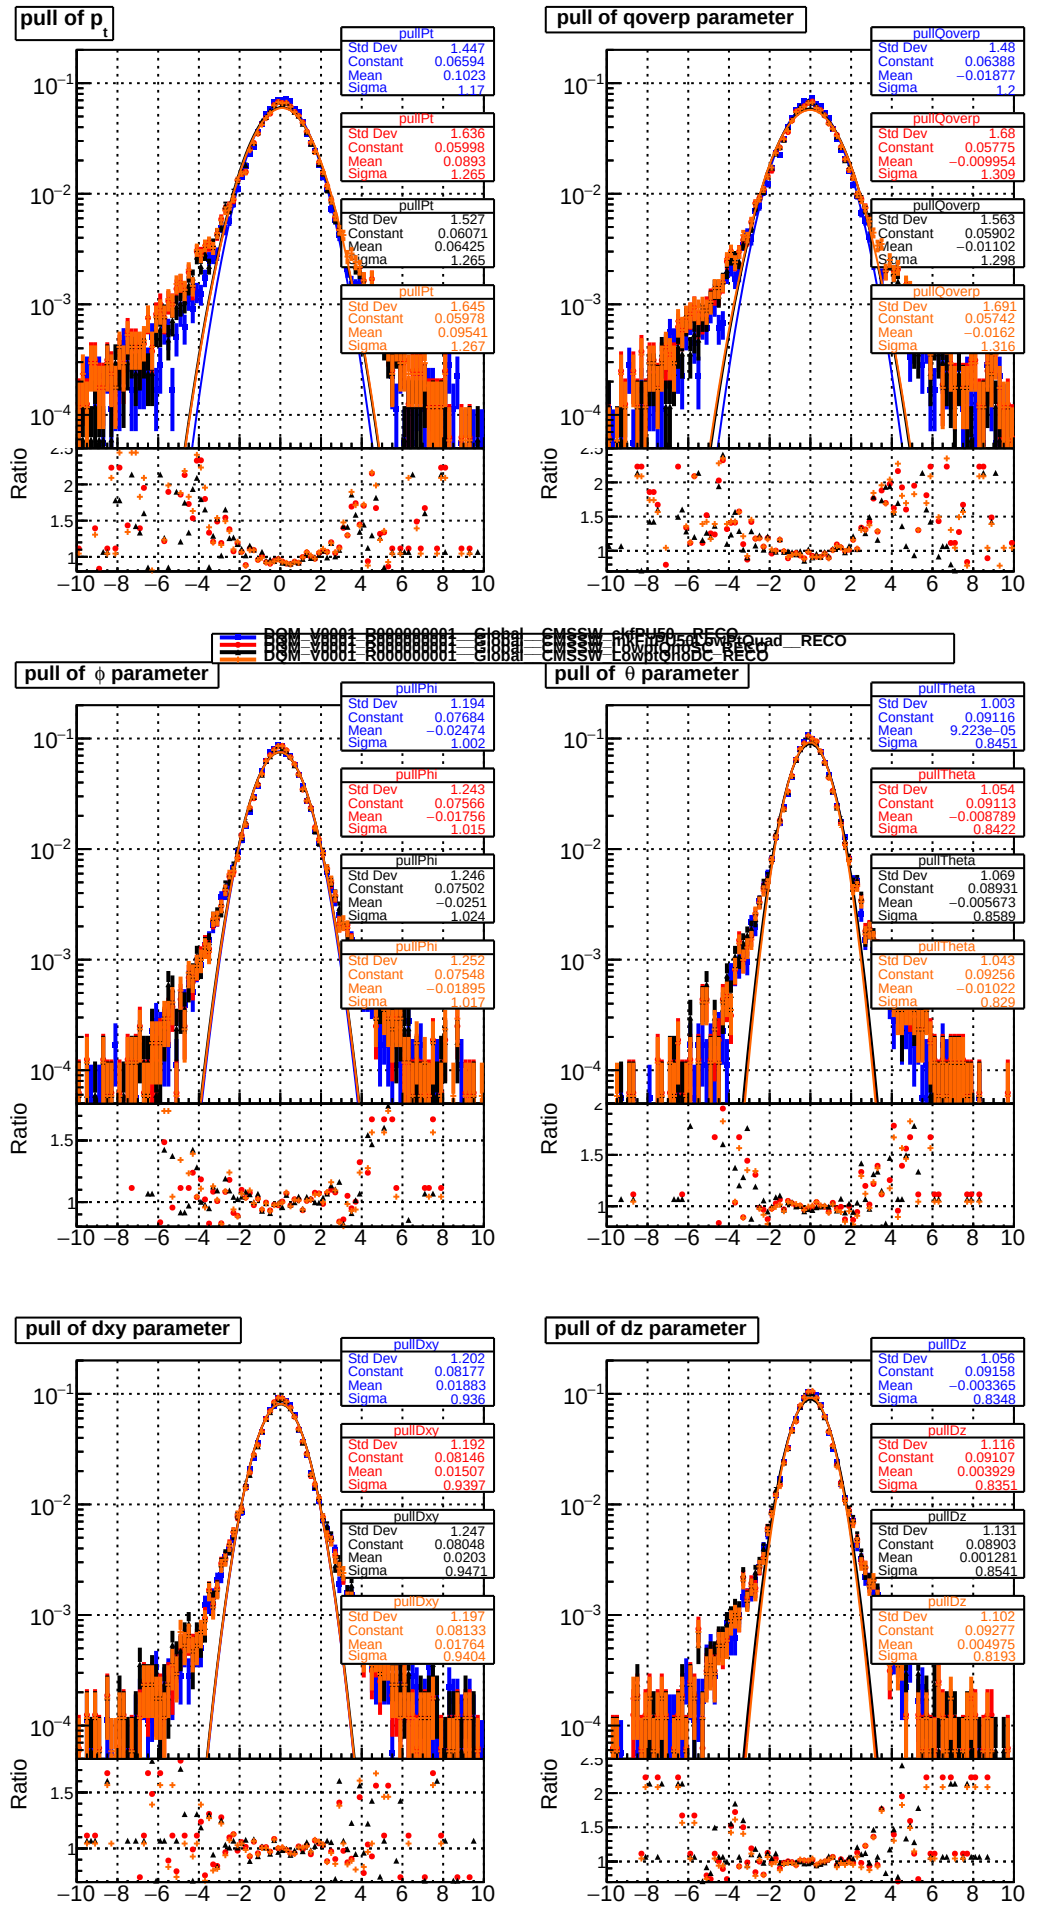
pull of p_t
pullPt
Std Dev 1.447
Constant 0.06594
Mean 0.1023
Sigma 1.17
pullPt
Std Dev 1.636
Constant 0.05998
Mean 0.0893
Sigma 1.265
pullPt
Std Dev 1.527
Constant 0.06071
Mean 0.06425
Sigma 1.265
pullPt
Std Dev 1.645
Constant 0.05978
Mean 0.09541
Sigma 1.267
pull of qoverp parameter
pullQoverp
Std Dev 1.48
Constant 0.06388
Mean −0.01877
Sigma 1.2
pullQoverp
Std Dev 1.68
Constant 0.05775
Mean −0.009954
Sigma 1.309
pullQoverp
Std Dev 1.563
Constant 0.05902
Mean −0.01102
Sigma 1.298
pullQoverp
Std Dev 1.691
Constant 0.05742
Mean −0.0162
Sigma 1.316
DQM V0001 R000000001 Global CMSSW_lowPtQuad_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.194
Constant 0.07684
Mean −0.02474
Sigma 1.002
pullPhi
Std Dev 1.243
Constant 0.07566
Mean −0.01756
Sigma 1.015
pullPhi
Std Dev 1.246
Constant 0.07502
Mean −0.0251
Sigma 1.024
pullPhi
Std Dev 1.252
Constant 0.07548
Mean −0.01895
Sigma 1.017
pull of θ parameter
pullTheta
Std Dev 1.003
Constant 0.09116
Mean 9.223e−05
Sigma 0.8451
pullTheta
Std Dev 1.054
Constant 0.09113
Mean −0.008789
Sigma 0.8422
pullTheta
Std Dev 1.069
Constant 0.08931
Mean −0.005673
Sigma 0.8589
pullTheta
Std Dev 1.043
Constant 0.09256
Mean −0.01022
Sigma 0.829
pull of dxy parameter
pullDxy
Std Dev 1.202
Constant 0.08177
Mean 0.01883
Sigma 0.936
pullDxy
Std Dev 1.192
Constant 0.08146
Mean 0.01507
Sigma 0.9397
pullDxy
Std Dev 1.247
Constant 0.08048
Mean 0.0203
Sigma 0.9471
pullDxy
Std Dev 1.197
Constant 0.08133
Mean 0.01764
Sigma 0.9404
pull of dz parameter
pullDz
Std Dev 1.056
Constant 0.09158
Mean −0.003365
Sigma 0.8348
pullDz
Std Dev 1.116
Constant 0.09107
Mean 0.003929
Sigma 0.8351
pullDz
Std Dev 1.131
Constant 0.08903
Mean 0.001281
Sigma 0.8541
pullDz
Std Dev 1.102
Constant 0.09277
Mean 0.004975
Sigma 0.8193
Ratio