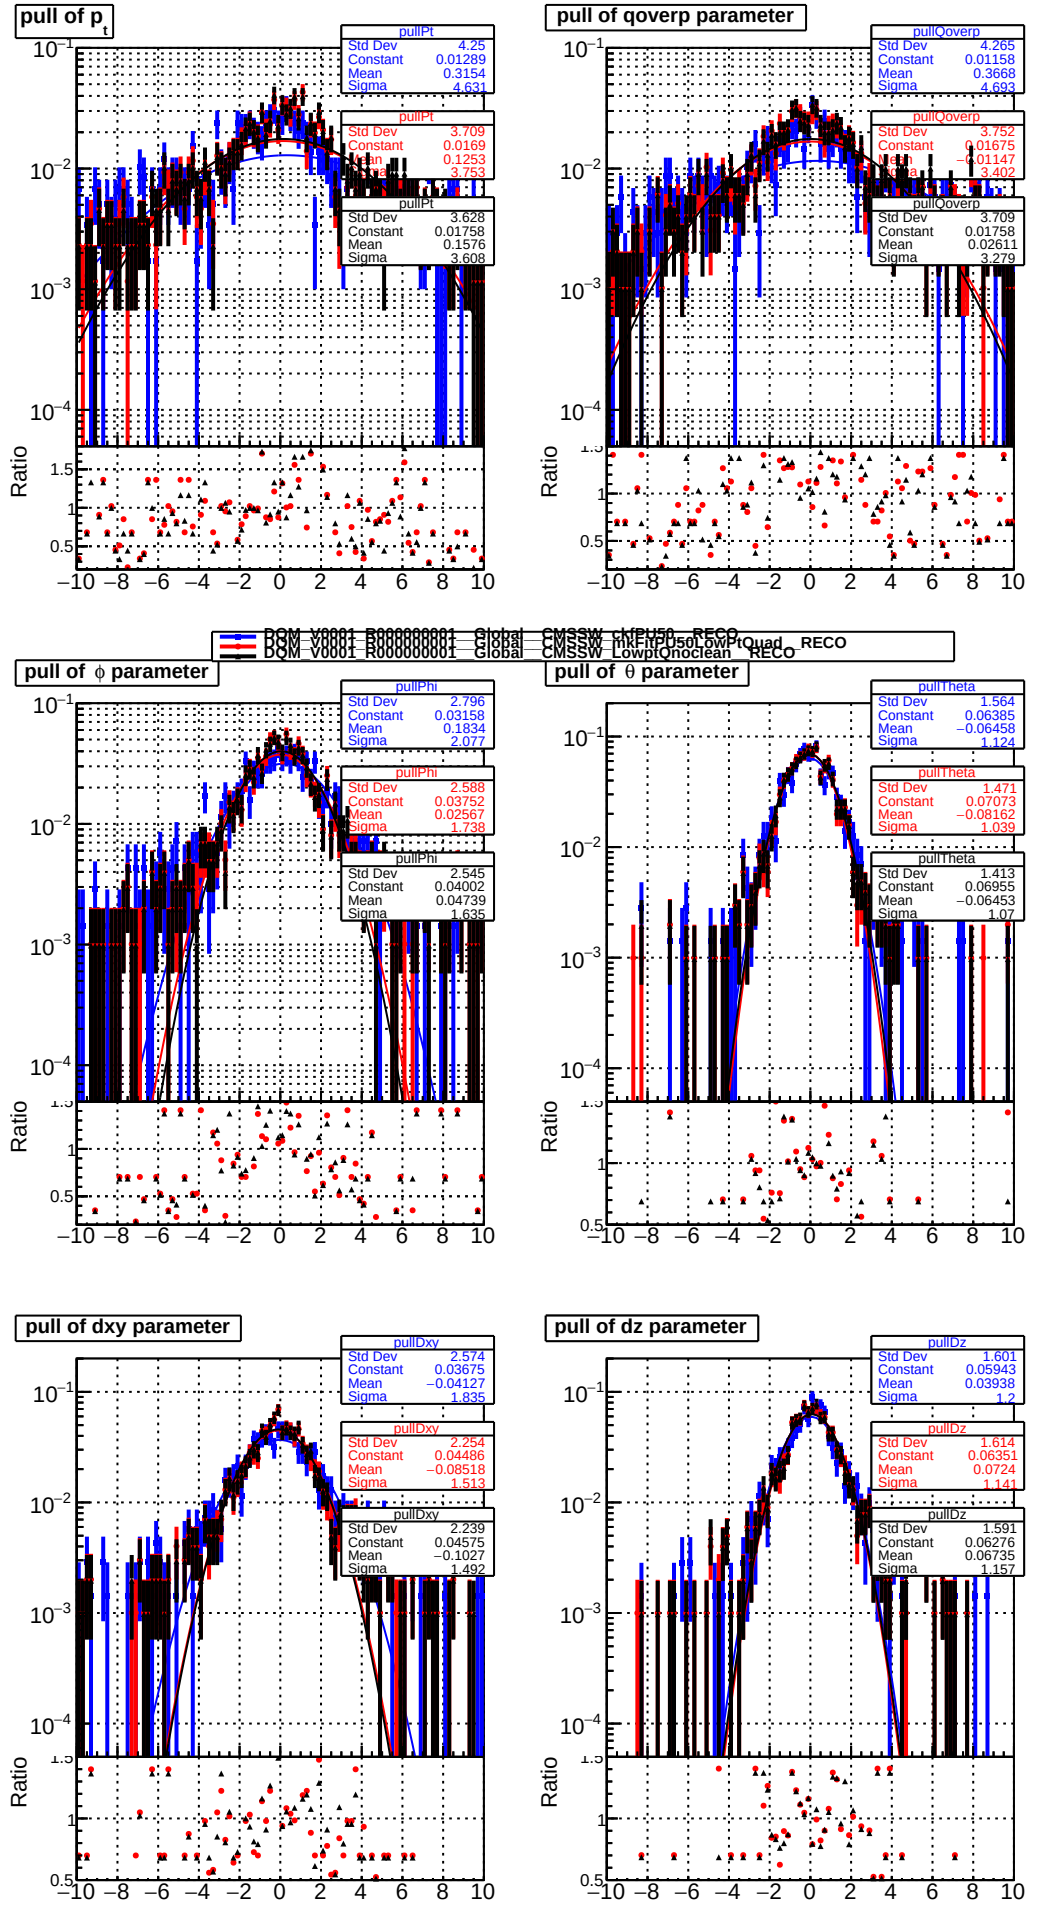
pull of p_t
pullPt
Std Dev 4.25
Constant 0.01289
Mean 0.3154
Sigma 4.631
pullPt
Std Dev 3.709
Constant 0.0169
Mean 0.1253
Sigma 3.753
pullPt
Std Dev 3.628
Constant 0.01758
Mean 0.1576
Sigma 3.608
pull of qoverp parameter
pullQoverp
Std Dev 4.265
Constant 0.01158
Mean 0.3668
Sigma 4.693
pullQoverp
Std Dev 3.752
Constant 0.01675
Mean −0.01147
Sigma 3.402
pullQoverp
Std Dev 3.709
Constant 0.01758
Mean 0.02611
Sigma 3.279
DQM_V0001_R000000001__Global__CMSSW_ckfPU50__RECO
DQM_V0001_R000000001__Global__CMSSW_lnKFitPU50LowPtQuad__RECO
DQM_V0001_R000000001__Global__CMSSW_LowptQnoclean__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.796
Constant 0.03158
Mean 0.1834
Sigma 2.077
pullPhi
Std Dev 2.588
Constant 0.03752
Mean 0.02567
Sigma 1.738
pullPhi
Std Dev 2.545
Constant 0.04002
Mean 0.04739
Sigma 1.635
pull of θ parameter
pullTheta
Std Dev 1.564
Constant 0.06385
Mean −0.06458
Sigma 1.124
pullTheta
Std Dev 1.471
Constant 0.07073
Mean −0.08162
Sigma 1.039
pullTheta
Std Dev 1.413
Constant 0.06955
Mean −0.06453
Sigma 1.07
pull of dxy parameter
pullDxy
Std Dev 2.574
Constant 0.03675
Mean −0.04127
Sigma 1.835
pullDxy
Std Dev 2.254
Constant 0.04486
Mean −0.08518
Sigma 1.513
pullDxy
Std Dev 2.239
Constant 0.04575
Mean −0.1027
Sigma 1.492
pull of dz parameter
pullDz
Std Dev 1.601
Constant 0.05943
Mean 0.03938
Sigma 1.2
pullDz
Std Dev 1.614
Constant 0.06351
Mean 0.0724
Sigma 1.141
pullDz
Std Dev 1.591
Constant 0.06276
Mean 0.06735
Sigma 1.157
Ratio