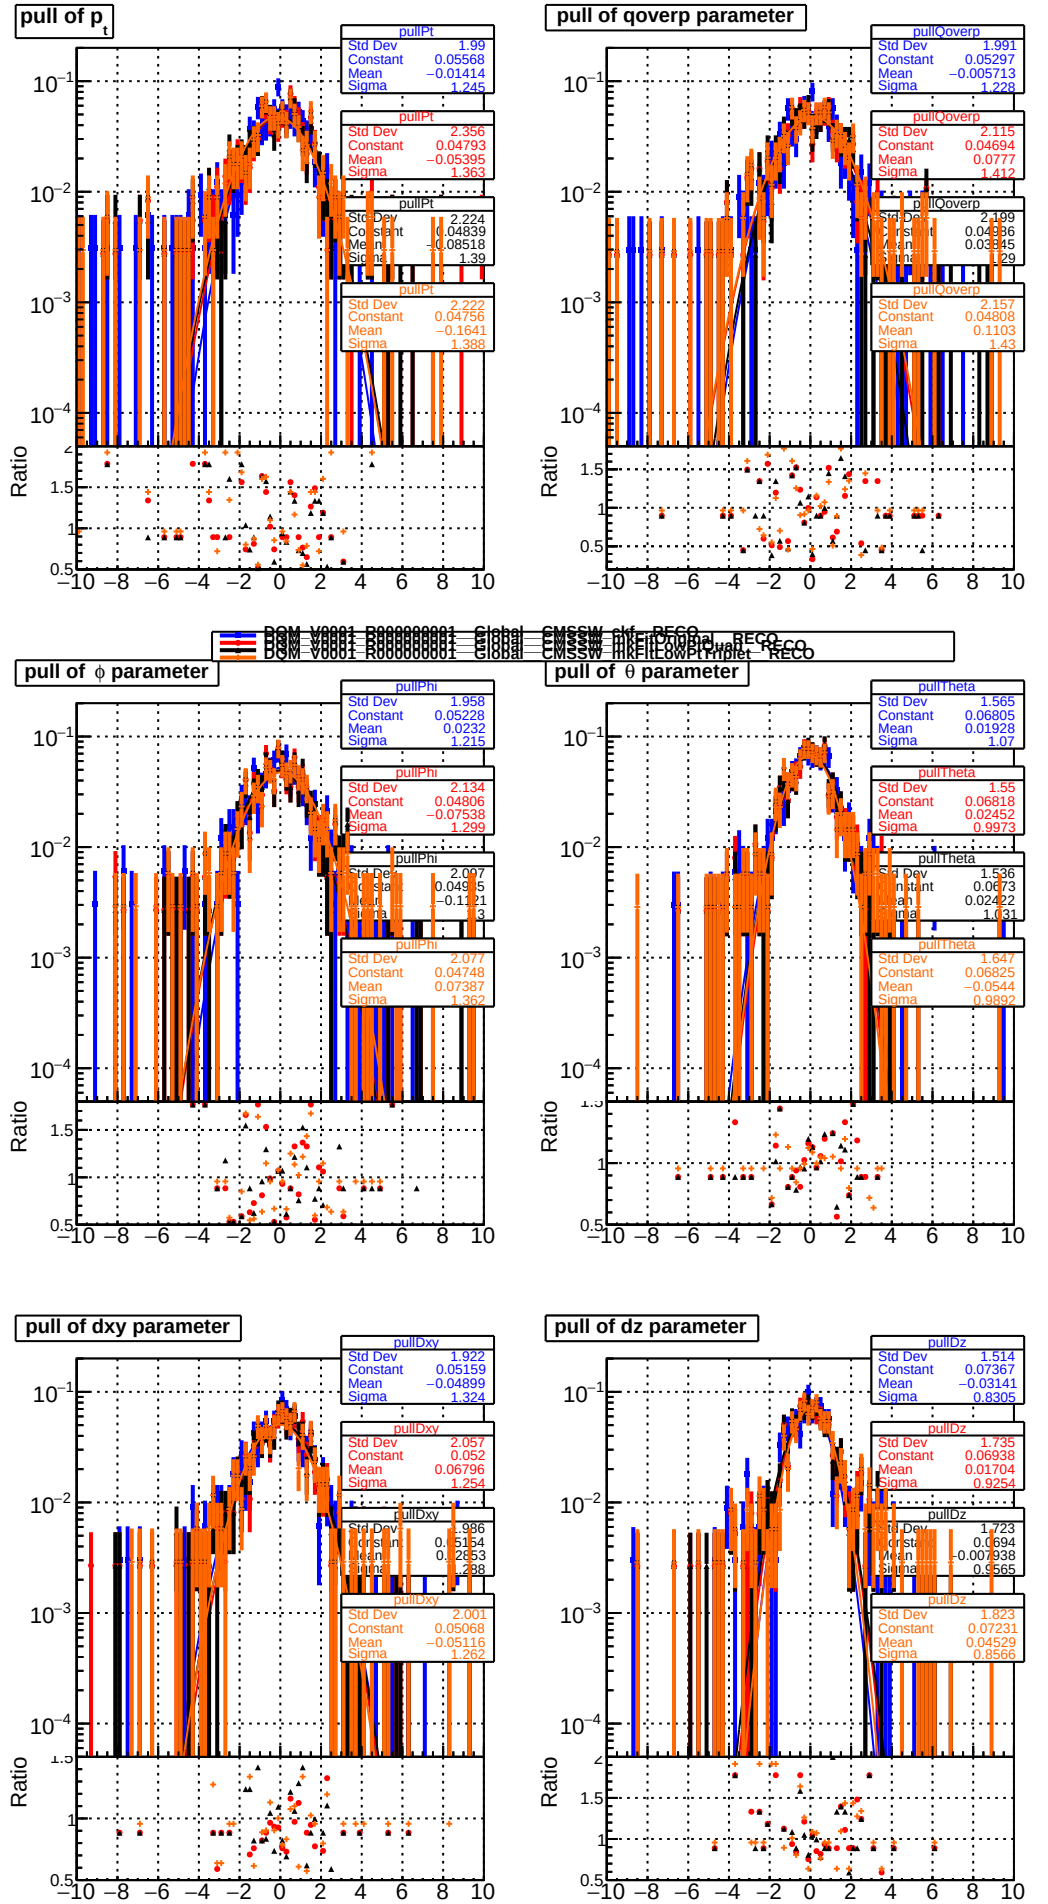
pull of p_t
pullPt
Std Dev 1.99
Constant 0.05568
Mean −0.01414
Sigma 1.245
pullPt
Std Dev 2.356
Constant 0.04793
Mean −0.05395
Sigma 1.363
pullPt
Std Dev 2.224
Constant 0.04839
Mean −0.08518
Sigma 1.39
pullPt
Std Dev 2.222
Constant 0.04756
Mean −0.1641
Sigma 1.388
pull of qoverp parameter
pullQoverp
Std Dev 1.991
Constant 0.05297
Mean −0.005713
Sigma 1.228
pullQoverp
Std Dev 2.115
Constant 0.04694
Mean 0.0777
Sigma 1.412
pullQoverp
Std Dev 2.199
Constant 0.04386
Mean 0.03845
Sigma 1.29
pullQoverp
Std Dev 2.157
Constant 0.04808
Mean 0.1103
Sigma 1.43
DQM V0001 R000000001 Global CMSSW_clkf_RECO
DQM V0001 R000000001 Global CMSSW_initialStepTrackFitter_RECO
DQM V0001 R000000001 Global CMSSW_lowPtQuadTriplet_RECO
DQM V0001 R000000001 Global CMSSW_lowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.958
Constant 0.05228
Mean 0.0232
Sigma 1.215
pullPhi
Std Dev 2.134
Constant 0.04806
Mean −0.07538
Sigma 1.299
pullPhi
Std Dev 2.097
Constant 0.04955
Mean −0.1121
Sigma 1.3
pullPhi
Std Dev 2.077
Constant 0.04748
Mean 0.07387
Sigma 1.362
pull of θ parameter
pullTheta
Std Dev 1.565
Constant 0.06805
Mean 0.01928
Sigma 1.07
pullTheta
Std Dev 1.55
Constant 0.06818
Mean 0.02452
Sigma 0.9973
pullTheta
Std Dev 1.536
Constant 0.0673
Mean 0.02422
Sigma 1.031
pullTheta
Std Dev 1.647
Constant 0.06825
Mean −0.0544
Sigma 0.9892
pull of dxy parameter
pullDxy
Std Dev 1.922
Constant 0.05159
Mean −0.04899
Sigma 1.324
pullDxy
Std Dev 2.057
Constant 0.052
Mean 0.06796
Sigma 1.254
pullDxy
Std Dev 1.986
Constant 0.05154
Mean 0.02853
Sigma 1.238
pullDxy
Std Dev 2.001
Constant 0.05068
Mean −0.05116
Sigma 1.262
pull of dz parameter
pullDz
Std Dev 1.514
Constant 0.07367
Mean −0.03141
Sigma 0.8305
pullDz
Std Dev 1.735
Constant 0.06938
Mean 0.01704
Sigma 0.9254
pullDz
Std Dev 1.723
Constant 0.0694
Mean −0.007938
Sigma 0.9565
pullDz
Std Dev 1.823
Constant 0.07231
Mean 0.04529
Sigma 0.8566
Ratio