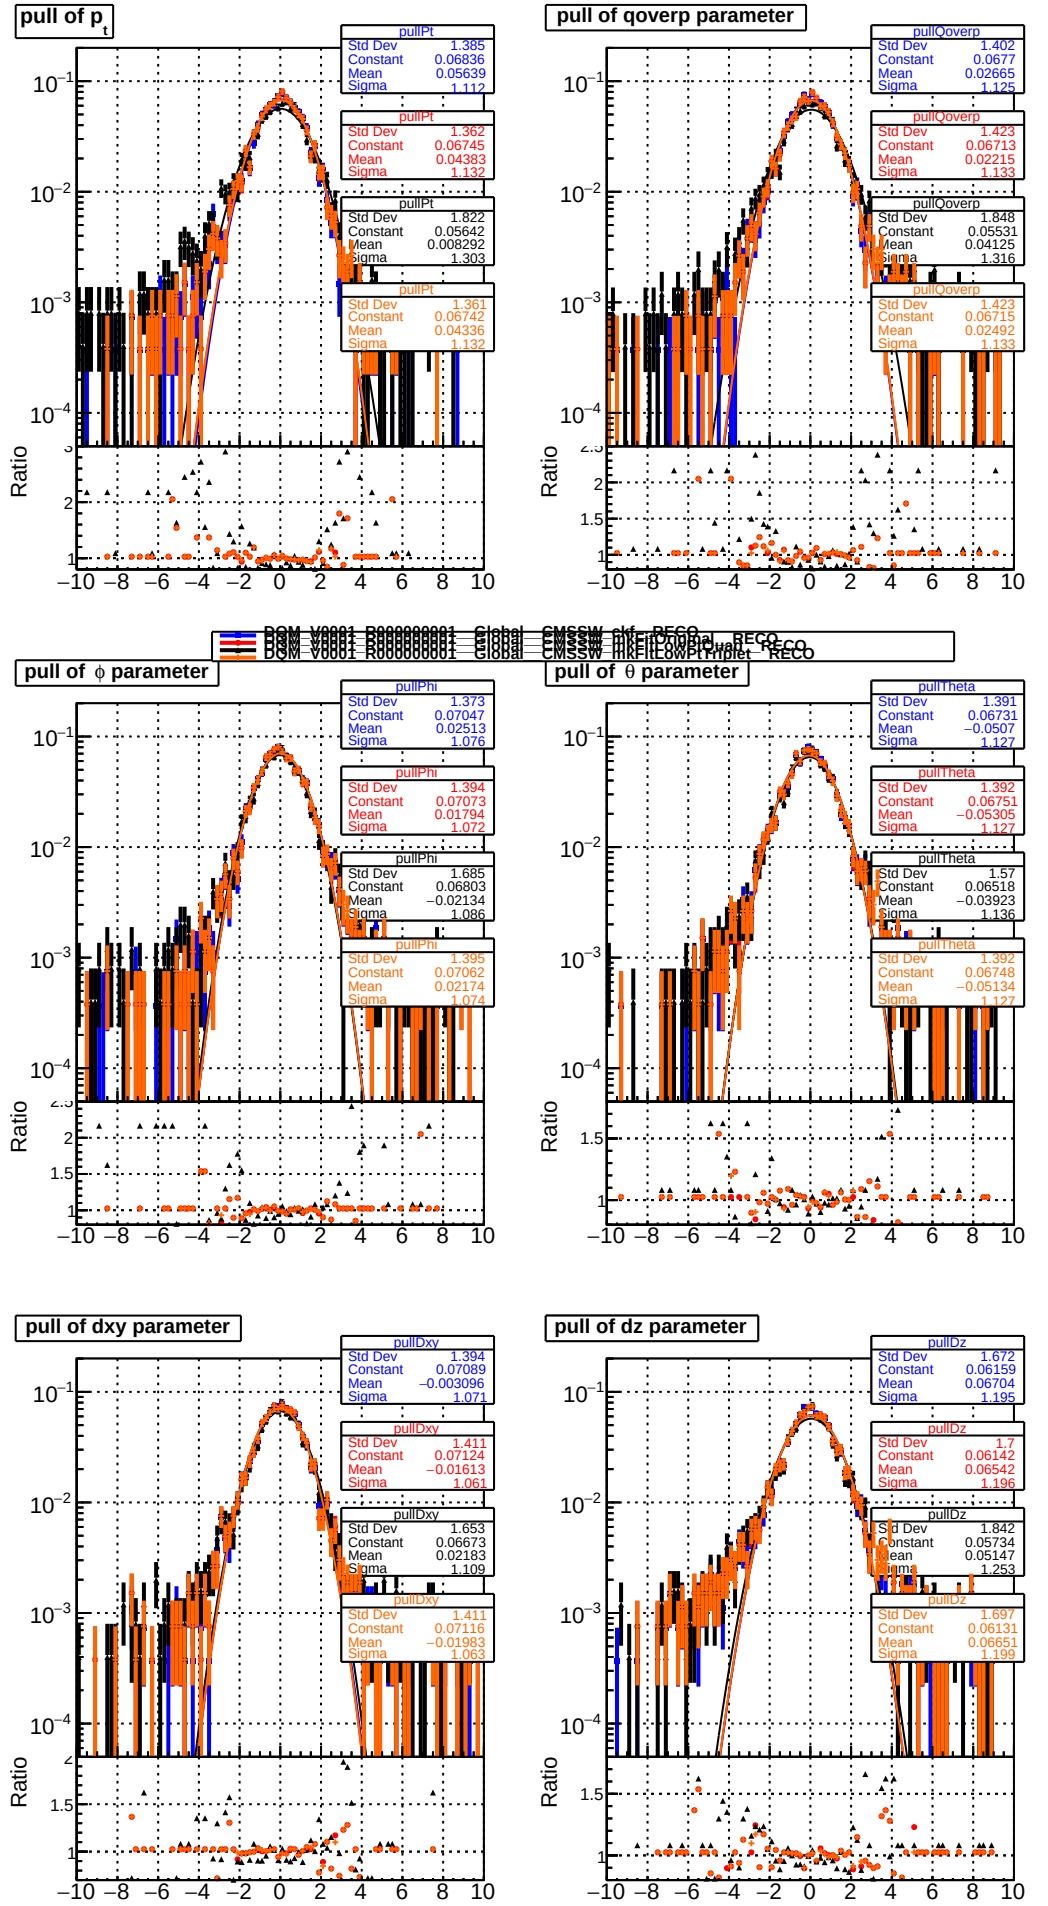
pull of p_t
pullPt
Std Dev 1.385
Constant 0.06836
Mean 0.05639
Sigma 1.112
pullPt
Std Dev 1.362
Constant 0.06745
Mean 0.04383
Sigma 1.132
pullPt
Std Dev 1.822
Constant 0.05642
Mean 0.008292
Sigma 1.303
pullPt
Std Dev 1.361
Constant 0.06742
Mean 0.04336
Sigma 1.132
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.402
Constant 0.0677
Mean 0.02665
Sigma 1.125
pullQoverp
Std Dev 1.423
Constant 0.06713
Mean 0.02215
Sigma 1.133
pullQoverp
Std Dev 1.848
Constant 0.05531
Mean 0.04125
Sigma 1.316
pullQoverp
Std Dev 1.423
Constant 0.06715
Mean 0.02492
Sigma 1.133
Ratio
DQM V0001 R000000001 Global CMSSW_clf_RECO
DQM V0001 R000000001 Global CMSSW_hlkFlt_lowPtQuadr_RECO
DQM V0001 R000000001 Global CMSSW_hlkFlt_lowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.373
Constant 0.07047
Mean 0.02513
Sigma 1.076
pullPhi
Std Dev 1.394
Constant 0.07073
Mean 0.01794
Sigma 1.072
pullPhi
Std Dev 1.685
Constant 0.06803
Mean −0.02134
Sigma 1.086
pullPhi
Std Dev 1.395
Constant 0.07062
Mean 0.02174
Sigma 1.074
Ratio
pull of θ parameter
pullTheta
Std Dev 1.391
Constant 0.06731
Mean −0.0507
Sigma 1.127
pullTheta
Std Dev 1.392
Constant 0.06751
Mean −0.05305
Sigma 1.127
pullTheta
Std Dev 1.57
Constant 0.06518
Mean −0.03923
Sigma 1.136
pullTheta
Std Dev 1.392
Constant 0.06748
Mean −0.05134
Sigma 1.127
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.394
Constant 0.07089
Mean −0.003096
Sigma 1.071
pullDxy
Std Dev 1.411
Constant 0.07124
Mean −0.01613
Sigma 1.061
pullDxy
Std Dev 1.653
Constant 0.06673
Mean 0.02183
Sigma 1.109
pullDxy
Std Dev 1.411
Constant 0.07116
Mean −0.01983
Sigma 1.063
Ratio
pull of dz parameter
pullDz
Std Dev 1.672
Constant 0.06159
Mean 0.06704
Sigma 1.195
pullDz
Std Dev 1.7
Constant 0.06142
Mean 0.06542
Sigma 1.196
pullDz
Std Dev 1.842
Constant 0.05734
Mean 0.05147
Sigma 1.253
pullDz
Std Dev 1.697
Constant 0.06131
Mean 0.06651
Sigma 1.199
Ratio