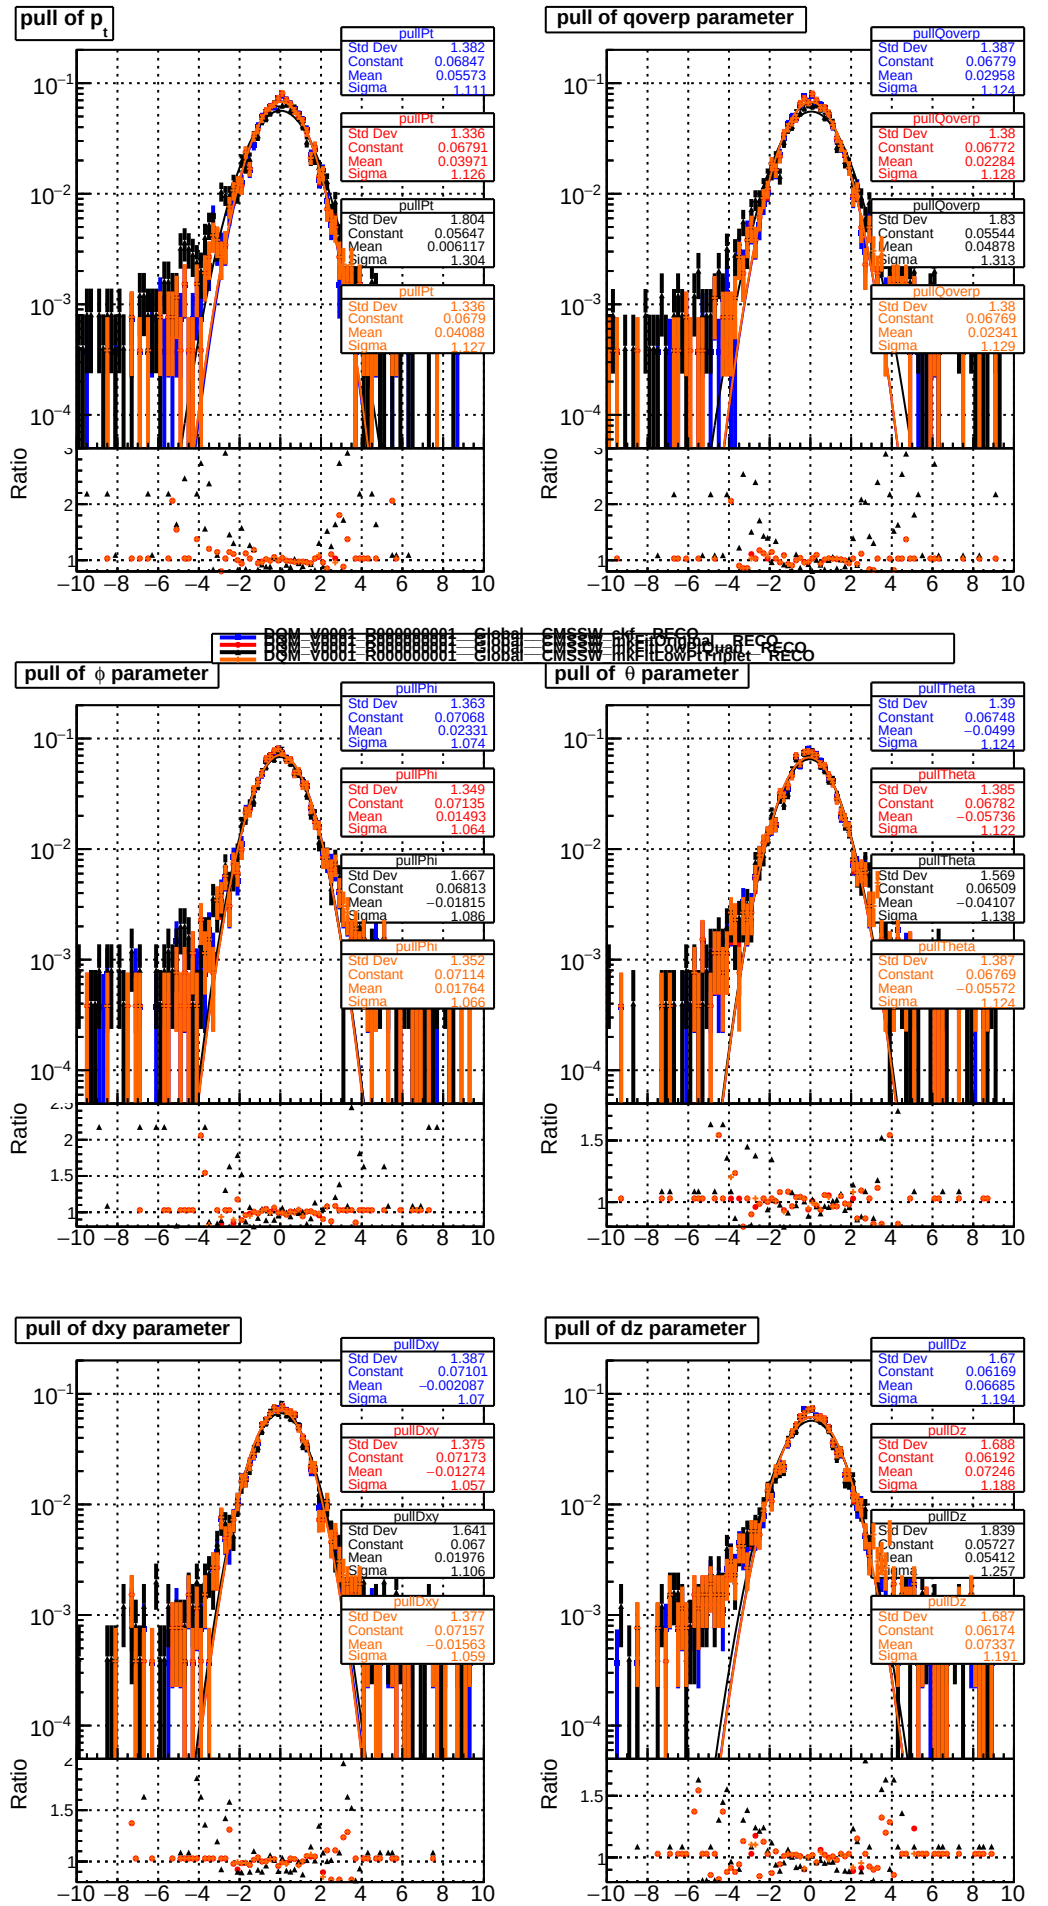
pull of p_t
pullPt
Std Dev 1.382
Constant 0.06847
Mean 0.05573
Sigma 1.111
pullPt
Std Dev 1.336
Constant 0.06791
Mean 0.03971
Sigma 1.126
pullPt
Std Dev 1.804
Constant 0.05647
Mean 0.006117
Sigma 1.304
pullPt
Std Dev 1.336
Constant 0.0679
Mean 0.04088
Sigma 1.127
pull of qoverp parameter
pullQoverp
Std Dev 1.387
Constant 0.06779
Mean 0.02958
Sigma 1.124
pullQoverp
Std Dev 1.38
Constant 0.06772
Mean 0.02284
Sigma 1.128
pullQoverp
Std Dev 1.83
Constant 0.05544
Mean 0.04878
Sigma 1.313
pullQoverp
Std Dev 1.38
Constant 0.06769
Mean 0.02341
Sigma 1.129
Ratio
DQM V0001 R000000001 Global CMSSW cfg RECO
DQM V0001 R000000001 Global CMSSW hlt RECO
DQM V0001 R000000001 Global CMSSW hlt RECO
DQM V0001 R000000001 Global CMSSW hlt RECO
pull of ϕ parameter
pullPhi
Std Dev 1.363
Constant 0.07068
Mean 0.02331
Sigma 1.074
pullPhi
Std Dev 1.349
Constant 0.07135
Mean 0.01493
Sigma 1.064
pullPhi
Std Dev 1.667
Constant 0.06813
Mean −0.01815
Sigma 1.086
pullPhi
Std Dev 1.352
Constant 0.07114
Mean 0.01764
Sigma 1.066
pull of θ parameter
pullTheta
Std Dev 1.39
Constant 0.06748
Mean −0.0499
Sigma 1.124
pullTheta
Std Dev 1.385
Constant 0.06782
Mean −0.05736
Sigma 1.122
pullTheta
Std Dev 1.569
Constant 0.06509
Mean −0.04107
Sigma 1.138
pullTheta
Std Dev 1.387
Constant 0.06769
Mean −0.05572
Sigma 1.124
pull of dxy parameter
pullDxy
Std Dev 1.387
Constant 0.07101
Mean −0.002087
Sigma 1.07
pullDxy
Std Dev 1.375
Constant 0.07173
Mean −0.01274
Sigma 1.057
pullDxy
Std Dev 1.641
Constant 0.067
Mean 0.01976
Sigma 1.106
pullDxy
Std Dev 1.377
Constant 0.07157
Mean −0.01563
Sigma 1.059
pull of dz parameter
pullDz
Std Dev 1.67
Constant 0.06169
Mean 0.06685
Sigma 1.194
pullDz
Std Dev 1.688
Constant 0.06192
Mean 0.07246
Sigma 1.188
pullDz
Std Dev 1.839
Constant 0.05727
Mean 0.05412
Sigma 1.257
pullDz
Std Dev 1.687
Constant 0.06174
Mean 0.07337
Sigma 1.191