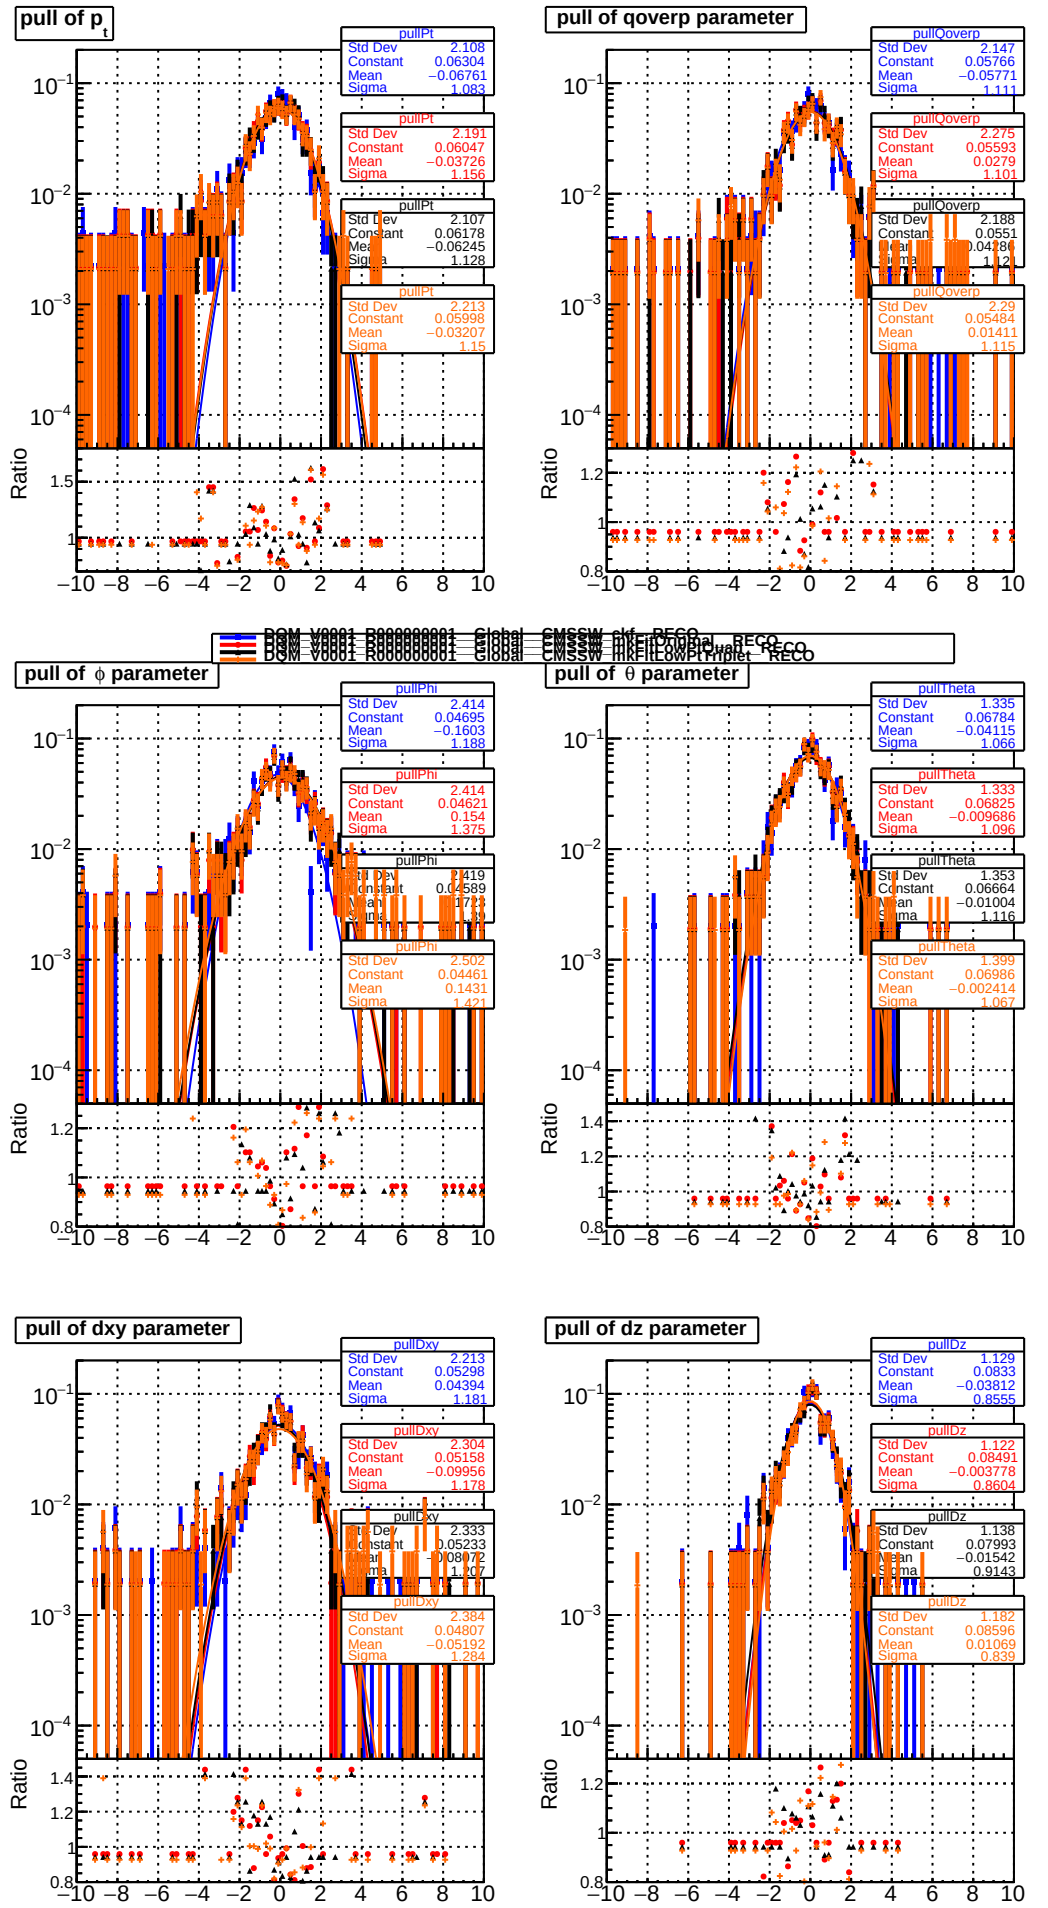
pull of p_t
pullPt
Std Dev 2.108
Constant 0.06304
Mean −0.06761
Sigma 1.083
pullPt
Std Dev 2.191
Constant 0.06047
Mean −0.03726
Sigma 1.156
pullPt
Std Dev 2.107
Constant 0.06178
Mean −0.06245
Sigma 1.128
pullPt
Std Dev 2.213
Constant 0.05998
Mean −0.03207
Sigma 1.15
pull of qoverp parameter
pullQoverp
Std Dev 2.147
Constant 0.05766
Mean −0.05771
Sigma 1.111
pullQoverp
Std Dev 2.275
Constant 0.05593
Mean 0.0279
Sigma 1.101
pullQoverp
Std Dev 2.188
Constant 0.0551
pullQoverp
Std Dev 2.29
Constant 0.05484
Mean 0.01411
Sigma 1.115
DQM V0001 R000000001 Global CMSSW_ckf_RECO
DQM V0001 R000000001 Global CMSSW_ckf_Quad_RECO
DQM V0001 R000000001 Global CMSSW_ckf_LowPtTriplet_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.414
Constant 0.04695
Mean −0.1603
Sigma 1.188
pullPhi
Std Dev 2.414
Constant 0.04621
Mean 0.154
Sigma 1.375
pullPhi
Std Dev 2.419
Constant 0.04589
pullPhi
Std Dev 2.502
Constant 0.04461
Mean 0.1431
pull of θ parameter
pullTheta
Std Dev 1.335
Constant 0.06784
Mean −0.04115
Sigma 1.066
pullTheta
Std Dev 1.333
Constant 0.06825
Mean −0.009686
Sigma 1.096
pullTheta
Std Dev 1.353
Constant 0.06664
Mean −0.01004
Sigma 1.116
pullTheta
Std Dev 1.399
Constant 0.06986
Mean −0.002414
Sigma 1.067
pull of dxy parameter
pullDxy
Std Dev 2.213
Constant 0.05298
Mean 0.04394
Sigma 1.181
pullDxy
Std Dev 2.304
Constant 0.05158
Mean −0.09956
Sigma 1.178
pullDxy
Std Dev 2.333
Constant 0.05233
pullDxy
Std Dev 2.384
Constant 0.04807
Mean −0.05192
Sigma 1.284
pull of dz parameter
pullDz
Std Dev 1.129
Constant 0.0833
Mean −0.03812
Sigma 0.8555
pullDz
Std Dev 1.122
Constant 0.08491
Mean −0.003778
Sigma 0.8604
pullDz
Std Dev 1.138
Constant 0.07993
Mean −0.01542
Sigma 0.9143
pullDz
Std Dev 1.182
Constant 0.08596
Mean 0.01069
Sigma 0.839
Ratio