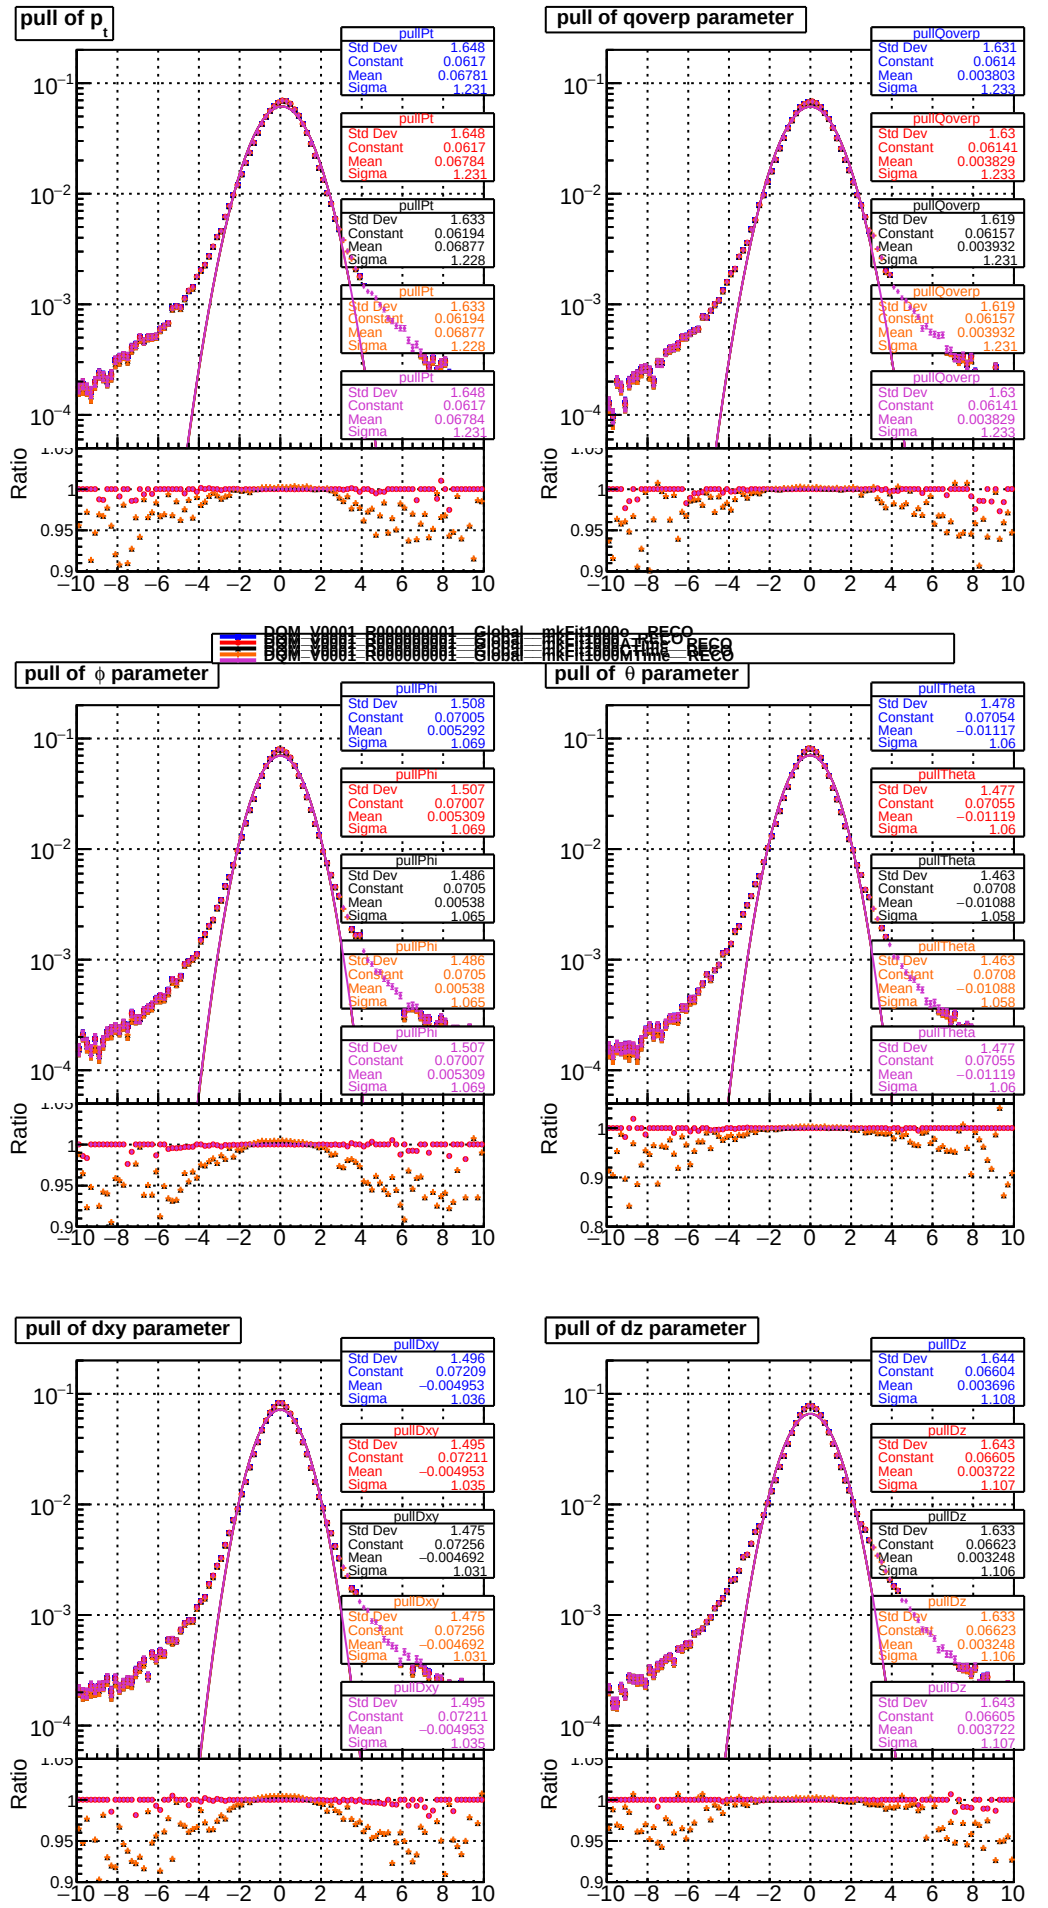
pull of p_t
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.06781
Sigma 1.231
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.06784
Sigma 1.231
pullPt
Std Dev 1.633
Constant 0.06194
Mean 0.06877
Sigma 1.228
pullPt
Std Dev 1.633
Constant 0.06194
Mean 0.06877
Sigma 1.228
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.06784
Sigma 1.231
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.631
Constant 0.0614
Mean 0.003803
Sigma 1.233
pullQoverp
Std Dev 1.63
Constant 0.06141
Mean 0.003829
Sigma 1.233
pullQoverp
Std Dev 1.619
Constant 0.06157
Mean 0.003932
Sigma 1.231
pullQoverp
Std Dev 1.619
Constant 0.06157
Mean 0.003932
Sigma 1.231
pullQoverp
Std Dev 1.63
Constant 0.06141
Mean 0.003829
Sigma 1.233
Ratio
DQM V0001 R000000001 Global mkFit1000o RECO
DQM V0001 R000000001 Global mkFit1000o RECO
DQM V0001 R000000001 Global mkFit1000oMTime RECO
DQM V0001 R000000001 Global mkFit1000oMTime RECO
pull of ϕ parameter
pullPhi
Std Dev 1.508
Constant 0.07005
Mean 0.005292
Sigma 1.069
pullPhi
Std Dev 1.507
Constant 0.07007
Mean 0.005309
Sigma 1.069
pullPhi
Std Dev 1.486
Constant 0.0705
Mean 0.00538
Sigma 1.065
pullPhi
Std Dev 1.486
Constant 0.0705
Mean 0.00538
Sigma 1.065
pullPhi
Std Dev 1.507
Constant 0.07007
Mean 0.005309
Sigma 1.069
Ratio
pull of θ parameter
pullTheta
Std Dev 1.478
Constant 0.07054
Mean −0.01117
Sigma 1.06
pullTheta
Std Dev 1.477
Constant 0.07055
Mean −0.01119
Sigma 1.06
pullTheta
Std Dev 1.463
Constant 0.0708
Mean −0.01088
Sigma 1.058
pullTheta
Std Dev 1.463
Constant 0.0708
Mean −0.01088
Sigma 1.058
pullTheta
Std Dev 1.477
Constant 0.07055
Mean −0.01119
Sigma 1.06
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.496
Constant 0.07209
Mean −0.004953
Sigma 1.036
pullDxy
Std Dev 1.495
Constant 0.07211
Mean −0.004953
Sigma 1.035
pullDxy
Std Dev 1.475
Constant 0.07256
Mean −0.004692
Sigma 1.031
pullDxy
Std Dev 1.475
Constant 0.07256
Mean −0.004692
Sigma 1.031
pullDxy
Std Dev 1.495
Constant 0.07211
Mean −0.004953
Sigma 1.035
Ratio
pull of dz parameter
pullDz
Std Dev 1.644
Constant 0.06604
Mean 0.003696
Sigma 1.108
pullDz
Std Dev 1.643
Constant 0.06605
Mean 0.003722
Sigma 1.107
pullDz
Std Dev 1.633
Constant 0.06623
Mean 0.003248
Sigma 1.106
pullDz
Std Dev 1.633
Constant 0.06623
Mean 0.003248
Sigma 1.106
pullDz
Std Dev 1.643
Constant 0.06605
Mean 0.003722
Sigma 1.107
Ratio