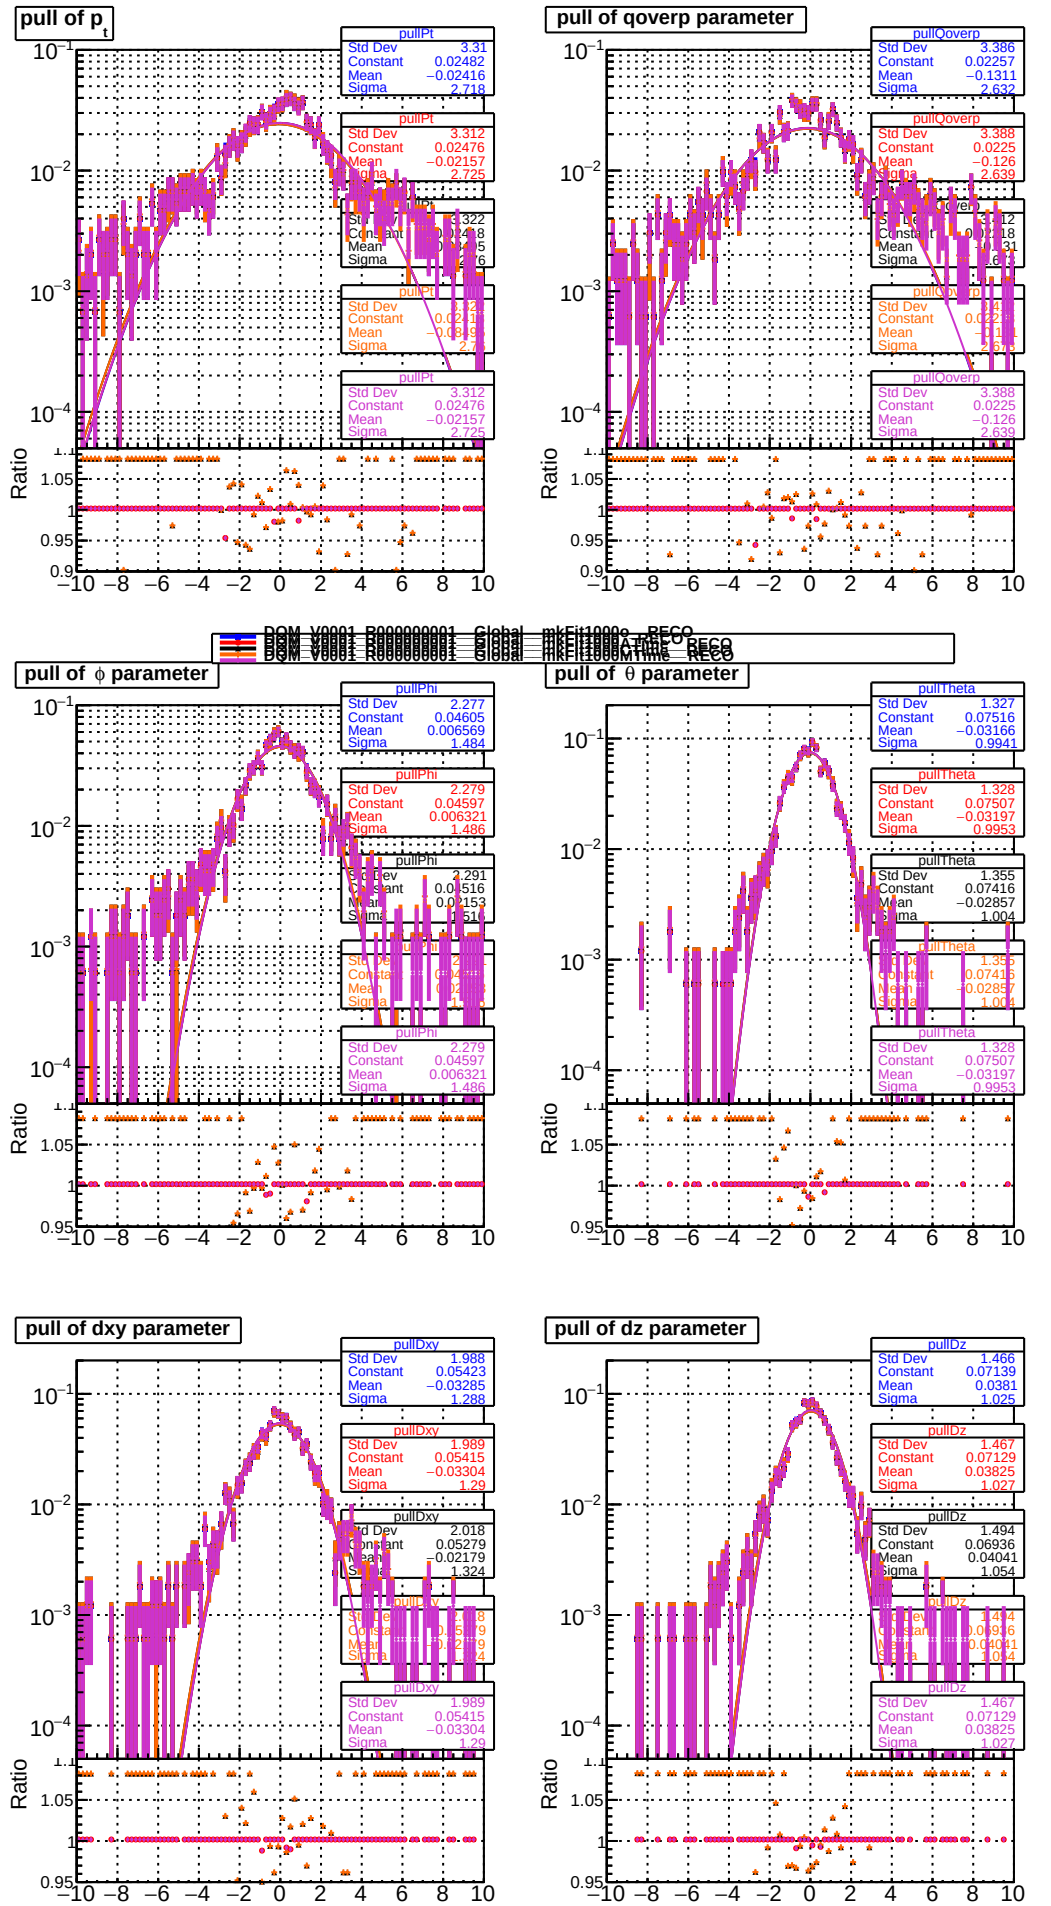
pull of p_t
pullPt
Std Dev 3.31
Constant 0.02482
Mean −0.02416
Sigma 2.718
pullPt
Std Dev 3.312
Constant 0.02476
Mean −0.02157
Sigma 2.725
pullPt
Std Dev 3.322
Constant 0.02118
Mean −0.0125
Sigma 2.76
pullPt
Std Dev 3.312
Constant 0.02476
Mean −0.02157
Sigma 2.725
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 3.386
Constant 0.02257
Mean −0.1311
Sigma 2.632
pullQoverp
Std Dev 3.388
Constant 0.0225
Mean −0.126
Sigma 2.639
pullQoverp
Std Dev 3.388
Constant 0.0225
Mean −0.126
Sigma 2.639
Ratio
DQM_V0001_R000000001__Global__mkFit1000__RECO
DQM_V0001_R000000001__Global__mkFit1000A__RECO
DQM_V0001_R000000001__Global__mkFit1000M__RECO
DQM_V0001_R000000001__Global__mkFit1000MTime__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.277
Constant 0.04605
Mean 0.006569
Sigma 1.484
pullPhi
Std Dev 2.279
Constant 0.04597
Mean 0.006321
Sigma 1.486
pullPhi
Std Dev 2.291
Constant 0.04516
Mean 0.00153
Sigma 1.516
pullPhi
Std Dev 2.279
Constant 0.04597
Mean 0.006321
Sigma 1.486
Ratio
pull of θ parameter
pullTheta
Std Dev 1.327
Constant 0.07516
Mean −0.03166
Sigma 0.9941
pullTheta
Std Dev 1.328
Constant 0.07507
Mean −0.03197
Sigma 0.9953
pullTheta
Std Dev 1.355
Constant 0.07416
Mean −0.02857
Sigma 1.004
pullTheta
Std Dev 1.328
Constant 0.07507
Mean −0.03197
Sigma 0.9953
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.988
Constant 0.05423
Mean −0.03285
Sigma 1.288
pullDxy
Std Dev 1.989
Constant 0.05415
Mean −0.03304
Sigma 1.29
pullDxy
Std Dev 2.018
Constant 0.05279
Mean −0.02179
Sigma 1.324
pullDxy
Std Dev 1.989
Constant 0.05415
Mean −0.03304
Sigma 1.29
Ratio
pull of dz parameter
pullDz
Std Dev 1.466
Constant 0.07139
Mean 0.0381
Sigma 1.025
pullDz
Std Dev 1.467
Constant 0.07129
Mean 0.03825
Sigma 1.027
pullDz
Std Dev 1.494
Constant 0.06936
Mean 0.04041
Sigma 1.054
pullDz
Std Dev 1.467
Constant 0.07129
Mean 0.03825
Sigma 1.027
Ratio