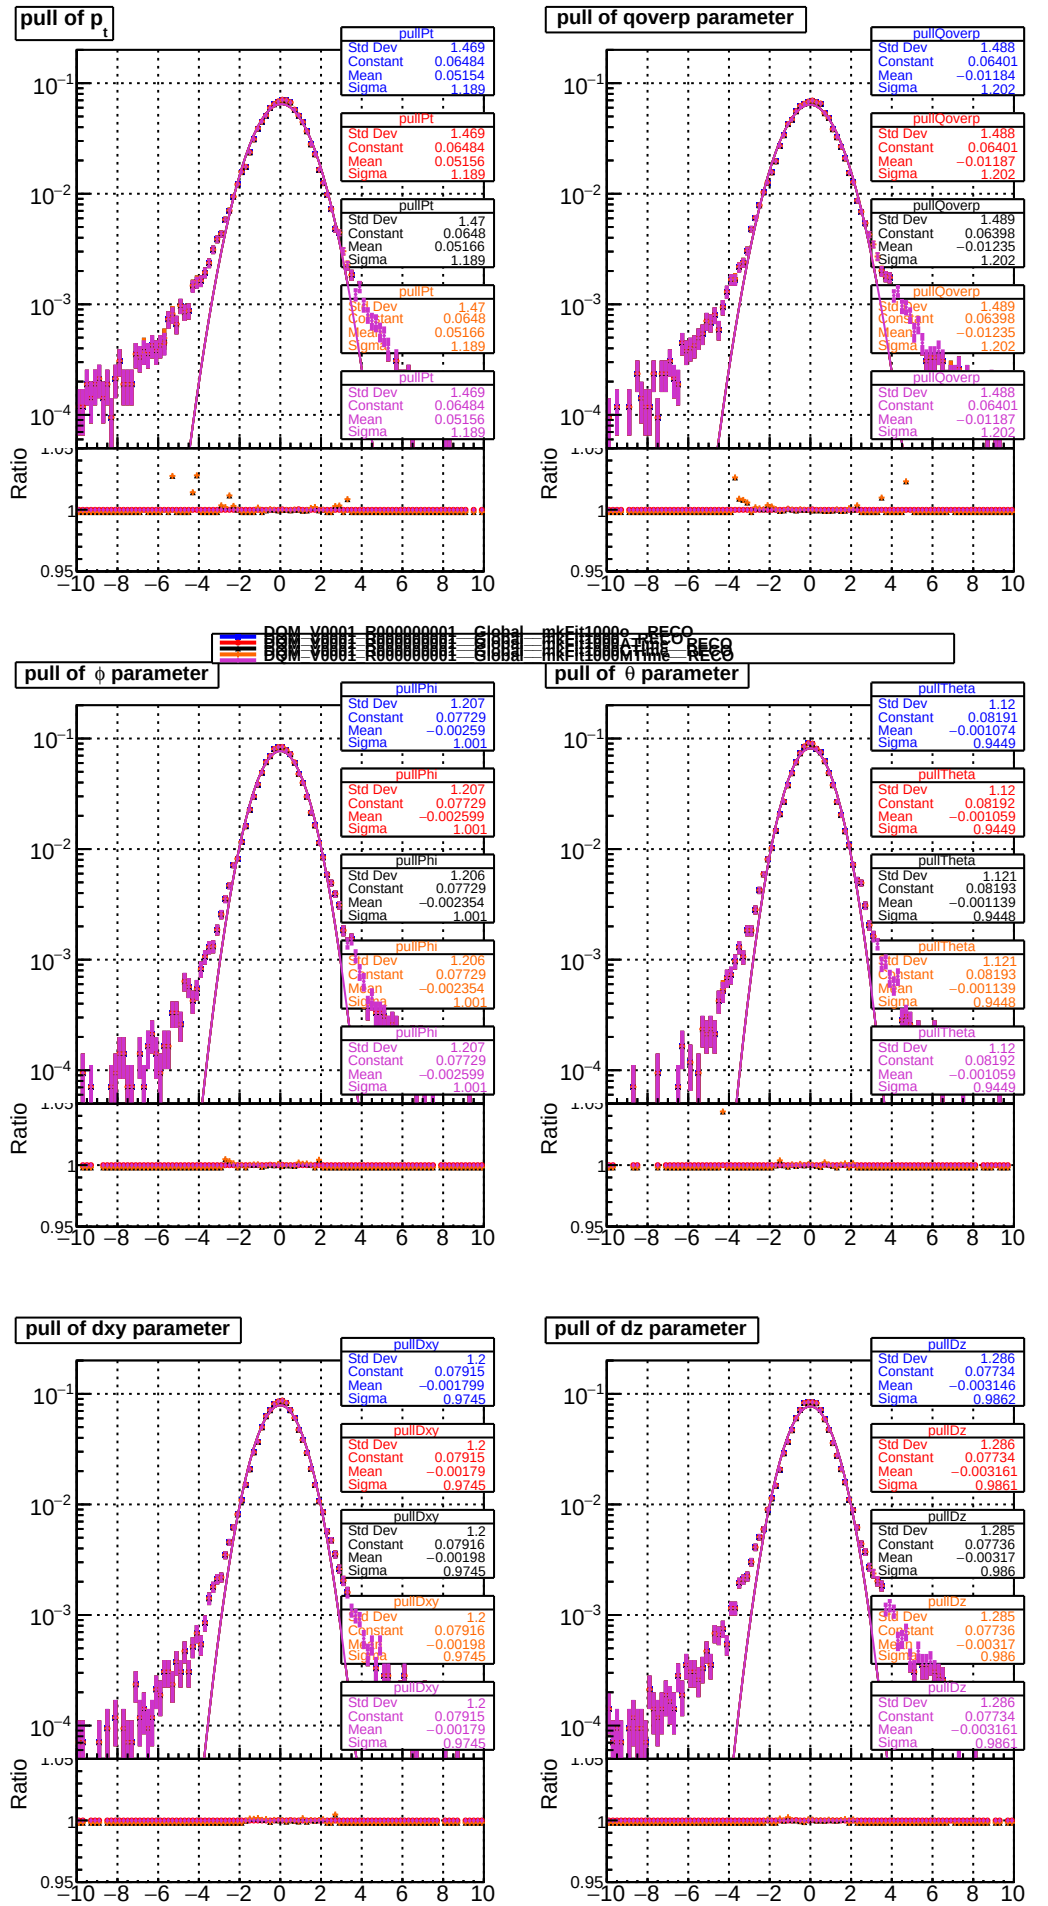
pull of $p_t$
pullPt
Std Dev 1.469
Constant 0.06484
Mean 0.05154
Sigma 1.189
pullPt
Std Dev 1.469
Constant 0.06484
Mean 0.05156
Sigma 1.189
pullPt
Std Dev 1.47
Constant 0.0648
Mean 0.05166
Sigma 1.189
pullPt
Std Dev 1.47
Constant 0.0648
Mean 0.05166
Sigma 1.189
pullPt
Std Dev 1.469
Constant 0.06484
Mean 0.05156
Sigma 1.189
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.488
Constant 0.06401
Mean −0.01184
Sigma 1.202
pullQoverp
Std Dev 1.488
Constant 0.06401
Mean −0.01187
Sigma 1.202
pullQoverp
Std Dev 1.489
Constant 0.06398
Mean −0.01235
Sigma 1.202
pullQoverp
Std Dev 1.489
Constant 0.06398
Mean −0.01235
Sigma 1.202
pullQoverp
Std Dev 1.488
Constant 0.06401
Mean −0.01187
Sigma 1.202
Ratio
DQM_V0001_R000000001__Global__mkFit1000__RECO
DQM_V0001_R000000001__Global__mkFit1000A__RECO
DQM_V0001_R000000001__Global__mkFit1000Mtime__RECO
pull of $\phi$ parameter
pullPhi
Std Dev 1.207
Constant 0.07729
Mean −0.00259
Sigma 1.001
pullPhi
Std Dev 1.207
Constant 0.07729
Mean −0.002599
Sigma 1.001
pullPhi
Std Dev 1.206
Constant 0.07729
Mean −0.002354
Sigma 1.001
pullPhi
Std Dev 1.206
Constant 0.07729
Mean −0.002354
Sigma 1.001
pullPhi
Std Dev 1.207
Constant 0.07729
Mean −0.002599
Sigma 1.001
Ratio
pull of $\theta$ parameter
pullTheta
Std Dev 1.12
Constant 0.08191
Mean −0.001074
Sigma 0.9449
pullTheta
Std Dev 1.12
Constant 0.08192
Mean −0.001059
Sigma 0.9449
pullTheta
Std Dev 1.121
Constant 0.08193
Mean −0.001139
Sigma 0.9448
pullTheta
Std Dev 1.121
Constant 0.08193
Mean −0.001139
Sigma 0.9448
pullTheta
Std Dev 1.12
Constant 0.08192
Mean −0.001059
Sigma 0.9449
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.2
Constant 0.07915
Mean −0.001799
Sigma 0.9745
pullDxy
Std Dev 1.2
Constant 0.07915
Mean −0.00179
Sigma 0.9745
pullDxy
Std Dev 1.2
Constant 0.07916
Mean −0.00198
Sigma 0.9745
pullDxy
Std Dev 1.2
Constant 0.07916
Mean −0.00198
Sigma 0.9745
pullDxy
Std Dev 1.2
Constant 0.07915
Mean −0.00179
Sigma 0.9745
Ratio
pull of dz parameter
pullDz
Std Dev 1.286
Constant 0.07734
Mean −0.003146
Sigma 0.9862
pullDz
Std Dev 1.286
Constant 0.07734
Mean −0.003161
Sigma 0.9861
pullDz
Std Dev 1.285
Constant 0.07736
Mean −0.00317
Sigma 0.986
pullDz
Std Dev 1.285
Constant 0.07736
Mean −0.00317
Sigma 0.986
pullDz
Std Dev 1.286
Constant 0.07734
Mean −0.003161
Sigma 0.9861
Ratio