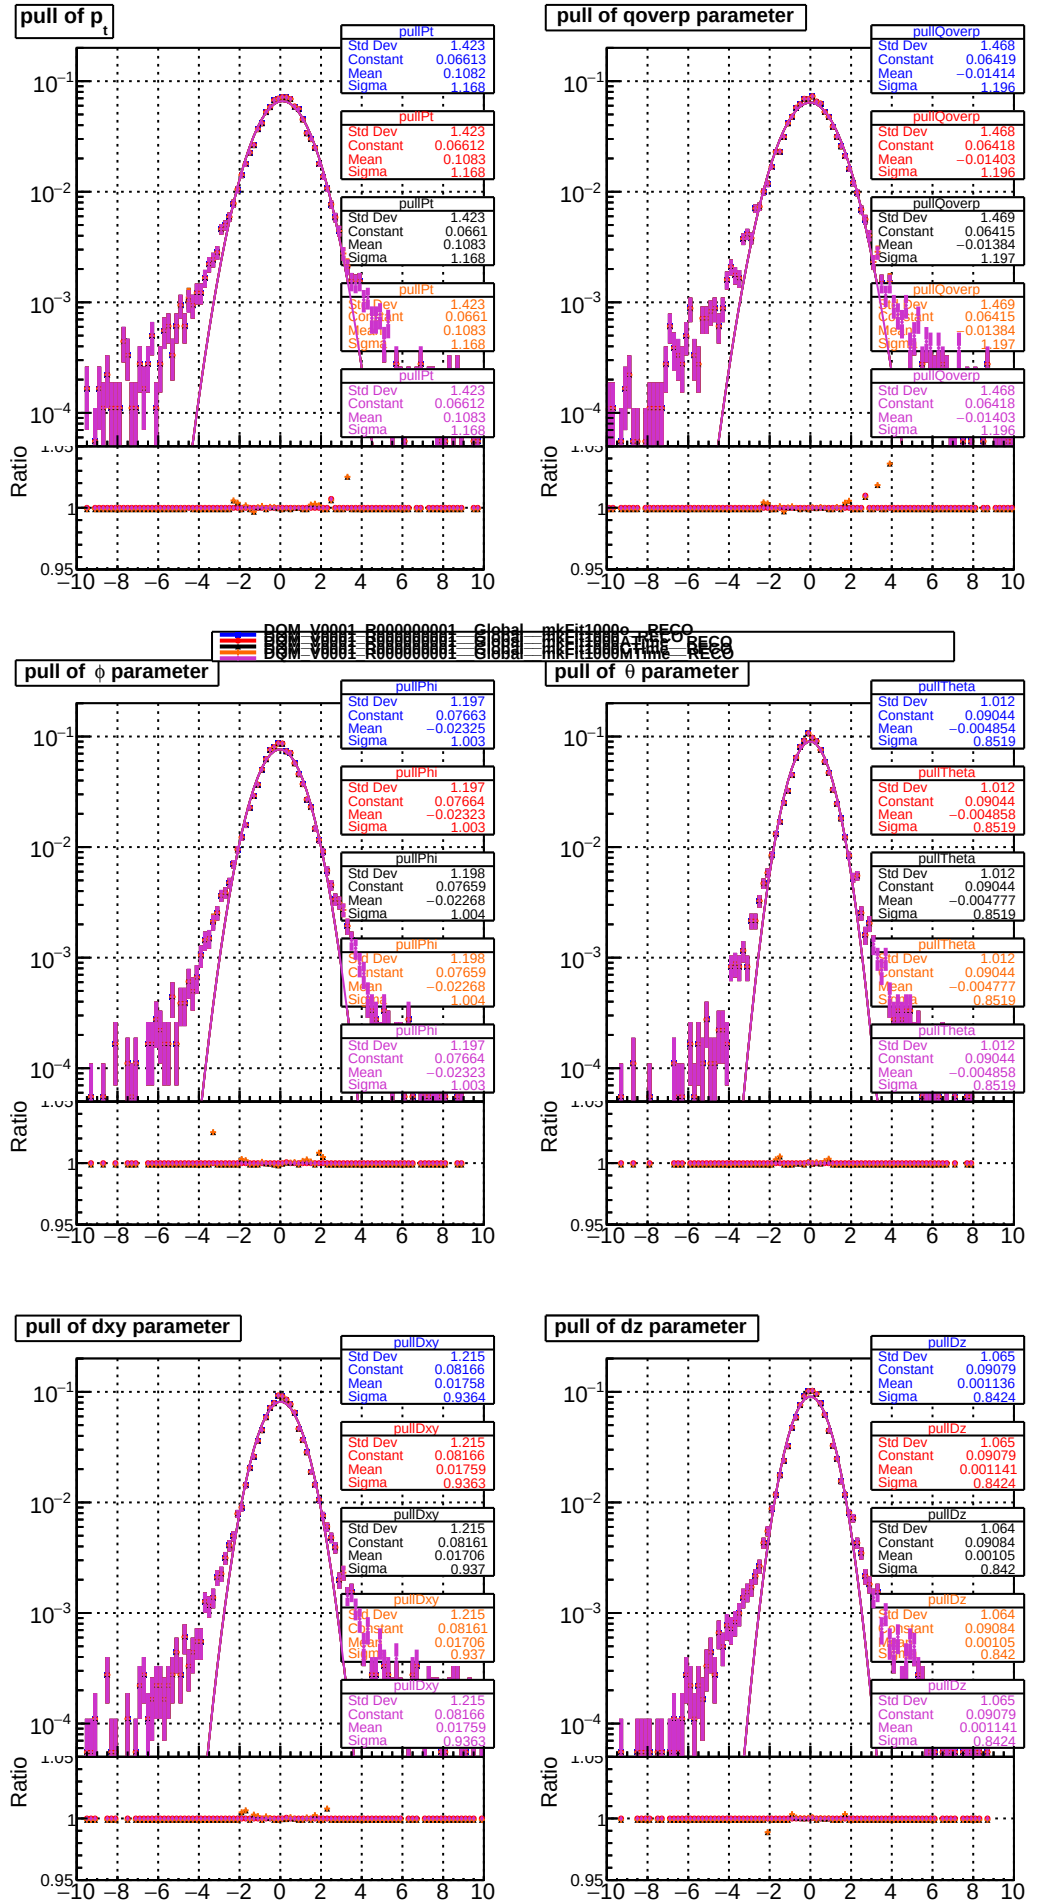
pull of p_t
pullPt
Std Dev 1.423
Constant 0.06613
Mean 0.1082
Sigma 1.168
pullPt
Std Dev 1.423
Constant 0.06612
Mean 0.1083
Sigma 1.168
pullPt
Std Dev 1.423
Constant 0.0661
Mean 0.1083
Sigma 1.168
pullPt
Std Dev 1.423
Constant 0.0661
Mean 0.1083
Sigma 1.168
pullPt
Std Dev 1.423
Constant 0.06612
Mean 0.1083
Sigma 1.168
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.468
Constant 0.06419
Mean −0.01414
Sigma 1.196
pullQoverp
Std Dev 1.468
Constant 0.06418
Mean −0.01403
Sigma 1.196
pullQoverp
Std Dev 1.469
Constant 0.06415
Mean −0.01384
Sigma 1.197
pullQoverp
Std Dev 1.469
Constant 0.06415
Mean −0.01384
Sigma 1.197
pullQoverp
Std Dev 1.468
Constant 0.06418
Mean −0.01403
Sigma 1.196
Ratio
DQM_V0001_R000000001__Global__mkFit1000__RECO
DQM_V0001_R000000001__Global__mkFit1000AllTime__RECO
DQM_V0001_R000000001__Global__mkFit1000OnTime__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.197
Constant 0.07663
Mean −0.02325
Sigma 1.003
pullPhi
Std Dev 1.197
Constant 0.07664
Mean −0.02323
Sigma 1.003
pullPhi
Std Dev 1.198
Constant 0.07659
Mean −0.02268
Sigma 1.004
pullPhi
Std Dev 1.198
Constant 0.07659
Mean −0.02268
Sigma 1.004
pullPhi
Std Dev 1.197
Constant 0.07664
Mean −0.02323
Sigma 1.003
Ratio
pull of θ parameter
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004854
Sigma 0.8519
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004858
Sigma 0.8519
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004777
Sigma 0.8519
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004777
Sigma 0.8519
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004858
Sigma 0.8519
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.215
Constant 0.08166
Mean 0.01758
Sigma 0.9364
pullDxy
Std Dev 1.215
Constant 0.08166
Mean 0.01759
Sigma 0.9363
pullDxy
Std Dev 1.215
Constant 0.08161
Mean 0.01706
Sigma 0.937
pullDxy
Std Dev 1.215
Constant 0.08161
Mean 0.01706
Sigma 0.937
pullDxy
Std Dev 1.215
Constant 0.08166
Mean 0.01759
Sigma 0.9363
Ratio
pull of dz parameter
pullDz
Std Dev 1.065
Constant 0.09079
Mean 0.001136
Sigma 0.8424
pullDz
Std Dev 1.065
Constant 0.09079
Mean 0.001141
Sigma 0.8424
pullDz
Std Dev 1.064
Constant 0.09084
Mean 0.00105
Sigma 0.842
pullDz
Std Dev 1.064
Constant 0.09084
Mean 0.00105
Sigma 0.842
pullDz
Std Dev 1.065
Constant 0.09079
Mean 0.001141
Sigma 0.8424
Ratio