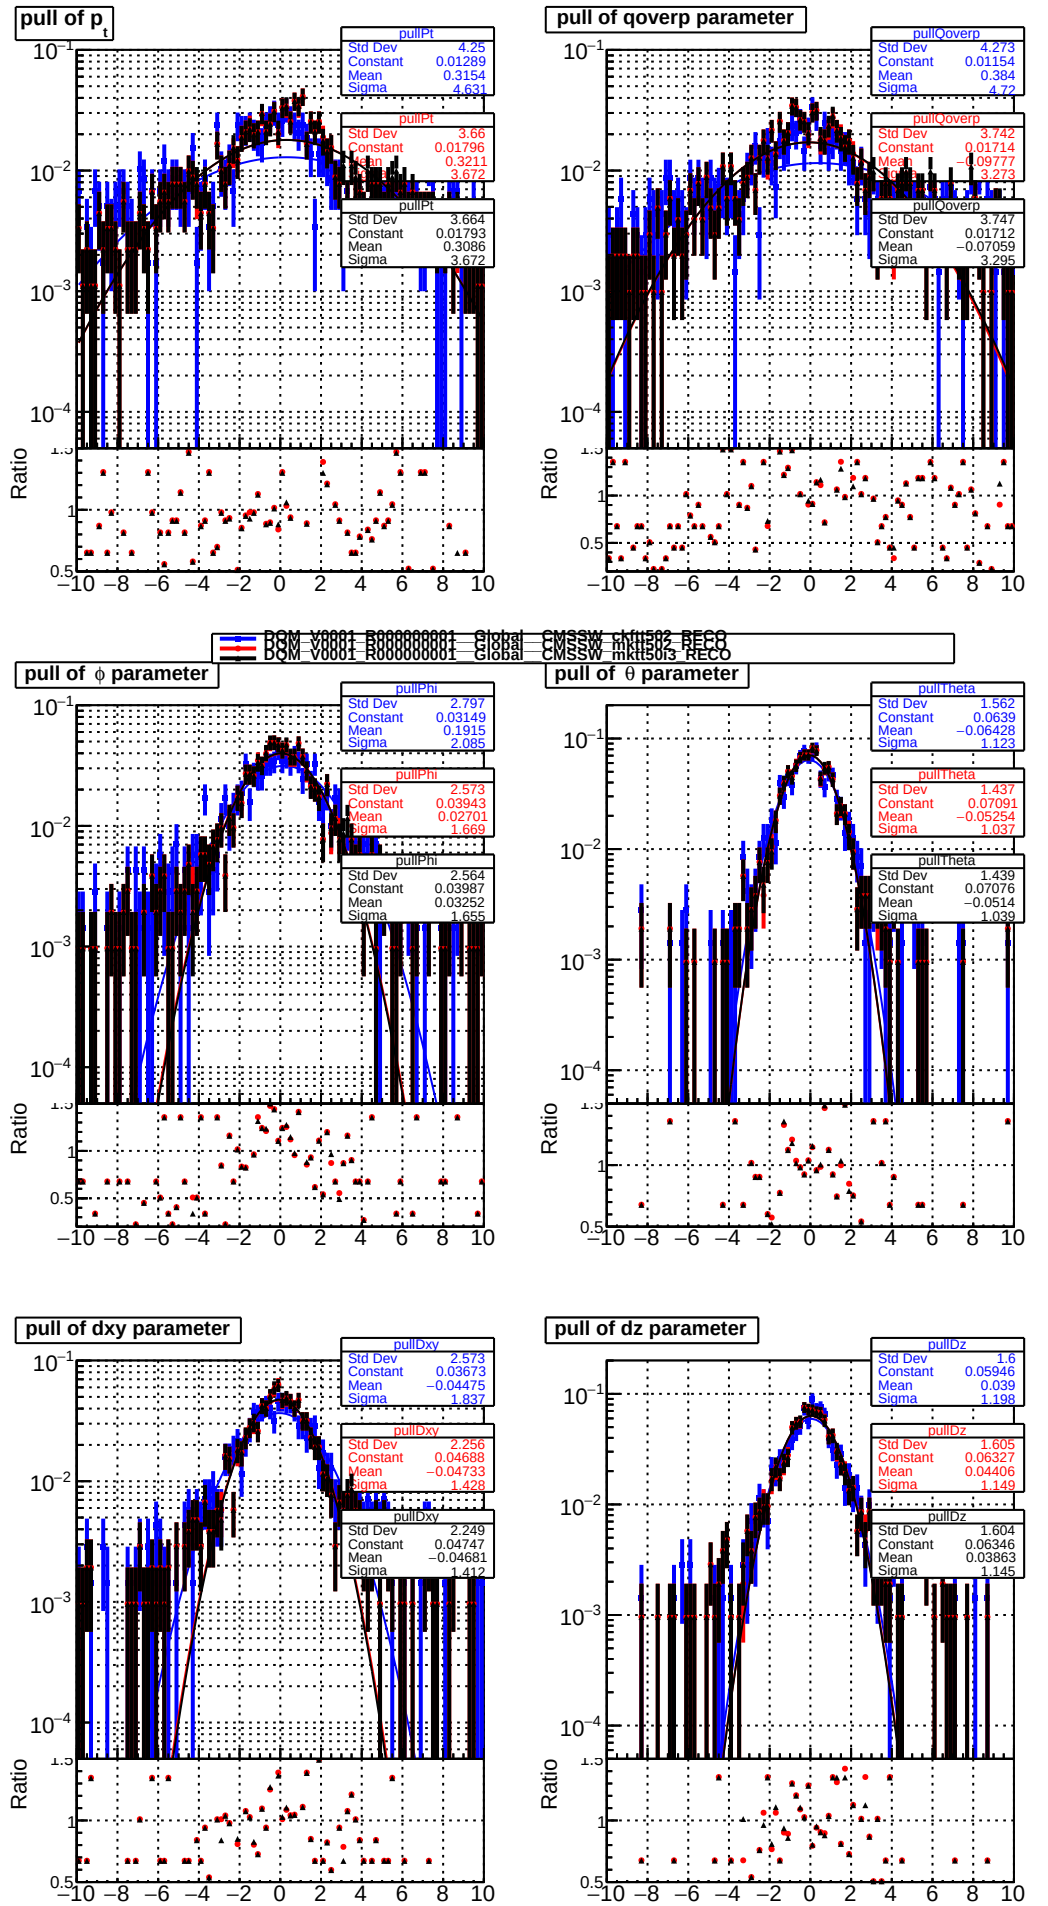
pull of p_t
pullPt
Std Dev 4.25
Constant 0.01289
Mean 0.3154
Sigma 4.631
pullPt
Std Dev 3.66
Constant 0.01796
Mean 0.3211
Sigma 3.672
pullPt
Std Dev 3.664
Constant 0.01793
Mean 0.3086
Sigma 3.672
pull of qoverp parameter
pullQoverp
Std Dev 4.273
Constant 0.01154
Mean 0.384
Sigma 4.72
pullQoverp
Std Dev 3.742
Constant 0.01714
Mean −0.09777
Sigma 3.273
pullQoverp
Std Dev 3.747
Constant 0.01712
Mean −0.07059
Sigma 3.295
DQM_V0001_R000000001__Global__CMSSW_ckfiu502_RECO
DQM_V0001_R000000001__Global__CMSSW_mkfiu502_RECO
DQM_V0001_R000000001__Global__CMSSW_mkfit5013_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.797
Constant 0.03149
Mean 0.1915
Sigma 2.085
pullPhi
Std Dev 2.573
Constant 0.03943
Mean 0.02701
Sigma 1.669
pullPhi
Std Dev 2.564
Constant 0.03987
Mean 0.03252
Sigma 1.655
pull of θ parameter
pullTheta
Std Dev 1.562
Constant 0.0639
Mean −0.06428
Sigma 1.123
pullTheta
Std Dev 1.437
Constant 0.07091
Mean −0.05254
Sigma 1.037
pullTheta
Std Dev 1.439
Constant 0.07076
Mean −0.0514
Sigma 1.039
pull of dxy parameter
pullDxy
Std Dev 2.573
Constant 0.03673
Mean −0.04475
Sigma 1.837
pullDxy
Std Dev 2.256
Constant 0.04688
Mean −0.04733
Sigma 1.428
pullDxy
Std Dev 2.249
Constant 0.04747
Mean −0.04681
Sigma 1.412
pull of dz parameter
pullDz
Std Dev 1.6
Constant 0.05946
Mean 0.039
Sigma 1.198
pullDz
Std Dev 1.605
Constant 0.06327
Mean 0.04406
Sigma 1.149
pullDz
Std Dev 1.604
Constant 0.06346
Mean 0.03863
Sigma 1.145
Ratio