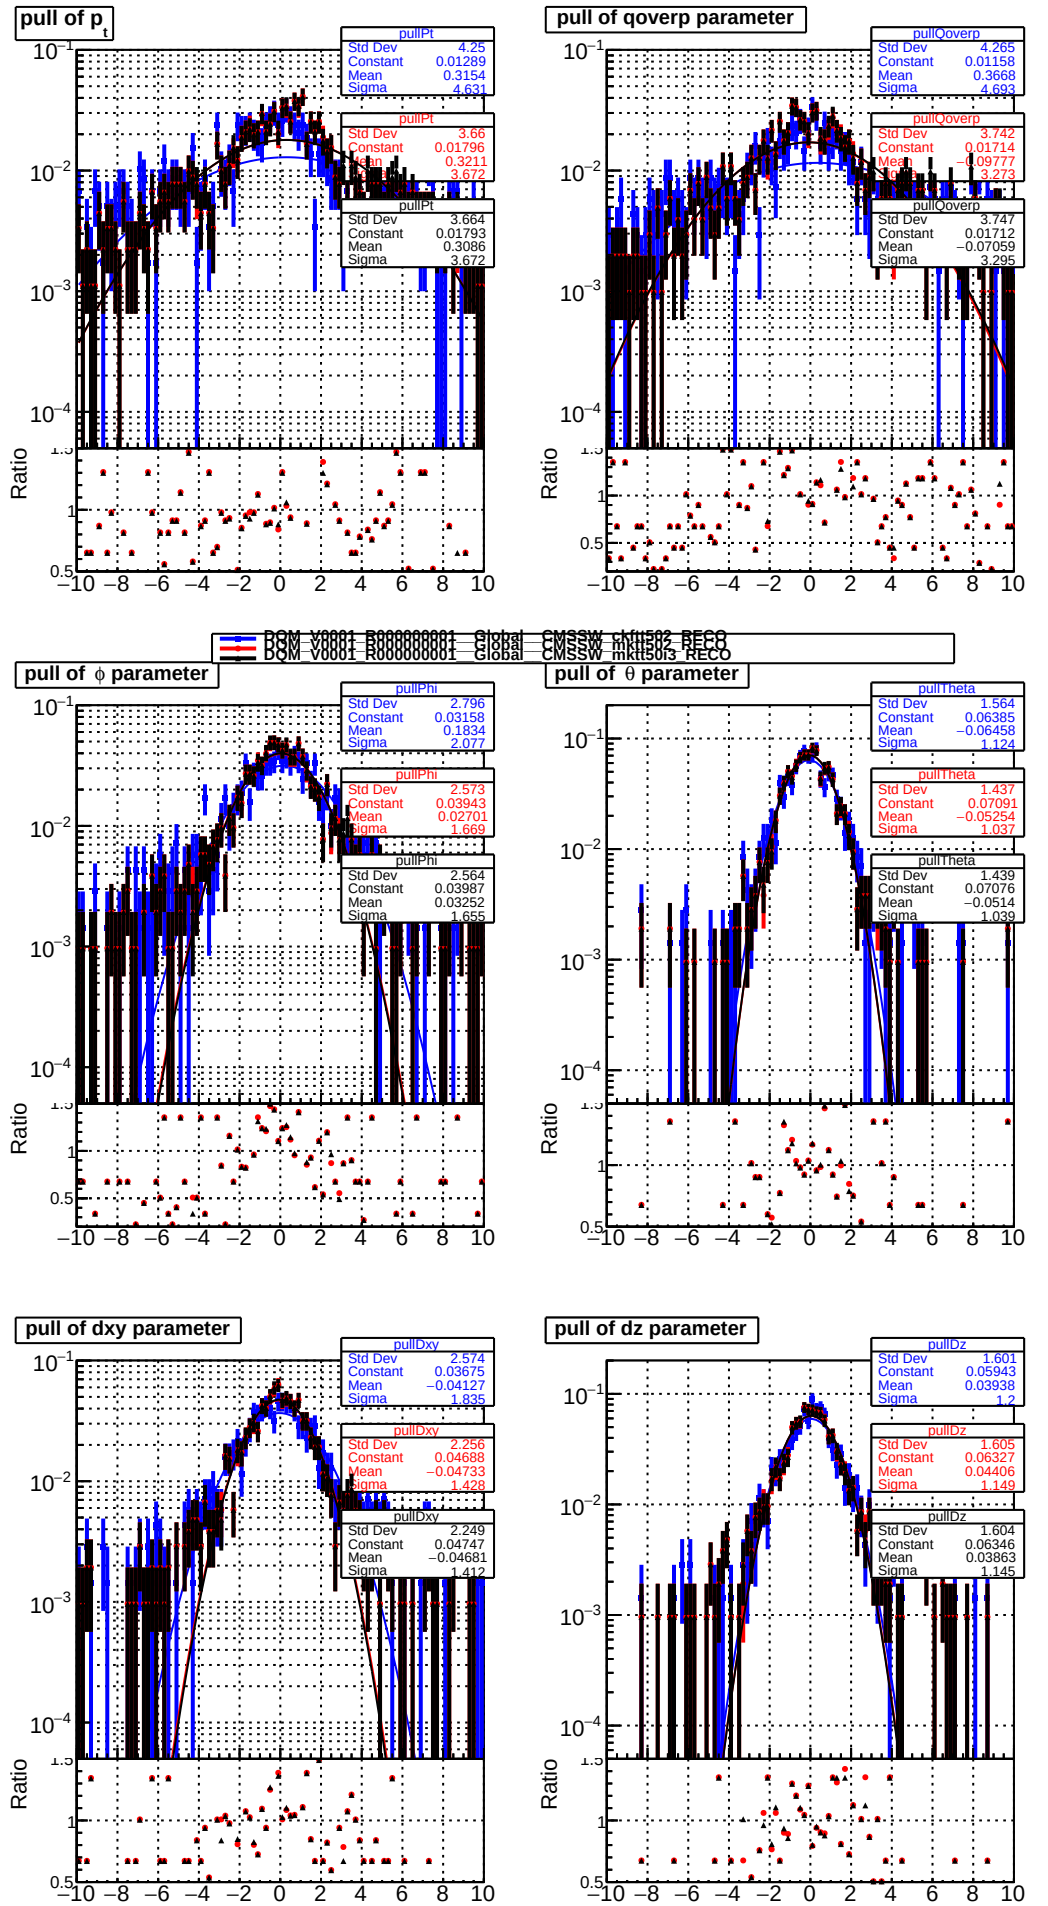
pull of p_t
pullPt
Std Dev 4.25
Constant 0.01289
Mean 0.3154
Sigma 4.631
pullPt
Std Dev 3.66
Constant 0.01796
Mean 0.3211
Sigma 3.672
pullPt
Std Dev 3.664
Constant 0.01793
Mean 0.3086
Sigma 3.672
pull of qoverp parameter
pullQoverp
Std Dev 4.265
Constant 0.01158
Mean 0.3668
Sigma 4.693
pullQoverp
Std Dev 3.742
Constant 0.01714
Mean −0.09777
Sigma 3.273
pullQoverp
Std Dev 3.747
Constant 0.01712
Mean −0.07059
Sigma 3.295
DQM_V0001_R000000001__Global__CMSSW_ckfiu502_RECO
DQM_V0001_R000000001__Global__CMSSW_mkfiu502_RECO
DQM_V0001_R000000001__Global__CMSSW_mkfit5013_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.796
Constant 0.03158
Mean 0.1834
Sigma 2.077
pullPhi
Std Dev 2.573
Constant 0.03943
Mean 0.02701
Sigma 1.669
pullPhi
Std Dev 2.564
Constant 0.03987
Mean 0.03252
Sigma 1.655
pull of θ parameter
pullTheta
Std Dev 1.564
Constant 0.06385
Mean −0.06458
Sigma 1.124
pullTheta
Std Dev 1.437
Constant 0.07091
Mean −0.05254
Sigma 1.037
pullTheta
Std Dev 1.439
Constant 0.07076
Mean −0.0514
Sigma 1.039
pull of dxy parameter
pullDxy
Std Dev 2.574
Constant 0.03675
Mean −0.04127
Sigma 1.835
pullDxy
Std Dev 2.256
Constant 0.04688
Mean −0.04733
Sigma 1.428
pullDxy
Std Dev 2.249
Constant 0.04747
Mean −0.04681
Sigma 1.412
pull of dz parameter
pullDz
Std Dev 1.601
Constant 0.05943
Mean 0.03938
Sigma 1.2
pullDz
Std Dev 1.605
Constant 0.06327
Mean 0.04406
Sigma 1.149
pullDz
Std Dev 1.604
Constant 0.06346
Mean 0.03863
Sigma 1.145
Ratio