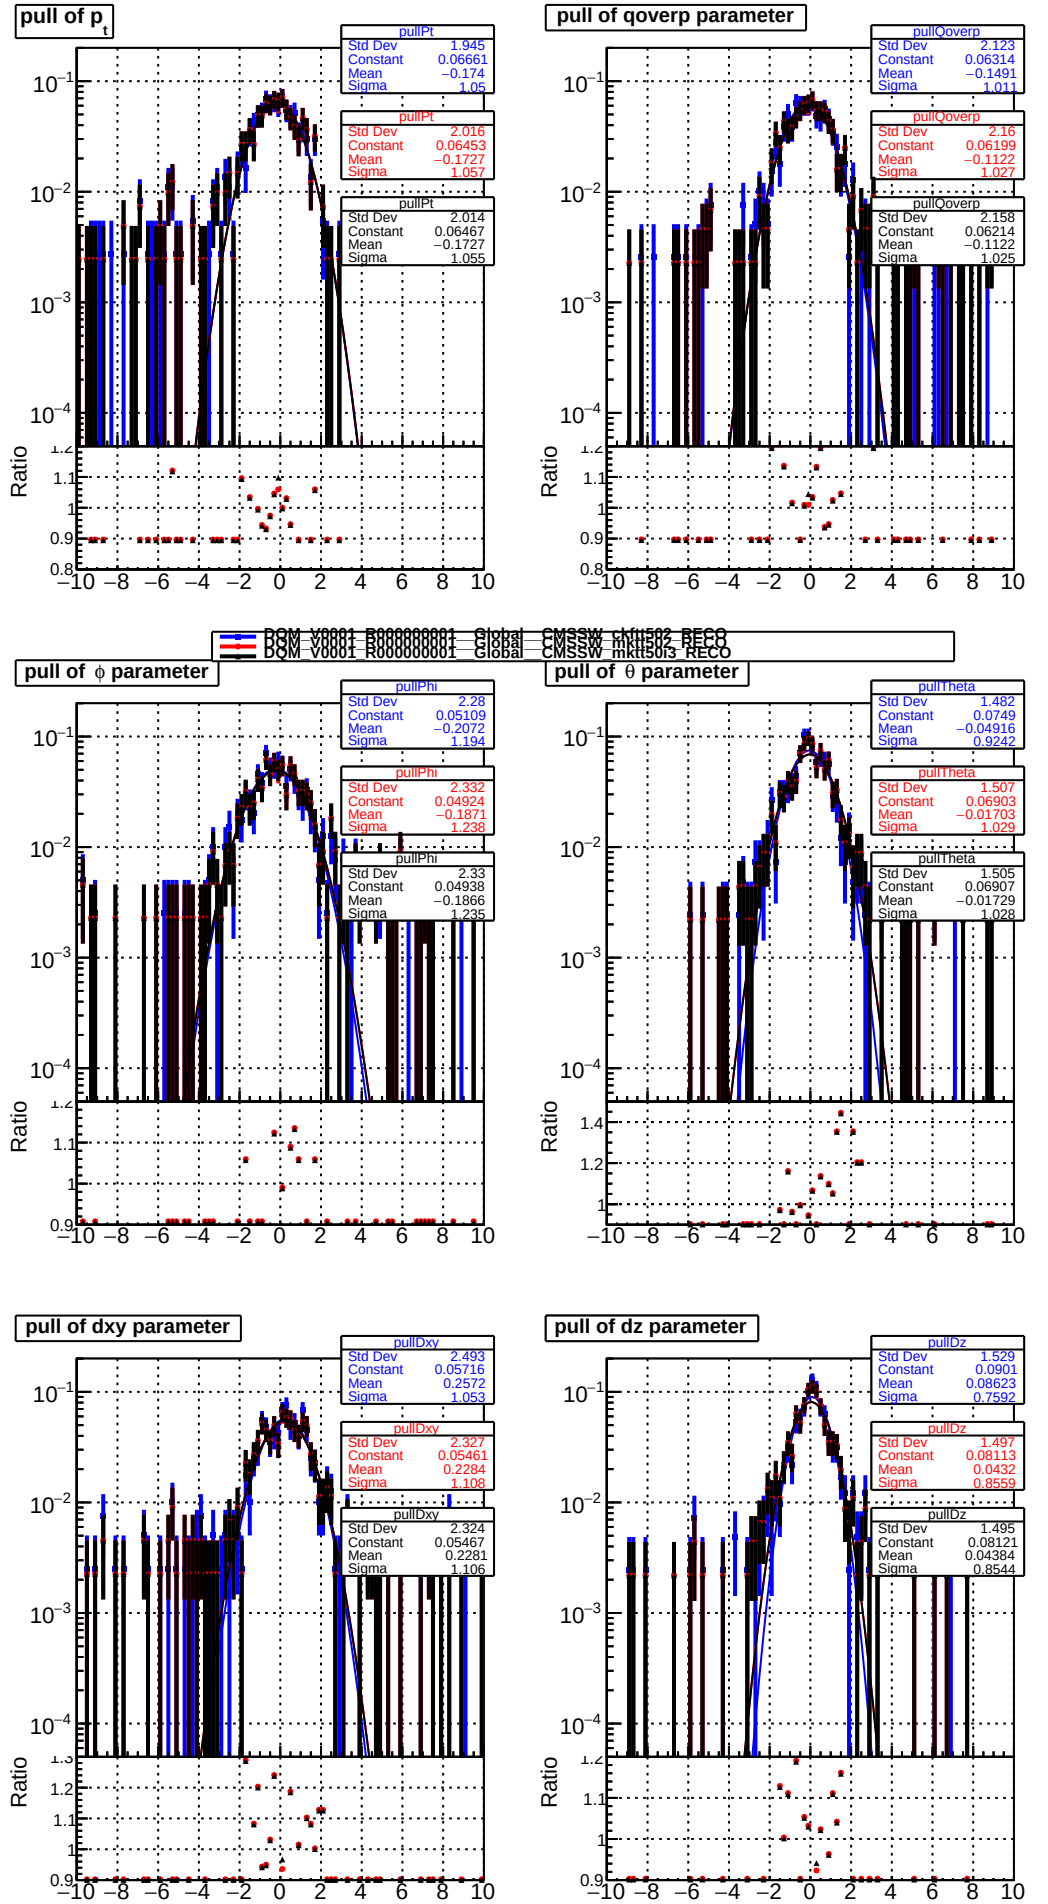
pull of p_t
pullPt
Std Dev 1.945
Constant 0.06661
Mean −0.174
Sigma 1.05
pullPt
Std Dev 2.016
Constant 0.06453
Mean −0.1727
Sigma 1.057
pullPt
Std Dev 2.014
Constant 0.06467
Mean −0.1727
Sigma 1.055
pull of qoverp parameter
pullQoverp
Std Dev 2.123
Constant 0.06314
Mean −0.1491
Sigma 1.011
pullQoverp
Std Dev 2.16
Constant 0.06199
Mean −0.1122
Sigma 1.027
pullQoverp
Std Dev 2.158
Constant 0.06214
Mean −0.1122
Sigma 1.025
DQM_V0001_R000000001__Global__CMSSW_ckfiu502_RECO
DQM_V0001_R000000001__Global__CMSSW_mkfit502_RECO
DQM_V0001_R000000001__Global__CMSSW_mkfit50i3_RECO
pull of ϕ parameter
pullPhi
Std Dev 2.28
Constant 0.05109
Mean −0.2072
Sigma 1.194
pullPhi
Std Dev 2.332
Constant 0.04924
Mean −0.1871
Sigma 1.238
pullPhi
Std Dev 2.33
Constant 0.04938
Mean −0.1866
Sigma 1.235
pull of θ parameter
pullTheta
Std Dev 1.482
Constant 0.0749
Mean −0.04916
Sigma 0.9242
pullTheta
Std Dev 1.507
Constant 0.06903
Mean −0.01703
Sigma 1.029
pullTheta
Std Dev 1.505
Constant 0.06907
Mean −0.01729
Sigma 1.028
pull of dxy parameter
pullDxy
Std Dev 2.493
Constant 0.05716
Mean 0.2572
Sigma 1.053
pullDxy
Std Dev 2.327
Constant 0.05461
Mean 0.2284
Sigma 1.108
pullDxy
Std Dev 2.324
Constant 0.05467
Mean 0.2281
Sigma 1.106
pull of dz parameter
pullDz
Std Dev 1.529
Constant 0.0901
Mean 0.08623
Sigma 0.7592
pullDz
Std Dev 1.497
Constant 0.08113
Mean 0.0432
Sigma 0.8559
pullDz
Std Dev 1.495
Constant 0.08121
Mean 0.04384
Sigma 0.8544
Ratio