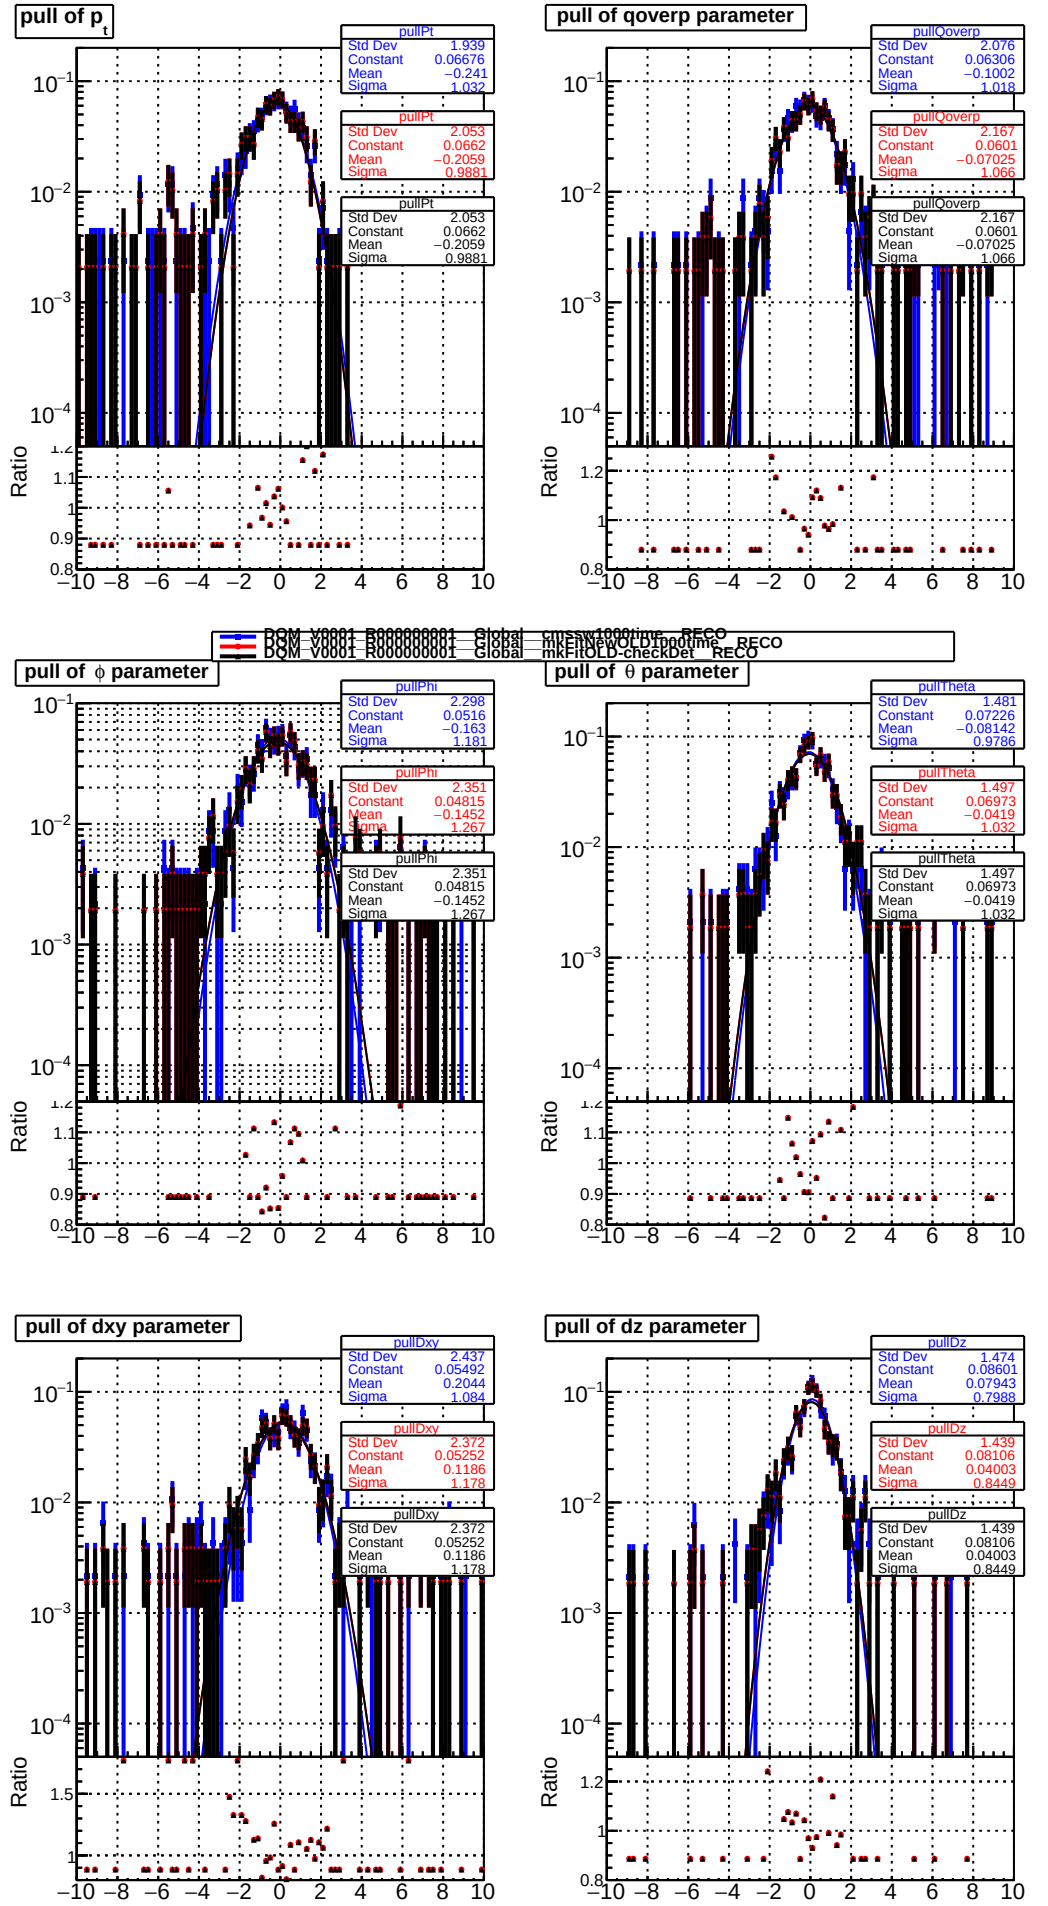
pull of p_t
pullPt
Std Dev 1.939
Constant 0.06676
Mean −0.241
Sigma 1.032
pullPt
Std Dev 2.053
Constant 0.0662
Mean −0.2059
Sigma 0.9881
pullPt
Std Dev 2.053
Constant 0.0662
Mean −0.2059
Sigma 0.9881
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.076
Constant 0.06306
Mean −0.1002
Sigma 1.018
pullQoverp
Std Dev 2.167
Constant 0.0601
Mean −0.07025
Sigma 1.066
pullQoverp
Std Dev 2.167
Constant 0.0601
Mean −0.07025
Sigma 1.066
Ratio
DQM_V0001_R000000001__Global__chiSsw1000time__RECO
DQM_V0001_R000000001__Global__mkFitNewOLDtpotime__RECO
DQM_V0001_R000000001__Global__mkFitOLD-checkDet__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.298
Constant 0.0516
Mean −0.163
Sigma 1.181
pullPhi
Std Dev 2.351
Constant 0.04815
Mean −0.1452
Sigma 1.267
pullPhi
Std Dev 2.351
Constant 0.04815
Mean −0.1452
Sigma 1.267
Ratio
pull of θ parameter
pullTheta
Std Dev 1.481
Constant 0.07226
Mean −0.08142
Sigma 0.9786
pullTheta
Std Dev 1.497
Constant 0.06973
Mean −0.0419
Sigma 1.032
pullTheta
Std Dev 1.497
Constant 0.06973
Mean −0.0419
Sigma 1.032
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.437
Constant 0.05492
Mean 0.2044
Sigma 1.084
pullDxy
Std Dev 2.372
Constant 0.05252
Mean 0.1186
Sigma 1.178
pullDxy
Std Dev 2.372
Constant 0.05252
Mean 0.1186
Sigma 1.178
Ratio
pull of dz parameter
pullDz
Std Dev 1.474
Constant 0.08601
Mean 0.07943
Sigma 0.7988
pullDz
Std Dev 1.439
Constant 0.08106
Mean 0.04003
Sigma 0.8449
pullDz
Std Dev 1.439
Constant 0.08106
Mean 0.04003
Sigma 0.8449
Ratio