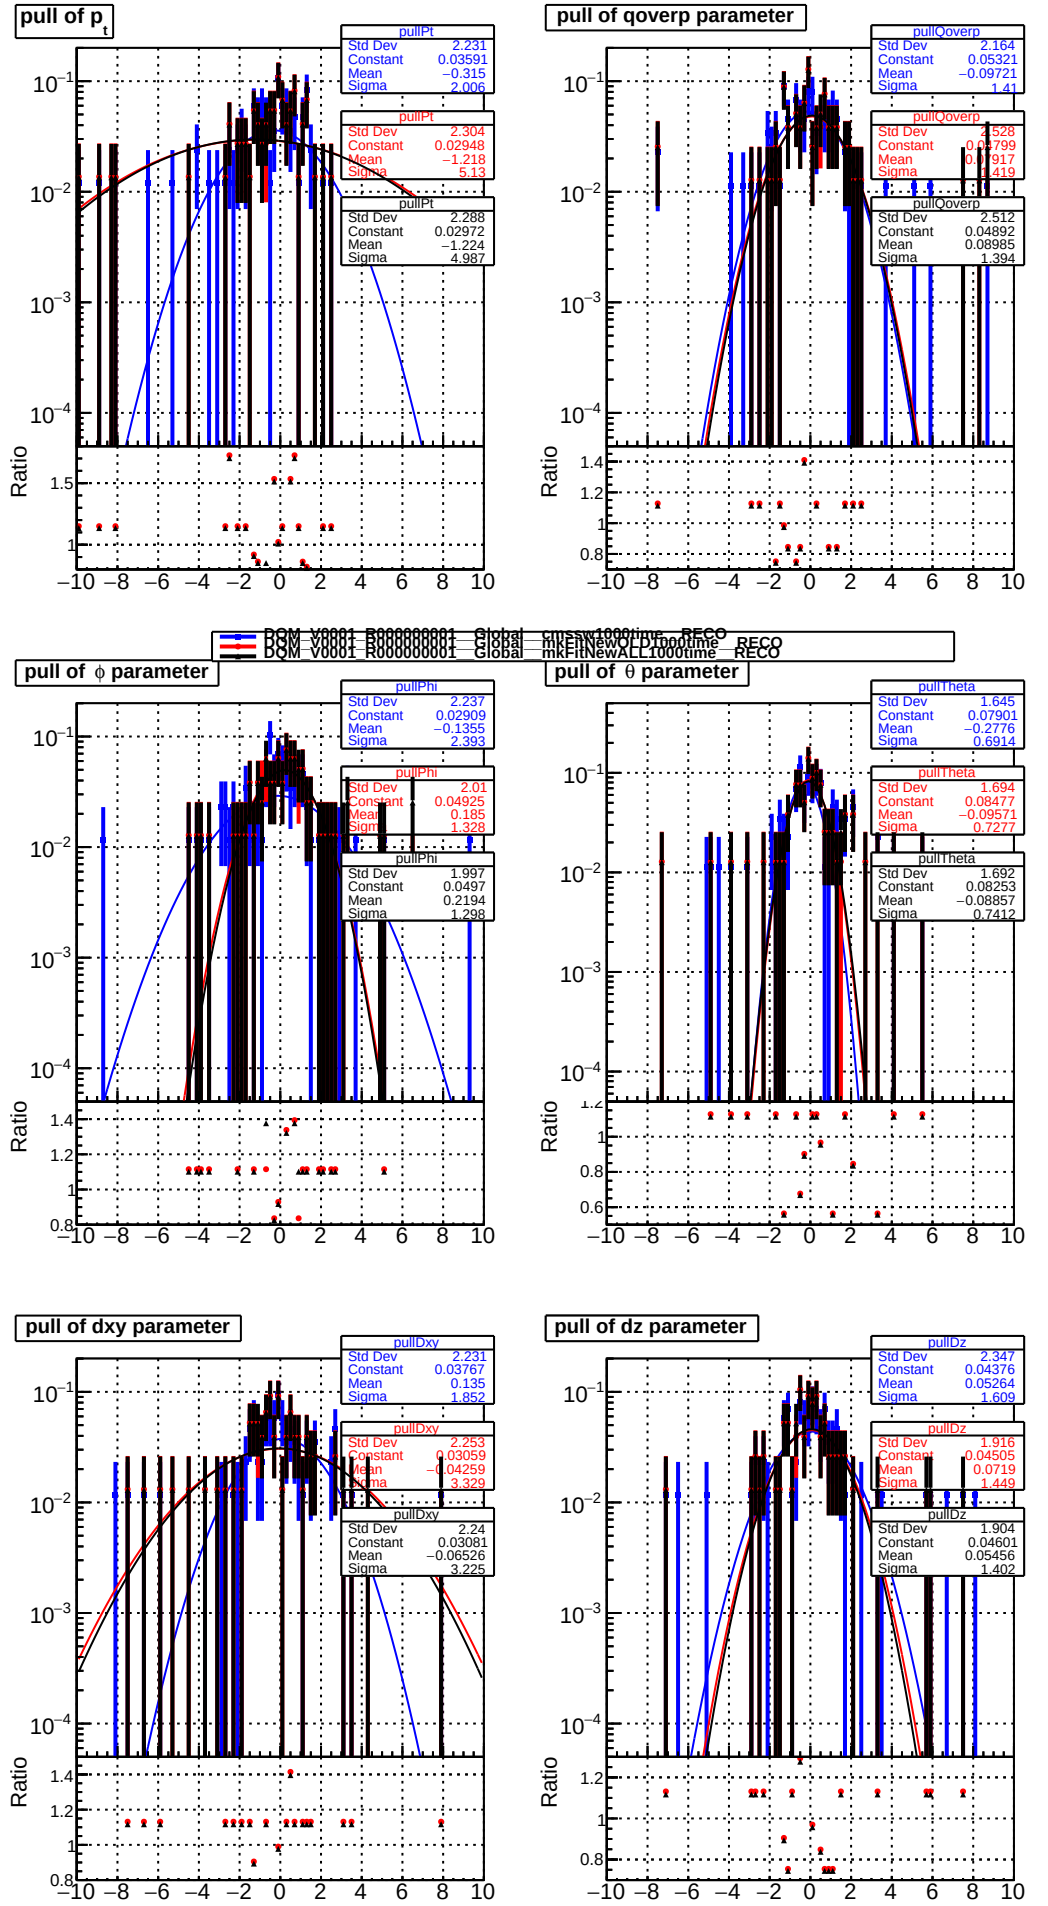
pull of p_t
pullPt
Std Dev 2.231
Constant 0.03591
Mean −0.315
Sigma 2.006
pullPt
Std Dev 2.304
Constant 0.02948
Mean −1.218
Sigma 5.13
pullPt
Std Dev 2.288
Constant 0.02972
Mean −1.224
Sigma 4.987
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.164
Constant 0.05321
Mean −0.09721
Sigma 1.41
pullQoverp
Std Dev 2.528
Constant 0.05799
Mean 0.07917
Sigma 1.419
pullQoverp
Std Dev 2.512
Constant 0.04892
Mean 0.08985
Sigma 1.394
Ratio
DQM_V0001_R000000001__Global__ctfwsw1000time__RECO
DQM_V0001_R000000001__Global__mkFitNewOLD1000time__RECO
DQM_V0001_R000000001__Global__mkFitNewALL1000time__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.237
Constant 0.02909
Mean −0.1355
Sigma 2.393
pullPhi
Std Dev 2.01
Constant 0.04925
Mean 0.185
Sigma 1.328
pullPhi
Std Dev 1.997
Constant 0.0497
Mean 0.2194
Sigma 1.298
Ratio
pull of θ parameter
pullTheta
Std Dev 1.645
Constant 0.07901
Mean −0.2776
Sigma 0.6914
pullTheta
Std Dev 1.694
Constant 0.08477
Mean −0.09571
Sigma 0.7277
pullTheta
Std Dev 1.692
Constant 0.08253
Mean −0.08857
Sigma 0.7412
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.231
Constant 0.03767
Mean 0.135
Sigma 1.852
pullDxy
Std Dev 2.253
Constant 0.03059
Mean −0.04259
Sigma 3.329
pullDxy
Std Dev 2.24
Constant 0.03081
Mean −0.06526
Sigma 3.225
Ratio
pull of dz parameter
pullDz
Std Dev 2.347
Constant 0.04376
Mean 0.05264
Sigma 1.609
pullDz
Std Dev 1.916
Constant 0.04505
Mean 0.0719
Sigma 1.449
pullDz
Std Dev 1.904
Constant 0.04601
Mean 0.05456
Sigma 1.402
Ratio