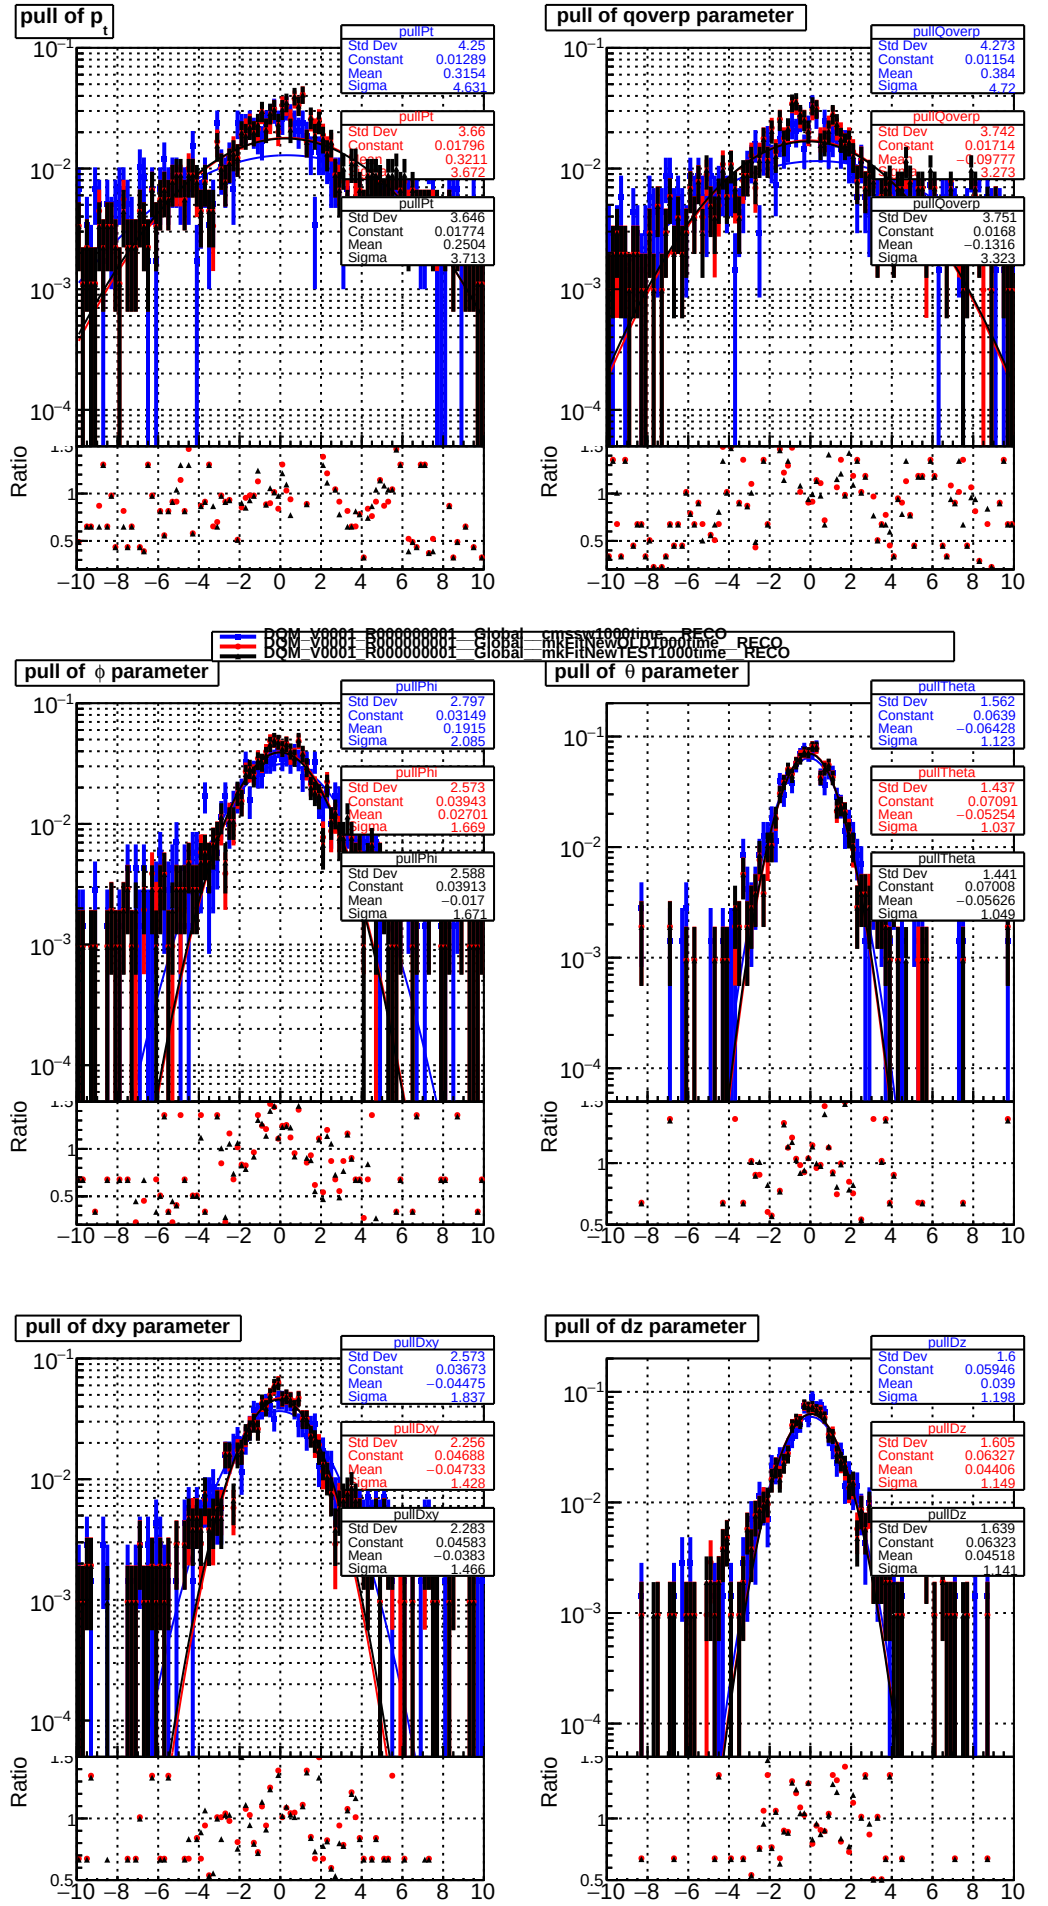
pull of p_t
pullPt
Std Dev 4.25
Constant 0.01289
Mean 0.3154
Sigma 4.631
pullPt
Std Dev 3.66
Constant 0.01796
Mean 0.3211
Sigma 3.672
pullPt
Std Dev 3.646
Constant 0.01774
Mean 0.2504
Sigma 3.713
pull of qoverp parameter
pullQoverp
Std Dev 4.273
Constant 0.01154
Mean 0.384
Sigma 4.72
pullQoverp
Std Dev 3.742
Constant 0.01714
Mean −0.09777
Sigma 3.273
pullQoverp
Std Dev 3.751
Constant 0.0168
Mean −0.1316
Sigma 3.323
DQM_V0001_R000000001__Global__cmssw1000time__RECO
DQM_V0001_R000000001__Global__mkFitNewOLDtest0time__RECO
DQM_V0001_R000000001__Global__mkFitNewTEST1000time__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.797
Constant 0.03149
Mean 0.1915
Sigma 2.085
pullPhi
Std Dev 2.573
Constant 0.03943
Mean 0.02701
Sigma 1.669
pullPhi
Std Dev 2.588
Constant 0.03913
Mean −0.017
Sigma 1.671
pull of θ parameter
pullTheta
Std Dev 1.562
Constant 0.0639
Mean −0.06428
Sigma 1.123
pullTheta
Std Dev 1.437
Constant 0.07091
Mean −0.05254
Sigma 1.037
pullTheta
Std Dev 1.441
Constant 0.07008
Mean −0.05626
Sigma 1.049
pull of dxy parameter
pullDxy
Std Dev 2.573
Constant 0.03673
Mean −0.04475
Sigma 1.837
pullDxy
Std Dev 2.256
Constant 0.04688
Mean −0.04733
Sigma 1.428
pullDxy
Std Dev 2.283
Constant 0.04583
Mean −0.0383
Sigma 1.466
pull of dz parameter
pullDz
Std Dev 1.6
Constant 0.05946
Mean 0.039
Sigma 1.198
pullDz
Std Dev 1.605
Constant 0.06327
Mean 0.04406
Sigma 1.149
pullDz
Std Dev 1.639
Constant 0.06323
Mean 0.04518
Sigma 1.141
Ratio