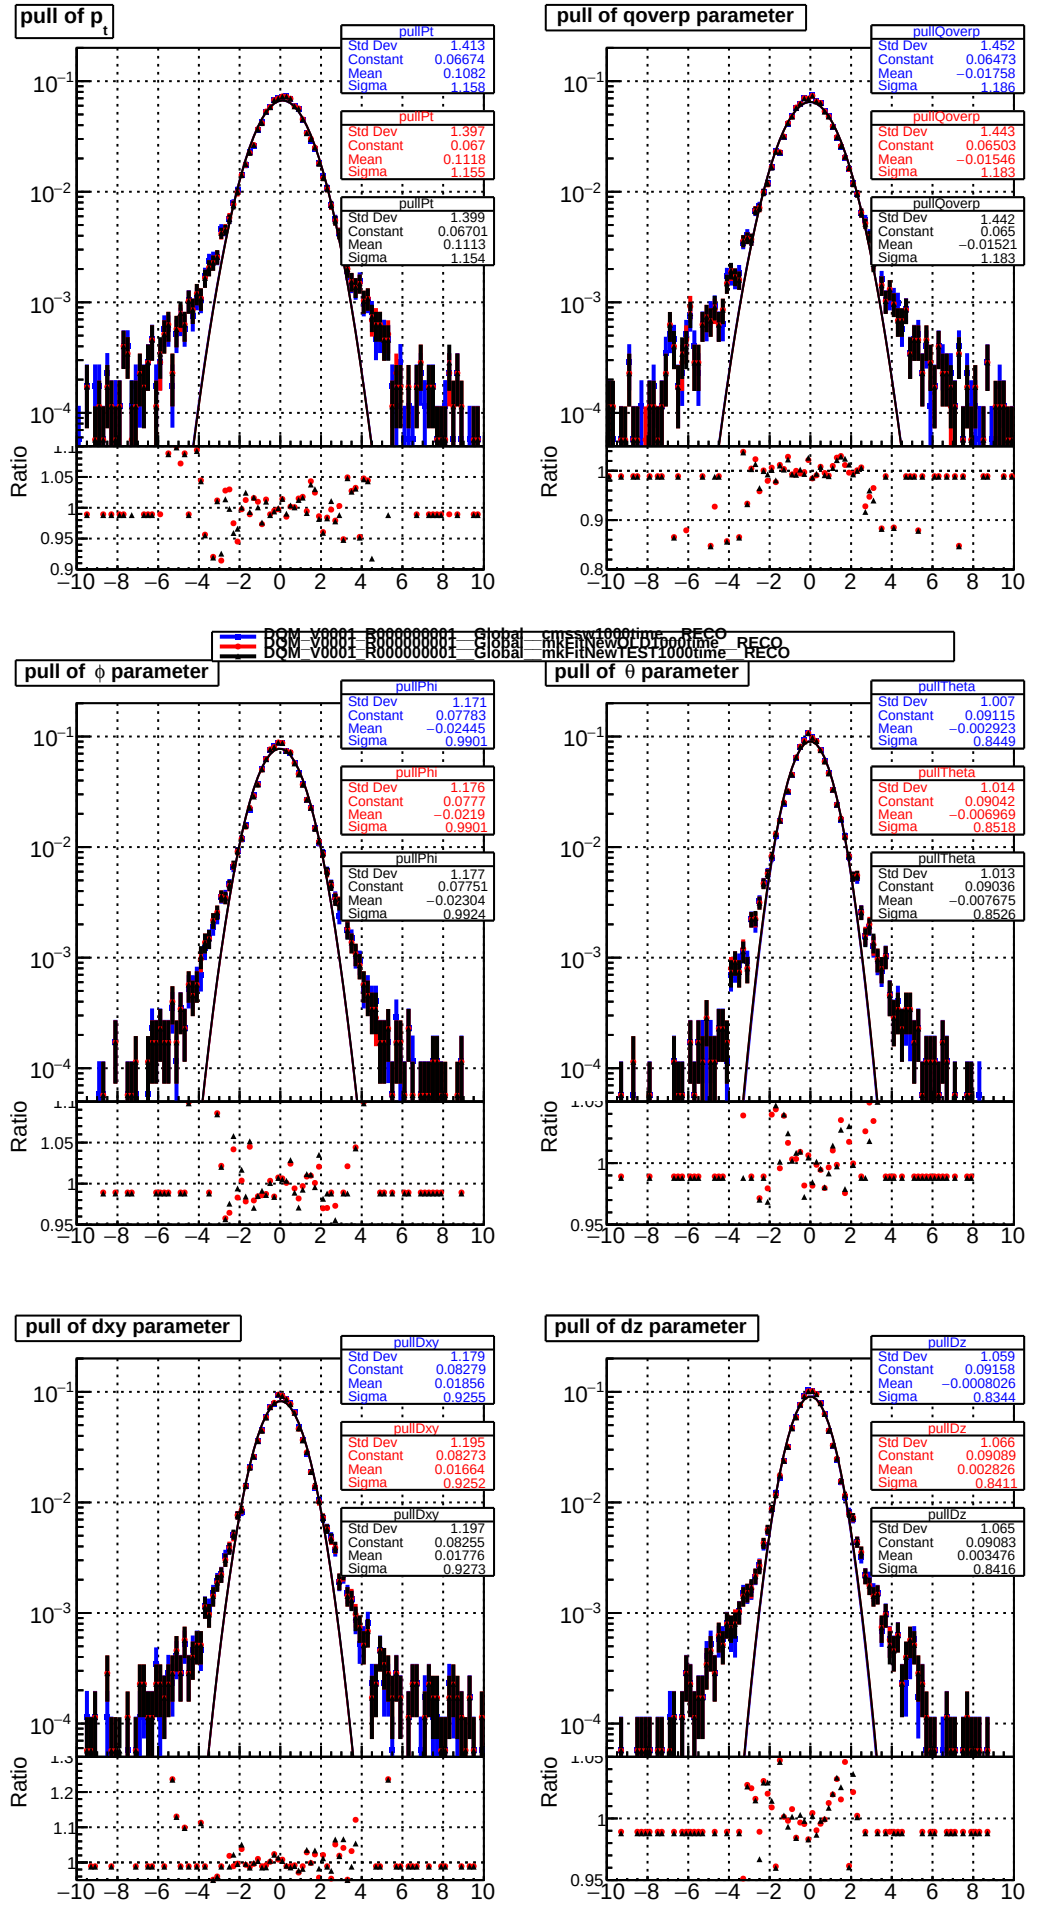
pull of p_t
pullPt
Std Dev 1.413
Constant 0.06674
Mean 0.1082
Sigma 1.158
pullPt
Std Dev 1.397
Constant 0.067
Mean 0.1118
Sigma 1.155
pullPt
Std Dev 1.399
Constant 0.06701
Mean 0.1113
Sigma 1.154
pull of qoverp parameter
pullQoverp
Std Dev 1.452
Constant 0.06473
Mean −0.01758
Sigma 1.186
pullQoverp
Std Dev 1.443
Constant 0.06503
Mean −0.01546
Sigma 1.183
pullQoverp
Std Dev 1.442
Constant 0.065
Mean −0.01521
Sigma 1.183
DQM_V0001_R000000001__Global__ckfnew1000time__RECO
DQM_V0001_R000000001__Global__mkFitNewOLDTest0time__RECO
DQM_V0001_R000000001__Global__mkFitNewTEST1000time__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.171
Constant 0.07783
Mean −0.02445
Sigma 0.9901
pullPhi
Std Dev 1.176
Constant 0.0777
Mean −0.0219
Sigma 0.9901
pullPhi
Std Dev 1.177
Constant 0.07751
Mean −0.02304
Sigma 0.9924
pull of θ parameter
pullTheta
Std Dev 1.007
Constant 0.09115
Mean −0.002923
Sigma 0.8449
pullTheta
Std Dev 1.014
Constant 0.09042
Mean −0.006969
Sigma 0.8518
pullTheta
Std Dev 1.013
Constant 0.09036
Mean −0.007675
Sigma 0.8526
pull of dxy parameter
pullDxy
Std Dev 1.179
Constant 0.08279
Mean 0.01856
Sigma 0.9255
pullDxy
Std Dev 1.195
Constant 0.08273
Mean 0.01664
Sigma 0.9252
pullDxy
Std Dev 1.197
Constant 0.08255
Mean 0.01776
Sigma 0.9273
pull of dz parameter
pullDz
Std Dev 1.059
Constant 0.09158
Mean −0.0008026
Sigma 0.8344
pullDz
Std Dev 1.066
Constant 0.09089
Mean 0.002826
Sigma 0.8411
pullDz
Std Dev 1.065
Constant 0.09083
Mean 0.003476
Sigma 0.8416
Ratio