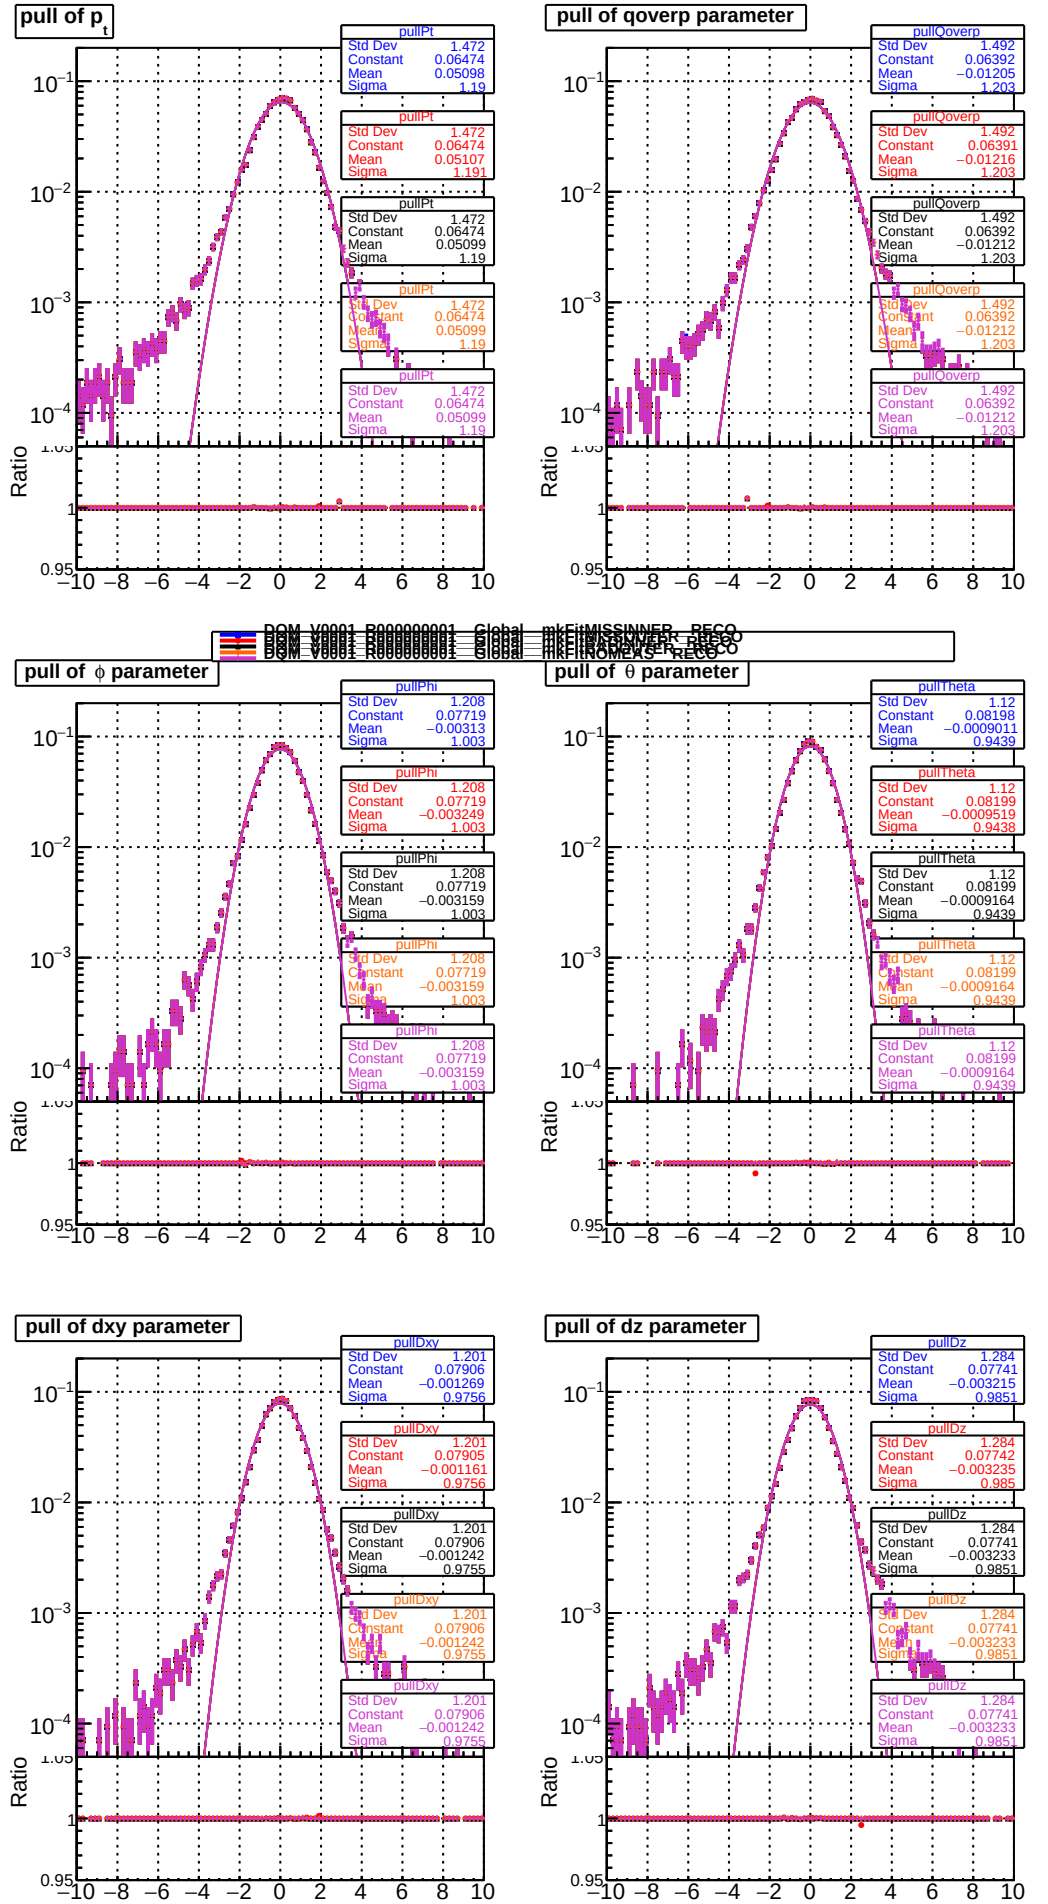
pull of p_t
pullPt
Std Dev 1.472
Constant 0.06474
Mean 0.05098
Sigma 1.19
pullPt
Std Dev 1.472
Constant 0.06474
Mean 0.05107
Sigma 1.191
pullPt
Std Dev 1.472
Constant 0.06474
Mean 0.05099
Sigma 1.19
pullPt
Std Dev 1.472
Constant 0.06474
Mean 0.05099
Sigma 1.19
pullPt
Std Dev 1.472
Constant 0.06474
Mean 0.05099
Sigma 1.19
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.492
Constant 0.06392
Mean −0.01205
Sigma 1.203
pullQoverp
Std Dev 1.492
Constant 0.06391
Mean −0.01216
Sigma 1.203
pullQoverp
Std Dev 1.492
Constant 0.06392
Mean −0.01212
Sigma 1.203
pullQoverp
Std Dev 1.492
Constant 0.06392
Mean −0.01212
Sigma 1.203
pullQoverp
Std Dev 1.492
Constant 0.06392
Mean −0.01212
Sigma 1.203
Ratio
DQM_V0001_R000000001__Global__mkFitMISSINNER__RECO
DQM_V0001_R000000001__Global__mkFitMISSOUTER__RECO
DQM_V0001_R000000001__Global__mkFitINOMEAS__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.208
Constant 0.07719
Mean −0.00313
Sigma 1.003
pullPhi
Std Dev 1.208
Constant 0.07719
Mean −0.003249
Sigma 1.003
pullPhi
Std Dev 1.208
Constant 0.07719
Mean −0.003159
Sigma 1.003
pullPhi
Std Dev 1.208
Constant 0.07719
Mean −0.003159
Sigma 1.003
pullPhi
Std Dev 1.208
Constant 0.07719
Mean −0.003159
Sigma 1.003
Ratio
pull of θ parameter
pullTheta
Std Dev 1.12
Constant 0.08198
Mean −0.0009011
Sigma 0.9439
pullTheta
Std Dev 1.12
Constant 0.08199
Mean −0.0009519
Sigma 0.9438
pullTheta
Std Dev 1.12
Constant 0.08199
Mean −0.0009164
Sigma 0.9439
pullTheta
Std Dev 1.12
Constant 0.08199
Mean −0.0009164
Sigma 0.9439
pullTheta
Std Dev 1.12
Constant 0.08199
Mean −0.0009164
Sigma 0.9439
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.201
Constant 0.07906
Mean −0.001269
Sigma 0.9756
pullDxy
Std Dev 1.201
Constant 0.07905
Mean −0.001161
Sigma 0.9756
pullDxy
Std Dev 1.201
Constant 0.07906
Mean −0.001242
Sigma 0.9755
pullDxy
Std Dev 1.201
Constant 0.07906
Mean −0.001242
Sigma 0.9755
pullDxy
Std Dev 1.201
Constant 0.07906
Mean −0.001242
Sigma 0.9755
Ratio
pull of dz parameter
pullDz
Std Dev 1.284
Constant 0.07741
Mean −0.003215
Sigma 0.9851
pullDz
Std Dev 1.284
Constant 0.07742
Mean −0.003235
Sigma 0.985
pullDz
Std Dev 1.284
Constant 0.07741
Mean −0.003233
Sigma 0.9851
pullDz
Std Dev 1.284
Constant 0.07741
Mean −0.003233
Sigma 0.9851
pullDz
Std Dev 1.284
Constant 0.07741
Mean −0.003233
Sigma 0.9851
Ratio