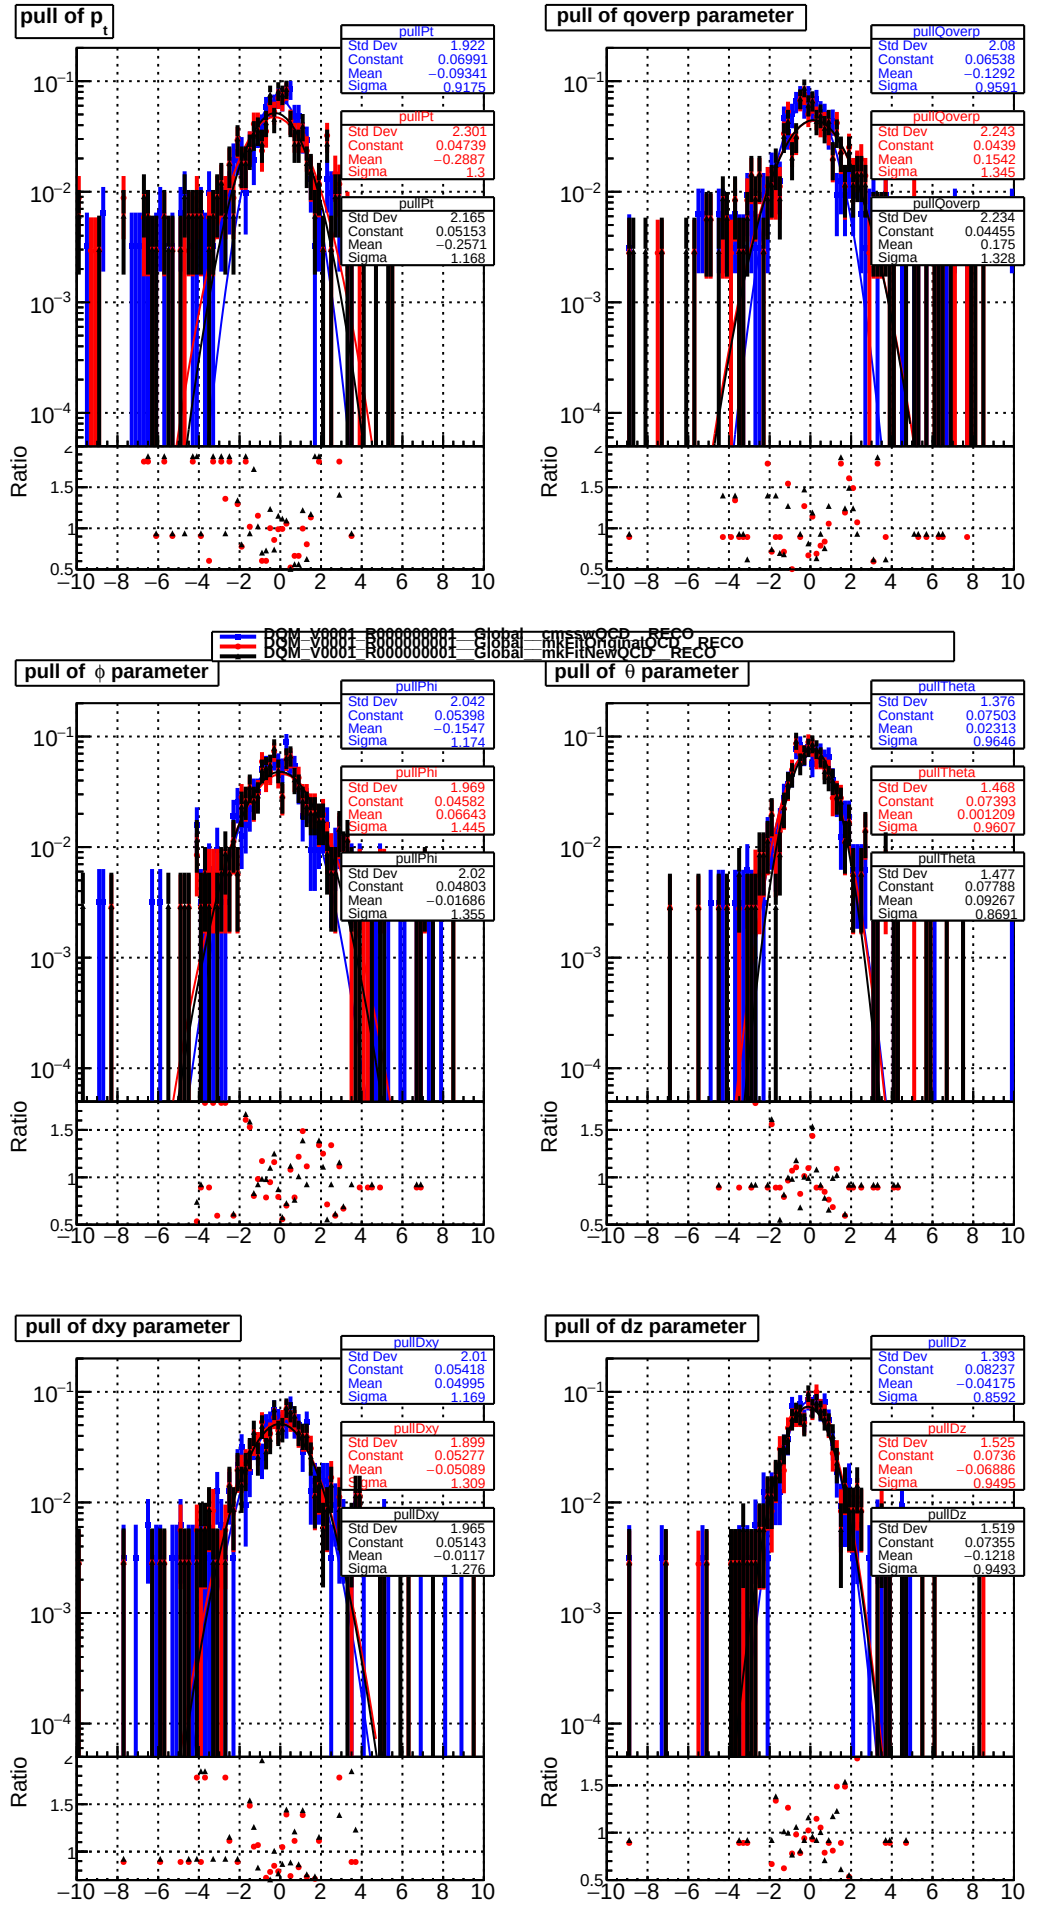
pull of p_t
pullPt
Std Dev 1.922
Constant 0.06991
Mean −0.09341
Sigma 0.9175
pullPt
Std Dev 2.301
Constant 0.04739
Mean −0.2887
Sigma 1.3
pullPt
Std Dev 2.165
Constant 0.05153
Mean −0.2571
Sigma 1.168
pull of qoverp parameter
pullQoverp
Std Dev 2.08
Constant 0.06538
Mean −0.1292
Sigma 0.9591
pullQoverp
Std Dev 2.243
Constant 0.0439
Mean 0.1542
Sigma 1.345
pullQoverp
Std Dev 2.234
Constant 0.04455
Mean 0.175
Sigma 1.328
DQM_V0001_R000000001__Global__ctfwithOrigin__RECO
DQM_V0001_R000000001__Global__mkFitOriginalQCD__RECO
DQM_V0001_R000000001__Global__mkFitNewQCD__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.042
Constant 0.05398
Mean −0.1547
Sigma 1.174
pullPhi
Std Dev 1.969
Constant 0.04582
Mean 0.06643
Sigma 1.445
pullPhi
Std Dev 2.02
Constant 0.04803
Mean −0.01686
Sigma 1.355
pull of θ parameter
pullTheta
Std Dev 1.376
Constant 0.07503
Mean 0.02313
Sigma 0.9646
pullTheta
Std Dev 1.468
Constant 0.07393
Mean 0.001209
Sigma 0.9607
pullTheta
Std Dev 1.477
Constant 0.07788
Mean 0.09267
Sigma 0.8691
pull of dxy parameter
pullDxy
Std Dev 2.01
Constant 0.05418
Mean 0.04995
Sigma 1.169
pullDxy
Std Dev 1.899
Constant 0.05277
Mean −0.05089
Sigma 1.309
pullDxy
Std Dev 1.965
Constant 0.05143
Mean −0.0117
Sigma 1.276
pull of dz parameter
pullDz
Std Dev 1.393
Constant 0.08237
Mean −0.04175
Sigma 0.8592
pullDz
Std Dev 1.525
Constant 0.0736
Mean −0.06886
Sigma 0.9495
pullDz
Std Dev 1.519
Constant 0.07355
Mean −0.1218
Sigma 0.9493
Ratio