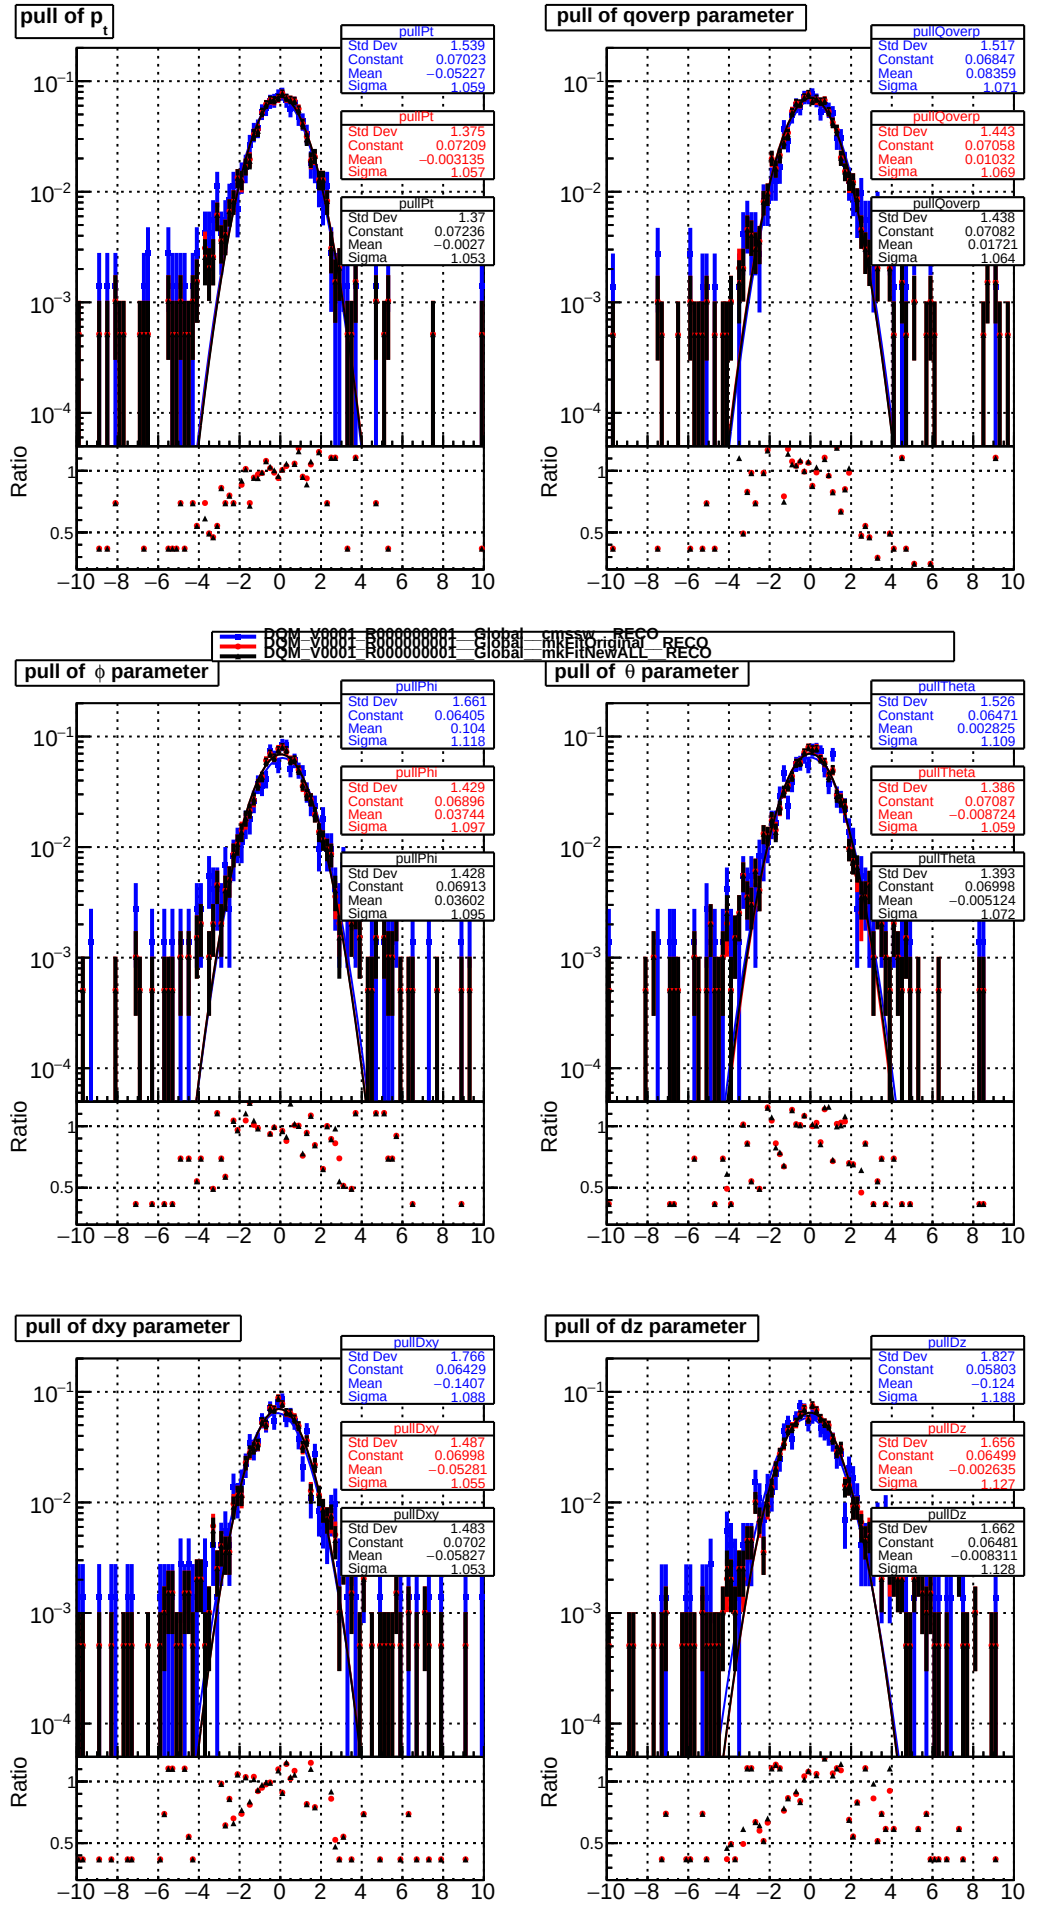
pull of p_t
pullPt
Std Dev 1.539
Constant 0.07023
Mean −0.05227
Sigma 1.059
pullPt
Std Dev 1.375
Constant 0.07209
Mean −0.003135
Sigma 1.057
pullPt
Std Dev 1.37
Constant 0.07236
Mean −0.0027
Sigma 1.053
pull of qoverp parameter
pullQoverp
Std Dev 1.517
Constant 0.06847
Mean 0.08359
Sigma 1.071
pullQoverp
Std Dev 1.443
Constant 0.07058
Mean 0.01032
Sigma 1.069
pullQoverp
Std Dev 1.438
Constant 0.07082
Mean 0.01721
Sigma 1.064
DQM_V0001_R000000001__Global__ctfWithMaterialTracksP5__RECO
DQM_V0001_R000000001__Global__mkFitOrigIter__RECO
DQM_V0001_R000000001__Global__mkFitNewALL__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.661
Constant 0.06405
Mean 0.104
Sigma 1.118
pullPhi
Std Dev 1.429
Constant 0.06896
Mean 0.03744
Sigma 1.097
pullPhi
Std Dev 1.428
Constant 0.06913
Mean 0.03602
Sigma 1.095
pull of θ parameter
pullTheta
Std Dev 1.526
Constant 0.06471
Mean 0.002825
Sigma 1.109
pullTheta
Std Dev 1.386
Constant 0.07087
Mean −0.008724
Sigma 1.059
pullTheta
Std Dev 1.393
Constant 0.06998
Mean −0.005124
Sigma 1.072
pull of dxy parameter
pullDxy
Std Dev 1.766
Constant 0.06429
Mean −0.1407
Sigma 1.088
pullDxy
Std Dev 1.487
Constant 0.06998
Mean −0.05281
Sigma 1.055
pullDxy
Std Dev 1.483
Constant 0.0702
Mean −0.05827
Sigma 1.053
pull of dz parameter
pullDz
Std Dev 1.827
Constant 0.05803
Mean −0.124
Sigma 1.188
pullDz
Std Dev 1.656
Constant 0.06499
Mean −0.002635
Sigma 1.127
pullDz
Std Dev 1.662
Constant 0.06481
Mean −0.008311
Sigma 1.128
Ratio