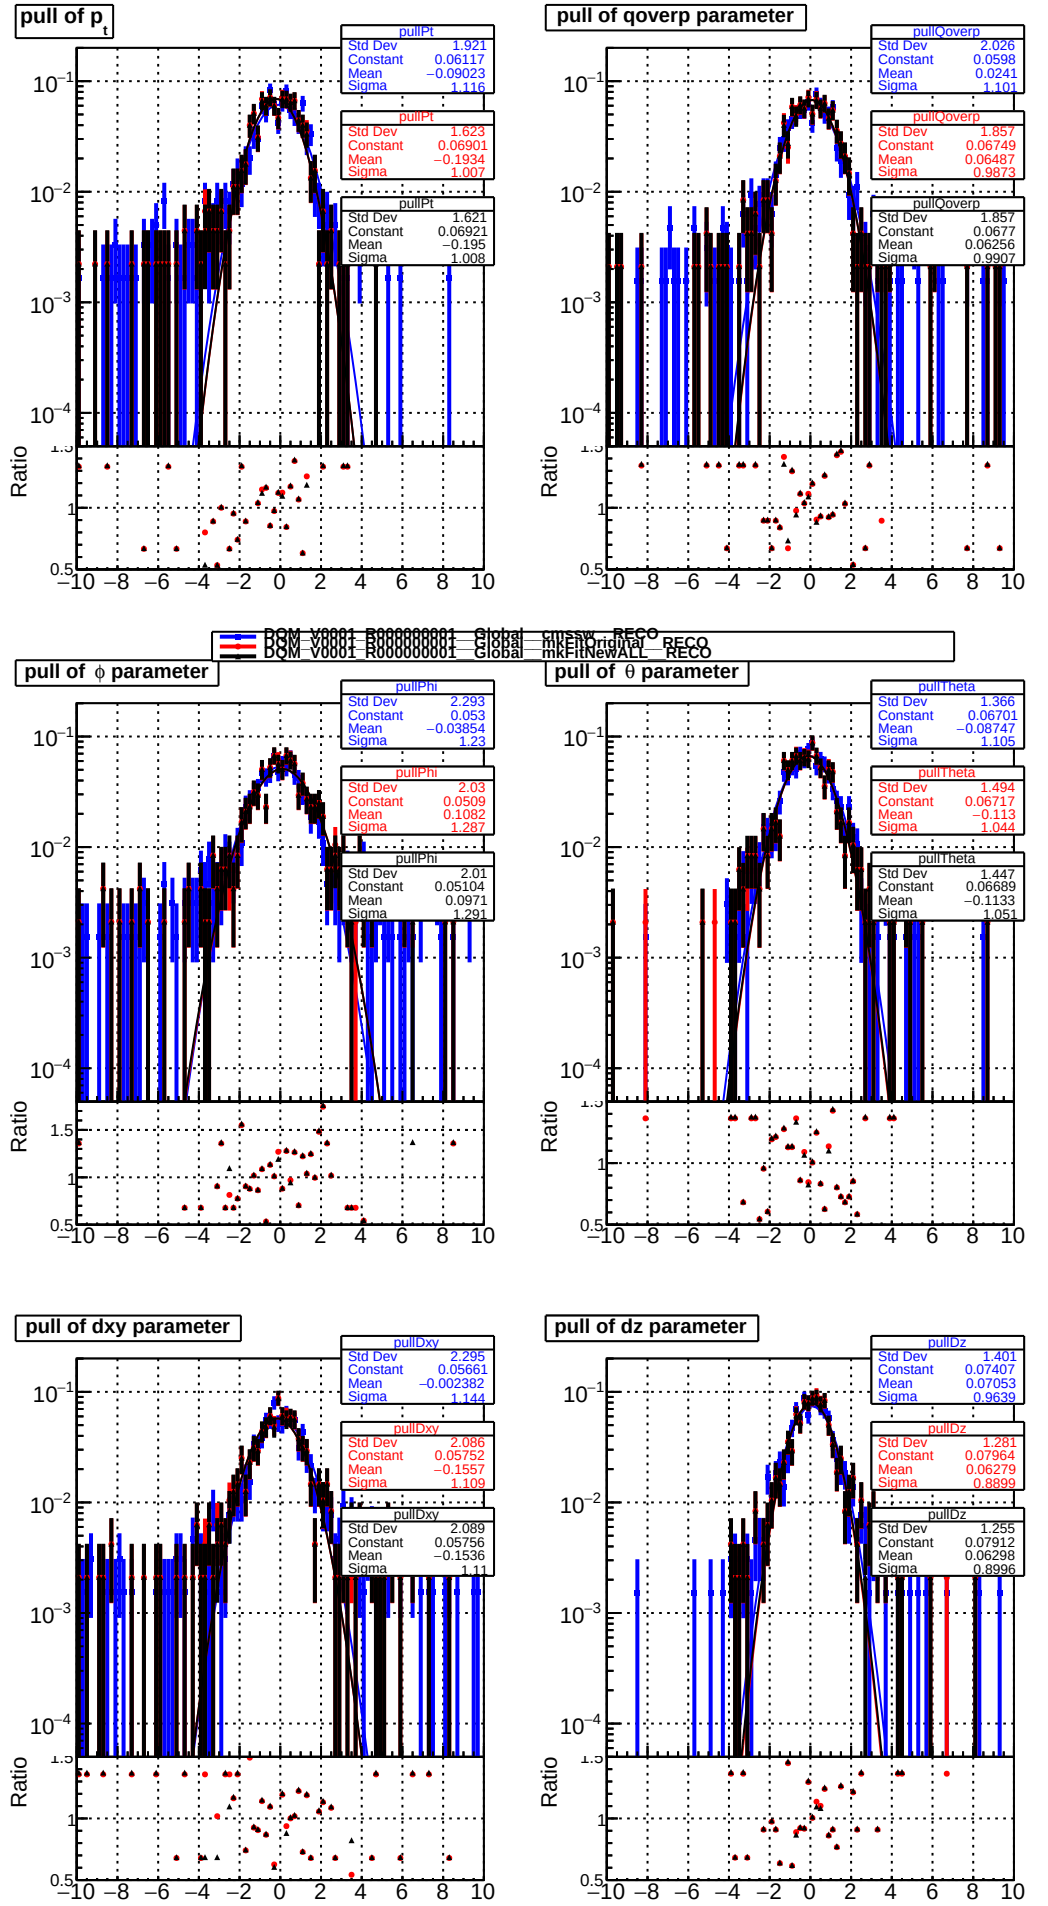
pull of p_t
pullPt
Std Dev 1.921
Constant 0.06117
Mean −0.09023
Sigma 1.116
pullPt
Std Dev 1.623
Constant 0.06901
Mean −0.1934
Sigma 1.007
pullPt
Std Dev 1.621
Constant 0.06921
Mean −0.195
Sigma 1.008
pull of qoverp parameter
pullQoverp
Std Dev 2.026
Constant 0.0598
Mean 0.0241
Sigma 1.101
pullQoverp
Std Dev 1.857
Constant 0.06749
Mean 0.06487
Sigma 0.9873
pullQoverp
Std Dev 1.857
Constant 0.0677
Mean 0.06256
Sigma 0.9907
DQM_V0001_R000000001__Global__ctfWsw__RECO
DQM_V0001_R000000001__Global__mkFitOrdinal__RECO
DQM_V0001_R000000001__Global__mkFitNewALL__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.293
Constant 0.053
Mean −0.03854
Sigma 1.23
pullPhi
Std Dev 2.03
Constant 0.0509
Mean 0.1082
Sigma 1.287
pullPhi
Std Dev 2.01
Constant 0.05104
Mean 0.0971
Sigma 1.291
pull of θ parameter
pullTheta
Std Dev 1.366
Constant 0.06701
Mean −0.08747
Sigma 1.105
pullTheta
Std Dev 1.494
Constant 0.06717
Mean −0.113
Sigma 1.044
pullTheta
Std Dev 1.447
Constant 0.06689
Mean −0.1133
Sigma 1.051
pull of dxy parameter
pullDxy
Std Dev 2.295
Constant 0.05661
Mean −0.002382
Sigma 1.144
pullDxy
Std Dev 2.086
Constant 0.05752
Mean −0.1557
Sigma 1.109
pullDxy
Std Dev 2.089
Constant 0.05756
Mean −0.1536
Sigma 1.11
pull of dz parameter
pullDz
Std Dev 1.401
Constant 0.07407
Mean 0.07053
Sigma 0.9639
pullDz
Std Dev 1.281
Constant 0.07964
Mean 0.06279
Sigma 0.8899
pullDz
Std Dev 1.255
Constant 0.07912
Mean 0.06298
Sigma 0.8996
Ratio