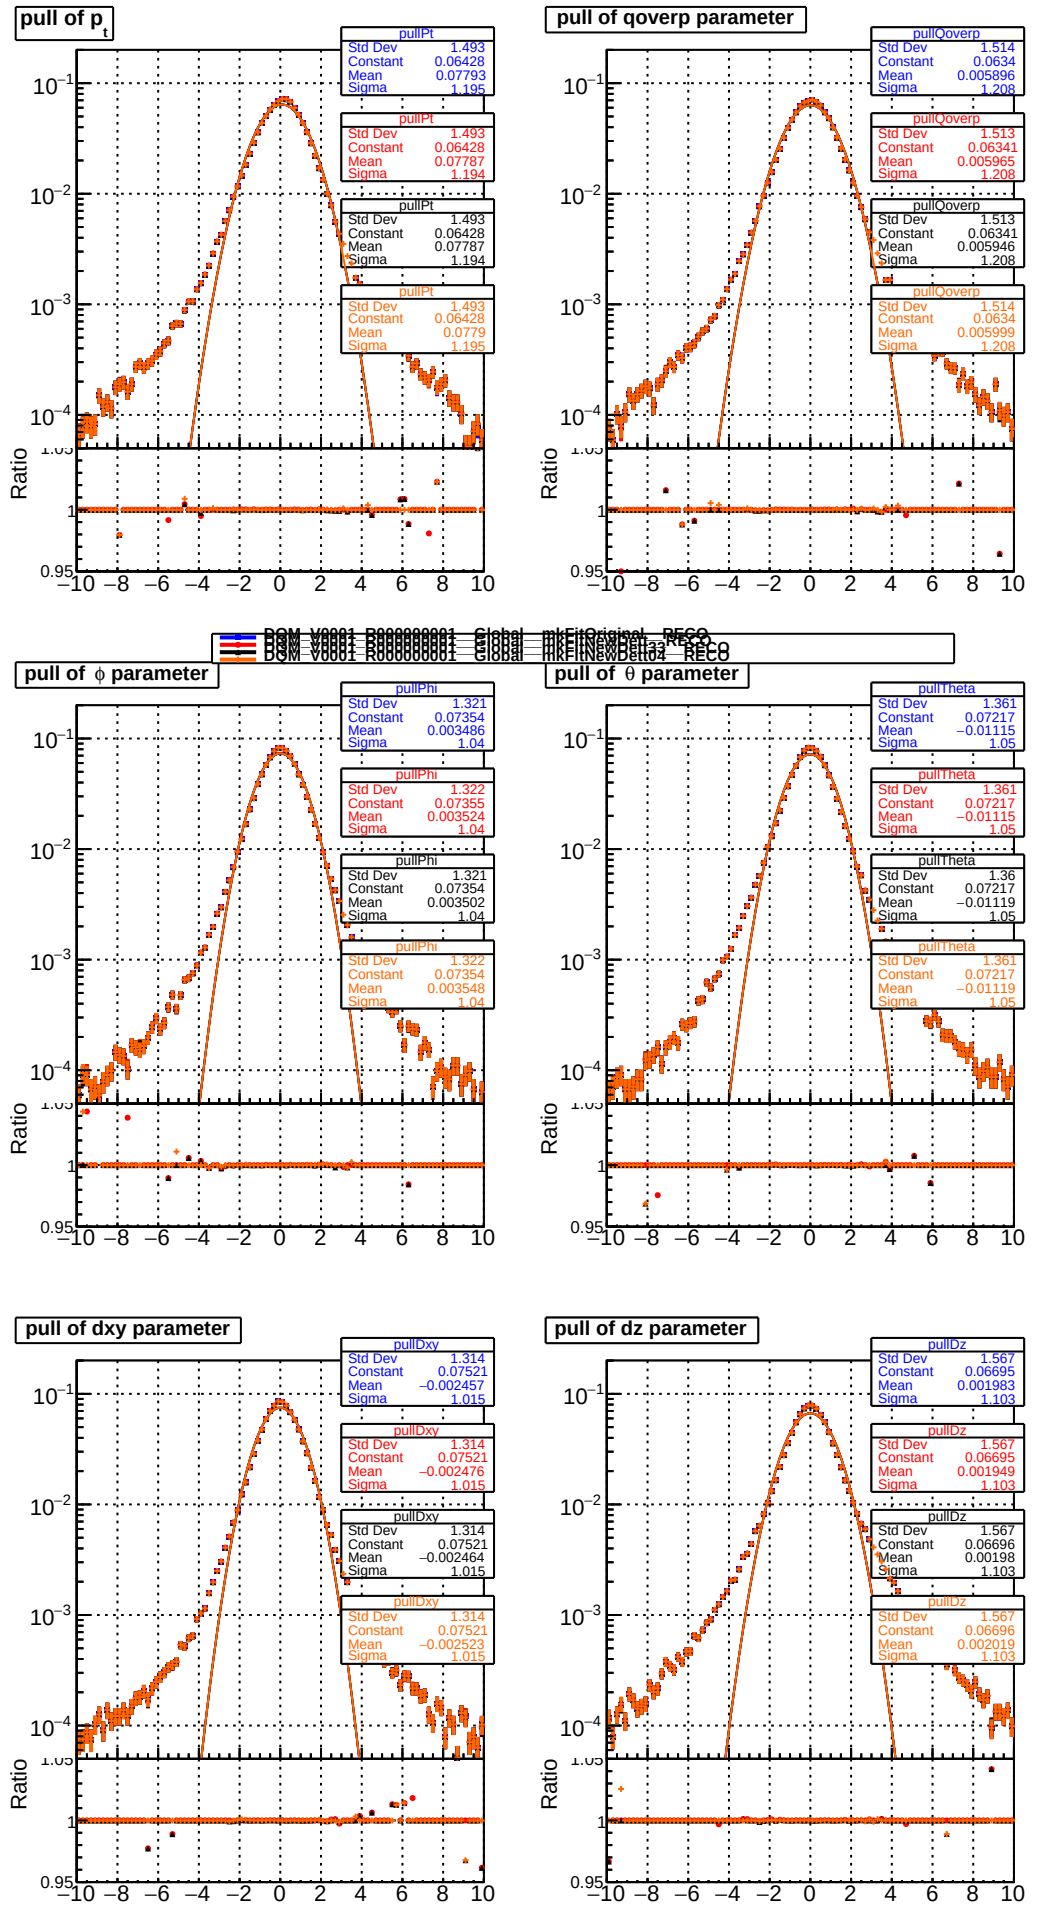
pull of p_t
pullPt
Std Dev 1.493
Constant 0.06428
Mean 0.07793
Sigma 1.195
pullPt
Std Dev 1.493
Constant 0.06428
Mean 0.07787
Sigma 1.194
pullPt
Std Dev 1.493
Constant 0.06428
Mean 0.07787
Sigma 1.194
pullPt
Std Dev 1.493
Constant 0.06428
Mean 0.0779
Sigma 1.195
pull of qoverp parameter
pullQoverp
Std Dev 1.514
Constant 0.0634
Mean 0.005896
Sigma 1.208
pullQoverp
Std Dev 1.513
Constant 0.06341
Mean 0.005965
Sigma 1.208
pullQoverp
Std Dev 1.513
Constant 0.06341
Mean 0.005946
Sigma 1.208
pullQoverp
Std Dev 1.514
Constant 0.0634
Mean 0.005999
Sigma 1.208
DQM V0001 R000000001 Global mkFitOriginal RECO
DQM V0001 R000000001 Global mkFitNewDetIdx RECO
DQM V0001 R000000001 Global mkFitNewDetIdx RECO
DQM V0001 R000000001 Global mkFitNewDetIdx RECO
pull of ϕ parameter
pullPhi
Std Dev 1.321
Constant 0.07354
Mean 0.003486
Sigma 1.04
pullPhi
Std Dev 1.322
Constant 0.07355
Mean 0.003524
Sigma 1.04
pullPhi
Std Dev 1.321
Constant 0.07354
Mean 0.003502
Sigma 1.04
pullPhi
Std Dev 1.322
Constant 0.07354
Mean 0.003548
Sigma 1.04
pull of θ parameter
pullTheta
Std Dev 1.361
Constant 0.07217
Mean −0.01115
Sigma 1.05
pullTheta
Std Dev 1.361
Constant 0.07217
Mean −0.01115
Sigma 1.05
pullTheta
Std Dev 1.36
Constant 0.07217
Mean −0.01119
Sigma 1.05
pullTheta
Std Dev 1.361
Constant 0.07217
Mean −0.01119
Sigma 1.05
pull of dxy parameter
pullDxy
Std Dev 1.314
Constant 0.07521
Mean −0.002457
Sigma 1.015
pullDxy
Std Dev 1.314
Constant 0.07521
Mean −0.002476
Sigma 1.015
pullDxy
Std Dev 1.314
Constant 0.07521
Mean −0.002464
Sigma 1.015
pullDxy
Std Dev 1.314
Constant 0.07521
Mean −0.002523
Sigma 1.015
pull of dz parameter
pullDz
Std Dev 1.567
Constant 0.06695
Mean 0.001983
Sigma 1.103
pullDz
Std Dev 1.567
Constant 0.06695
Mean 0.001949
Sigma 1.103
pullDz
Std Dev 1.567
Constant 0.06696
Mean 0.00198
Sigma 1.103
pullDz
Std Dev 1.567
Constant 0.06696
Mean 0.002019
Sigma 1.103
Ratio