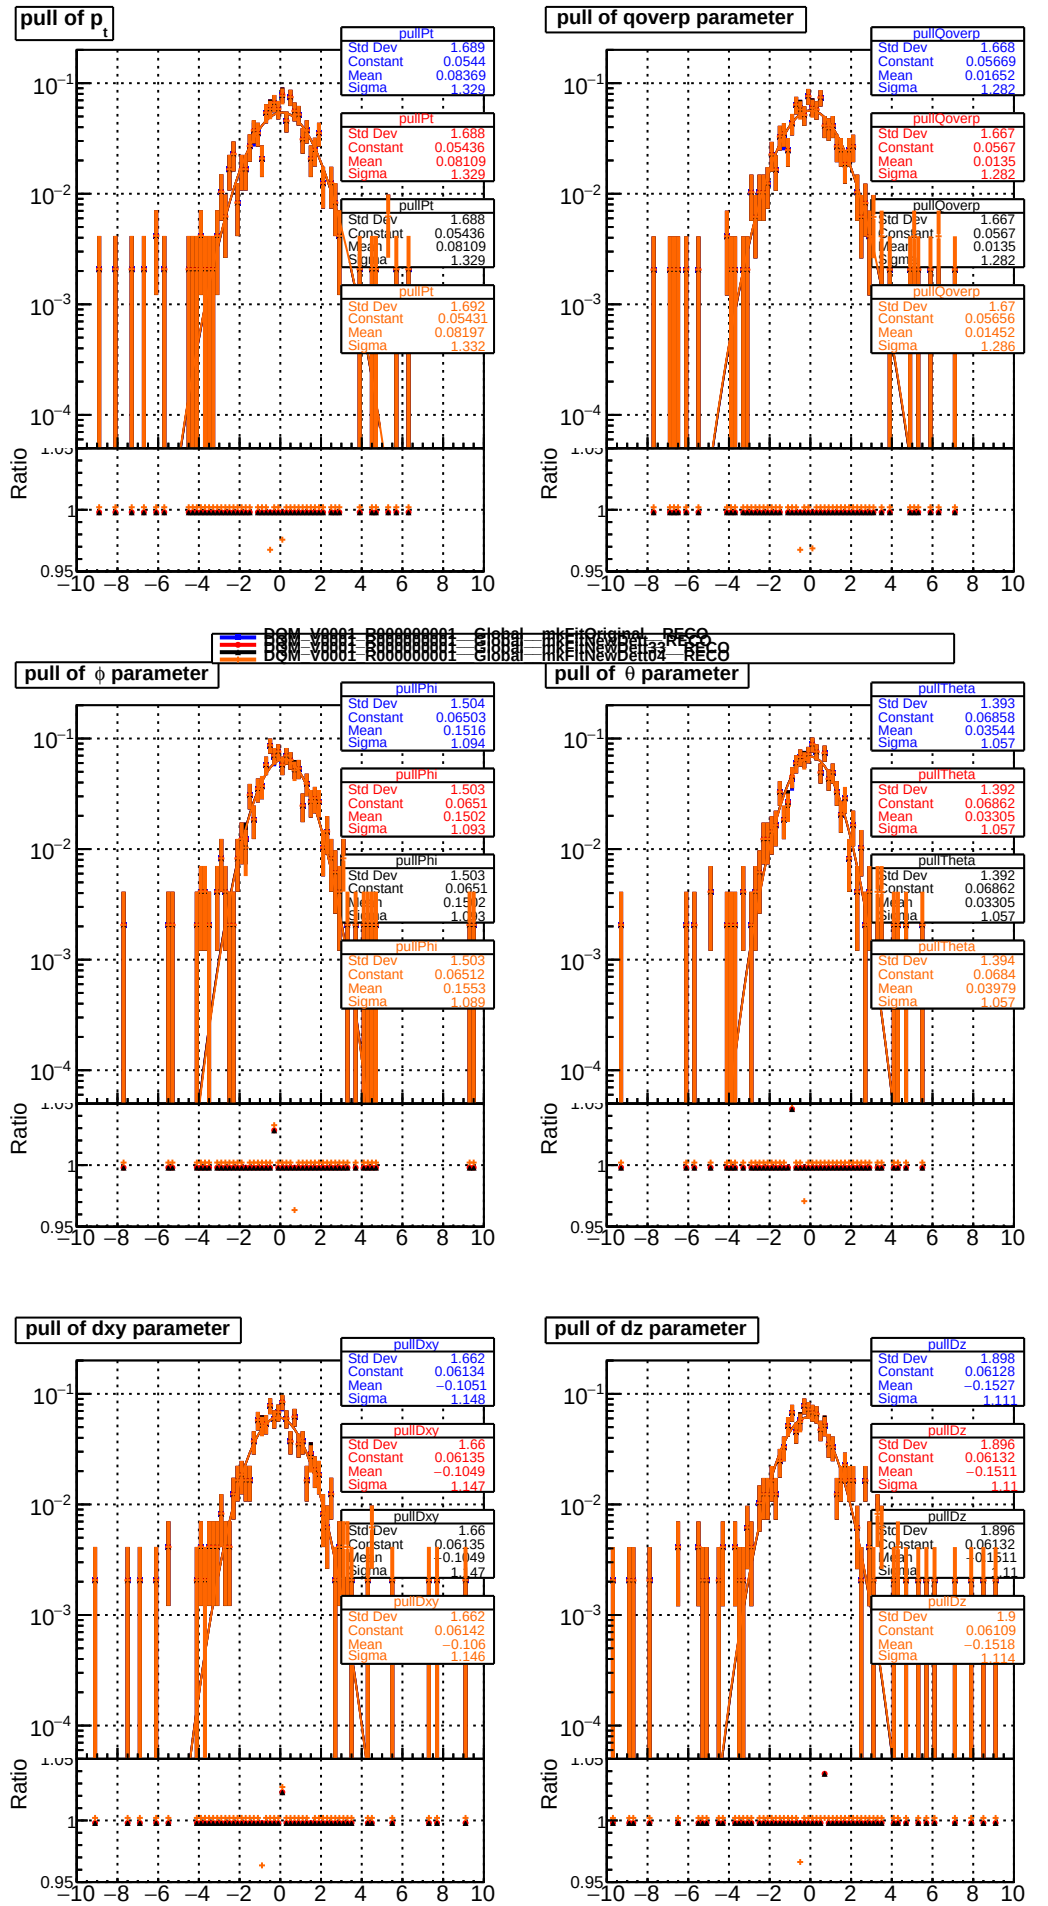
pull of p_t
pullPt
Std Dev 1.689
Constant 0.0544
Mean 0.08369
Sigma 1.329
pullPt
Std Dev 1.688
Constant 0.05436
Mean 0.08109
Sigma 1.329
pullPt
Std Dev 1.688
Constant 0.05436
Mean 0.08109
Sigma 1.329
pullPt
Std Dev 1.692
Constant 0.05431
Mean 0.08197
Sigma 1.332
pull of qoverp parameter
pullQoverp
Std Dev 1.668
Constant 0.05669
Mean 0.01652
Sigma 1.282
pullQoverp
Std Dev 1.667
Constant 0.0567
Mean 0.0135
Sigma 1.282
pullQoverp
Std Dev 1.667
Constant 0.0567
Mean 0.0135
Sigma 1.282
pullQoverp
Std Dev 1.67
Constant 0.05656
Mean 0.01452
Sigma 1.286
DQM V0001 R000000001 Global mkFitOriginal RECO
DQM V0001 R000000001 Global mkFitNewDetIds RECO
DQM V0001 R000000001 Global mkFitNewDetIds RECO
DQM V0001 R000000001 Global mkFitNewDetIds RECO
pull of ϕ parameter
pullPhi
Std Dev 1.504
Constant 0.06503
Mean 0.1516
Sigma 1.094
pullPhi
Std Dev 1.503
Constant 0.0651
Mean 0.1502
Sigma 1.093
pullPhi
Std Dev 1.503
Constant 0.0651
Mean 0.1502
Sigma 1.093
pullPhi
Std Dev 1.503
Constant 0.06512
Mean 0.1553
Sigma 1.089
pull of θ parameter
pullTheta
Std Dev 1.393
Constant 0.06858
Mean 0.03544
Sigma 1.057
pullTheta
Std Dev 1.392
Constant 0.06862
Mean 0.03305
Sigma 1.057
pullTheta
Std Dev 1.392
Constant 0.06862
Mean 0.03305
Sigma 1.057
pullTheta
Std Dev 1.394
Constant 0.0684
Mean 0.03979
Sigma 1.057
pull of dxy parameter
pullDxy
Std Dev 1.662
Constant 0.06134
Mean −0.1051
Sigma 1.148
pullDxy
Std Dev 1.66
Constant 0.06135
Mean −0.1049
Sigma 1.147
pullDxy
Std Dev 1.66
Constant 0.06135
Mean −0.1049
Sigma 1.147
pullDxy
Std Dev 1.662
Constant 0.06142
Mean −0.106
Sigma 1.146
pull of dz parameter
pullDz
Std Dev 1.898
Constant 0.06128
Mean −0.1527
Sigma 1.111
pullDz
Std Dev 1.896
Constant 0.06132
Mean −0.1511
Sigma 1.11
pullDz
Std Dev 1.896
Constant 0.06132
Mean −0.1511
Sigma 1.11
pullDz
Std Dev 1.9
Constant 0.06109
Mean −0.1518
Sigma 1.114
Ratio