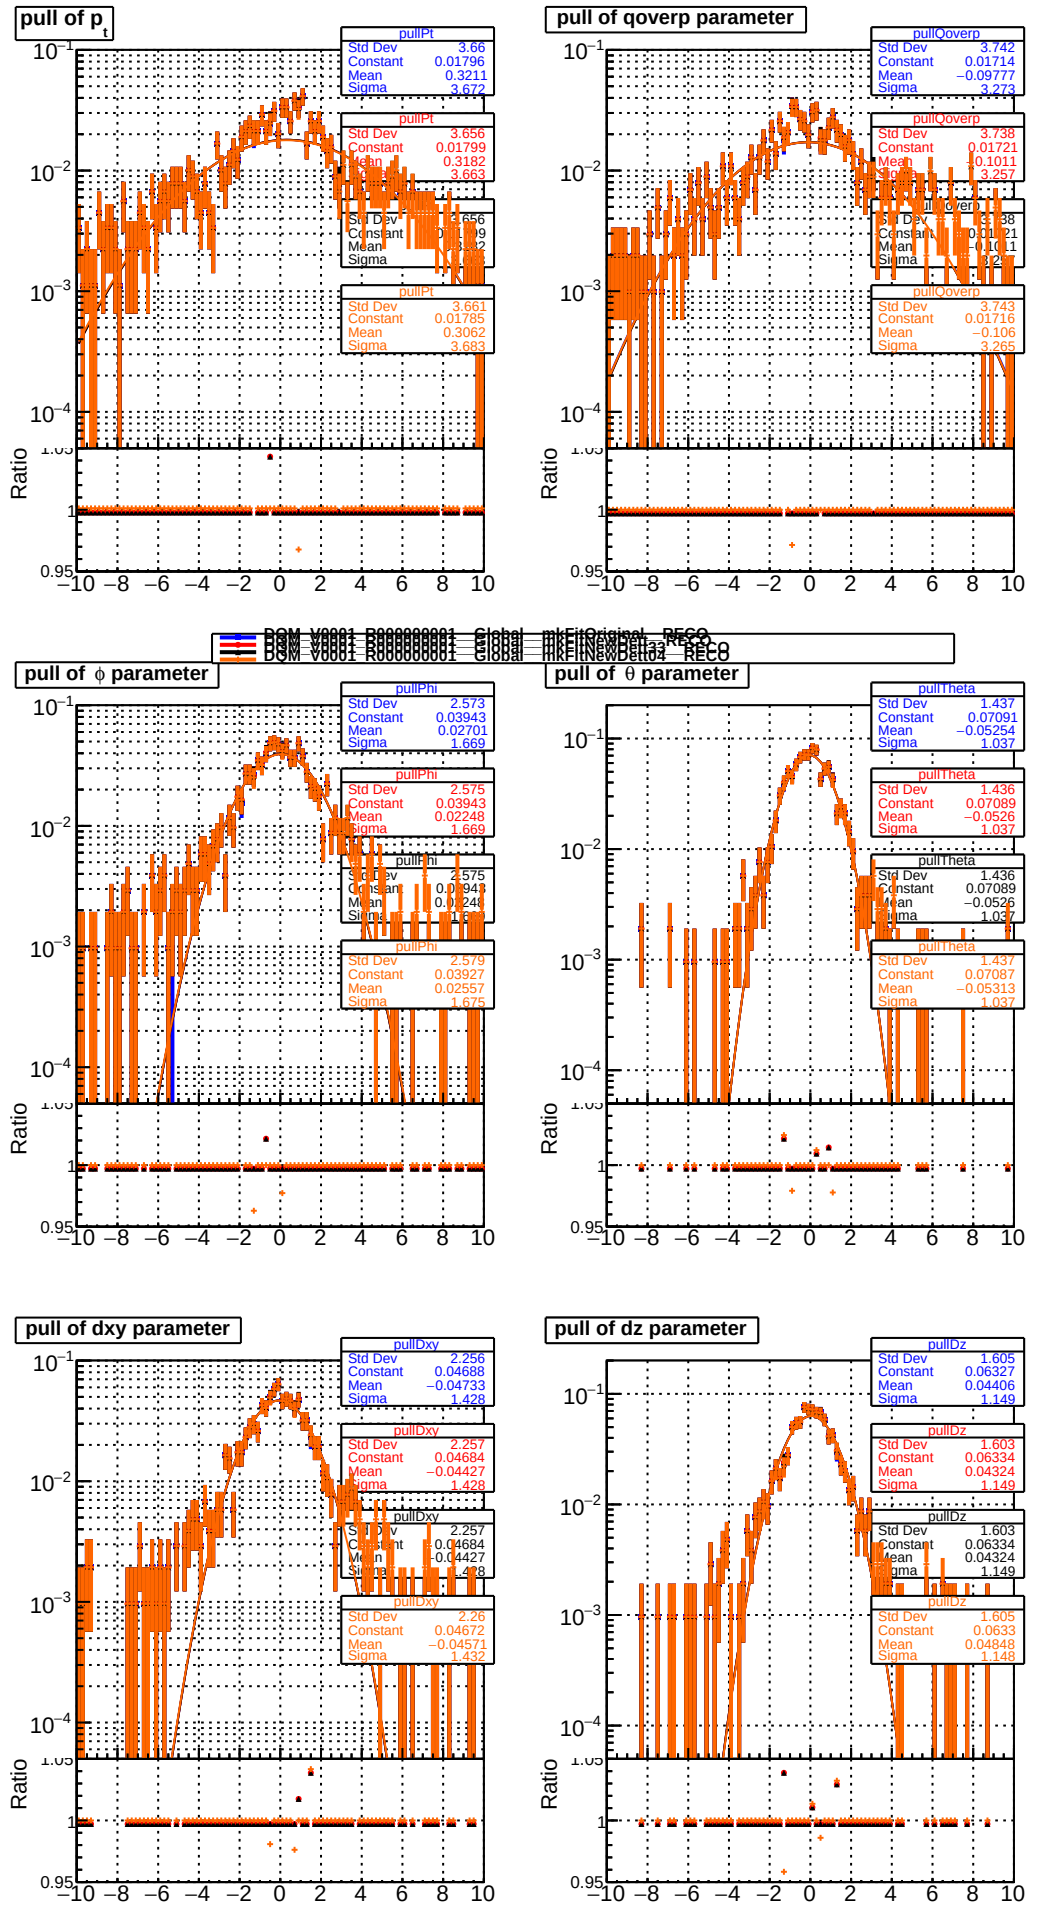
pull of p_t
pullPt
Std Dev 3.66
Constant 0.01796
Mean 0.3211
Sigma 3.672
pullPt
Std Dev 3.656
Constant 0.01799
Mean 0.3182
Sigma 3.663
pullPt
Std Dev 3.661
Constant 0.01785
Mean 0.3062
Sigma 3.683
pull of qoverp parameter
pullQoverp
Std Dev 3.742
Constant 0.01714
Mean −0.09777
Sigma 3.273
pullQoverp
Std Dev 3.738
Constant 0.01721
Mean −0.1011
Sigma 3.257
pullQoverp
Std Dev 3.743
Constant 0.01716
Mean −0.106
Sigma 3.265
DQM V0001 R000000001 Global mkFitOriginal RECO
DQM V0001 R000000001 Global mkFitNewDetIdx RECO
DQM V0001 R000000001 Global mkFitNewDetIdx RECO
DQM V0001 R000000001 Global mkFitNewDetIdx RECO
pull of ϕ parameter
pullPhi
Std Dev 2.573
Constant 0.03943
Mean 0.02701
Sigma 1.669
pullPhi
Std Dev 2.575
Constant 0.03943
Mean 0.02248
Sigma 1.669
pullPhi
Std Dev 2.579
Constant 0.03927
Mean 0.02557
Sigma 1.675
pull of θ parameter
pullTheta
Std Dev 1.437
Constant 0.07091
Mean −0.05254
Sigma 1.037
pullTheta
Std Dev 1.436
Constant 0.07089
Mean −0.0526
Sigma 1.037
pullTheta
Std Dev 1.437
Constant 0.07087
Mean −0.05313
Sigma 1.037
pull of dxy parameter
pullDxy
Std Dev 2.256
Constant 0.04688
Mean −0.04733
Sigma 1.428
pullDxy
Std Dev 2.257
Constant 0.04684
Mean −0.04427
Sigma 1.428
pullDxy
Std Dev 2.26
Constant 0.04672
Mean −0.04571
Sigma 1.432
pull of dz parameter
pullDz
Std Dev 1.605
Constant 0.06327
Mean 0.04406
Sigma 1.149
pullDz
Std Dev 1.603
Constant 0.06334
Mean 0.04324
Sigma 1.149
pullDz
Std Dev 1.605
Constant 0.0633
Mean 0.04848
Sigma 1.148
Ratio