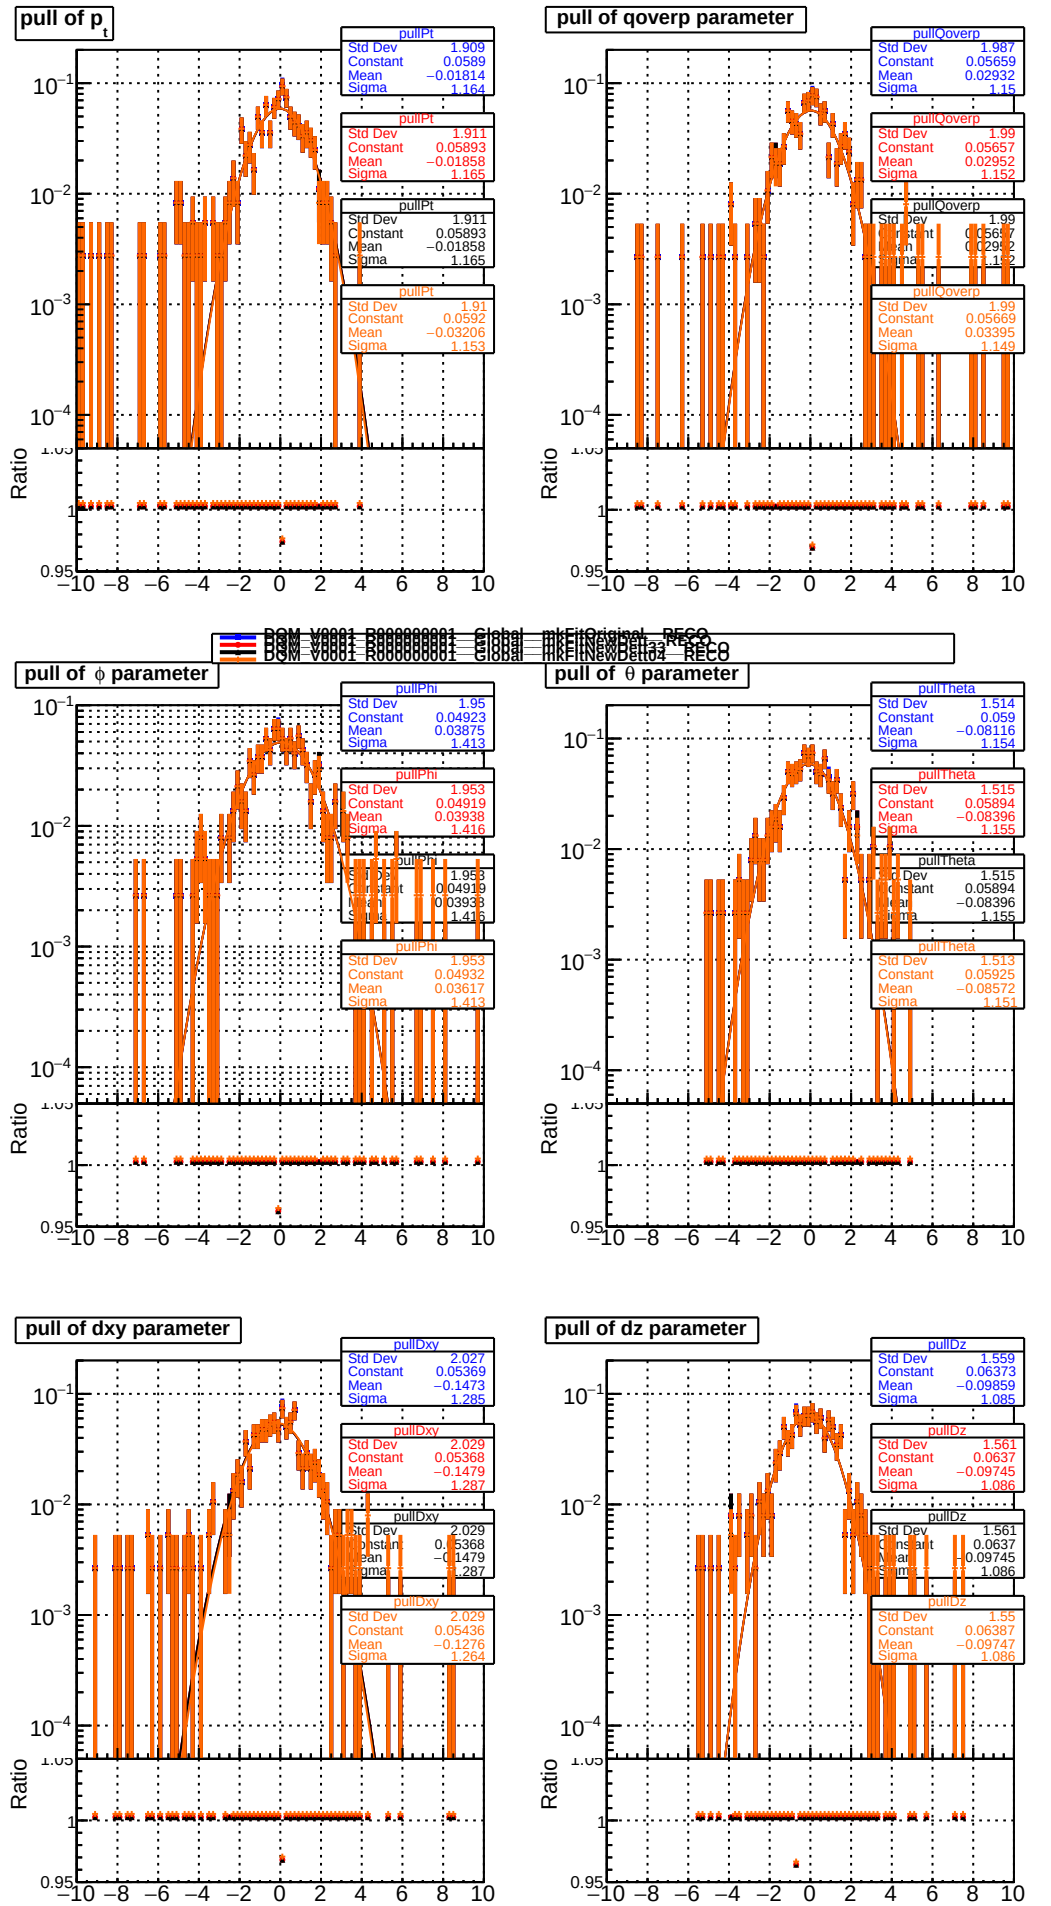
pull of p_t
pullPt
Std Dev 1.909
Constant 0.0589
Mean −0.01814
Sigma 1.164
pullPt
Std Dev 1.911
Constant 0.05893
Mean −0.01858
Sigma 1.165
pullPt
Std Dev 1.911
Constant 0.05893
Mean −0.01858
Sigma 1.165
pullPt
Std Dev 1.91
Constant 0.0592
Mean −0.03206
Sigma 1.153
pull of qoverp parameter
pullQoverp
Std Dev 1.987
Constant 0.05659
Mean 0.02932
Sigma 1.15
pullQoverp
Std Dev 1.99
Constant 0.05657
Mean 0.02952
Sigma 1.152
pullQoverp
Std Dev 1.99
Constant 0.05657
Mean 0.02952
Sigma 1.152
pullQoverp
Std Dev 1.99
Constant 0.05669
Mean 0.03395
Sigma 1.149
DQM V0001 R000000001 Global mkFitOriginal RECO
DQM V0001 R000000001 Global mkFitNewDetIds RECO
DQM V0001 R000000001 Global mkFitNewDetIds RECO
DQM V0001 R000000001 Global mkFitNewDetIds RECO
pull of ϕ parameter
pullPhi
Std Dev 1.95
Constant 0.04923
Mean 0.03875
Sigma 1.413
pullPhi
Std Dev 1.953
Constant 0.04919
Mean 0.03938
Sigma 1.416
pullPhi
Std Dev 1.953
Constant 0.04919
Mean 0.03938
Sigma 1.416
pullPhi
Std Dev 1.953
Constant 0.04932
Mean 0.03617
Sigma 1.413
pull of θ parameter
pullTheta
Std Dev 1.514
Constant 0.059
Mean −0.08116
Sigma 1.154
pullTheta
Std Dev 1.515
Constant 0.05894
Mean −0.08396
Sigma 1.155
pullTheta
Std Dev 1.515
Constant 0.05894
Mean −0.08396
Sigma 1.155
pullTheta
Std Dev 1.513
Constant 0.05925
Mean −0.08572
Sigma 1.151
pull of dxy parameter
pullDxy
Std Dev 2.027
Constant 0.05369
Mean −0.1473
Sigma 1.285
pullDxy
Std Dev 2.029
Constant 0.05368
Mean −0.1479
Sigma 1.287
pullDxy
Std Dev 2.029
Constant 0.05368
Mean −0.1479
Sigma 1.287
pullDxy
Std Dev 2.029
Constant 0.05436
Mean −0.1276
Sigma 1.264
pull of dz parameter
pullDz
Std Dev 1.559
Constant 0.06373
Mean −0.09859
Sigma 1.085
pullDz
Std Dev 1.561
Constant 0.0637
Mean −0.09745
Sigma 1.086
pullDz
Std Dev 1.561
Constant 0.0637
Mean −0.09745
Sigma 1.086
pullDz
Std Dev 1.55
Constant 0.06387
Mean −0.09747
Sigma 1.086
Ratio
1.05
1
0.95
−10 −8 −6 −4 −2 0 2 4 6 8 10