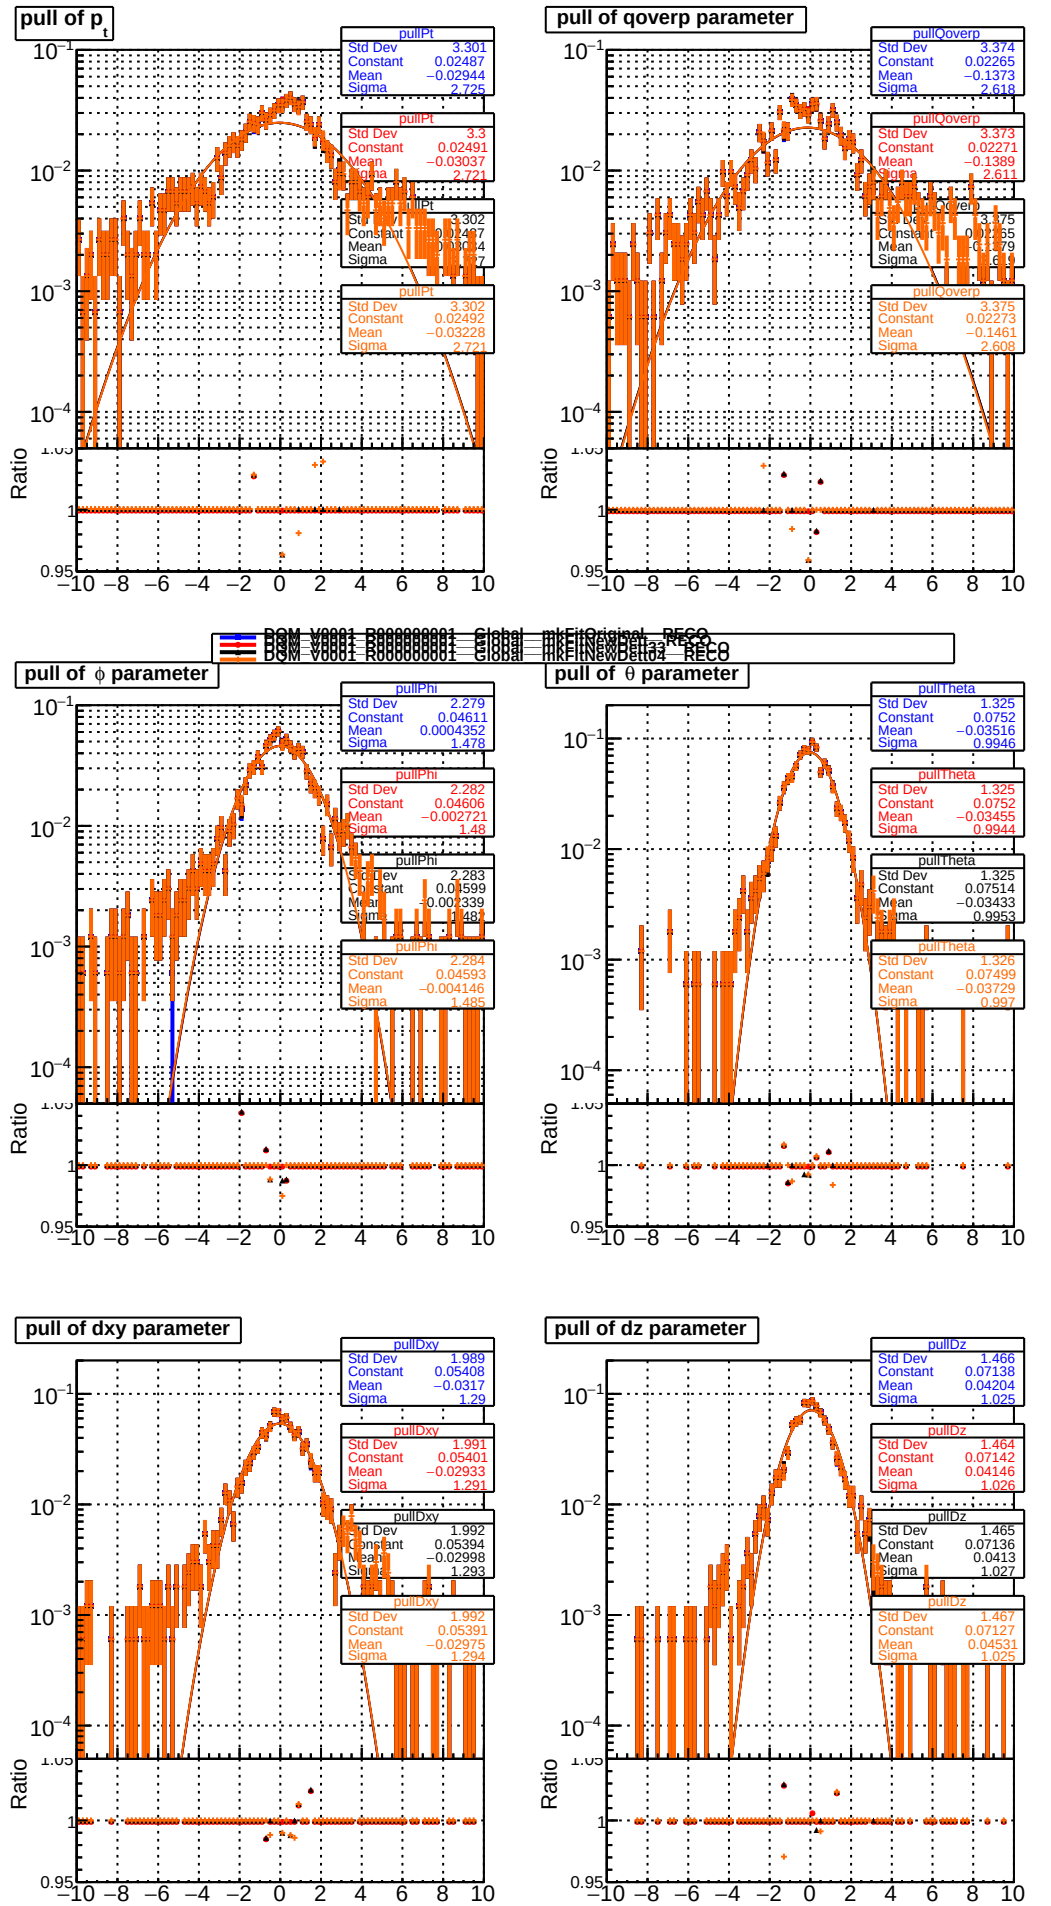
pull of p_t
pullPt
Std Dev 3.301
Constant 0.02487
Mean −0.02944
Sigma 2.725
pullPt
Std Dev 3.3
Constant 0.02491
Mean −0.03037
Sigma 2.721
pullPt
Std Dev 3.302
Constant 0.02487
Mean −0.03024
Sigma 2.727
pullPt
Std Dev 3.302
Constant 0.02492
Mean −0.03228
Sigma 2.721
pull of qoverp parameter
pullQoverp
Std Dev 3.374
Constant 0.02265
Mean −0.1373
Sigma 2.618
pullQoverp
Std Dev 3.373
Constant 0.02271
Mean −0.1389
Sigma 2.611
pullQoverp
Std Dev 3.375
Constant 0.02265
Mean −0.1379
Sigma 2.6
pullQoverp
Std Dev 3.375
Constant 0.02273
Mean −0.1461
Sigma 2.608
DQM V0001 R000000001 Global mkFitOriginal RECO
DQM V0001 R000000001 Global mkFitNewDeltaZ RECO
DQM V0001 R000000001 Global mkFitNewDeltaZ33 RECO
DQM V0001 R000000001 Global mkFitNewDeltaZ04 RECO
pull of ϕ parameter
pullPhi
Std Dev 2.279
Constant 0.04611
Mean 0.0004352
Sigma 1.478
pullPhi
Std Dev 2.282
Constant 0.04606
Mean −0.002721
Sigma 1.48
pullPhi
Std Dev 2.283
Constant 0.04599
Mean −0.002339
Sigma 1.482
pullPhi
Std Dev 2.284
Constant 0.04593
Mean −0.004146
Sigma 1.485
pull of θ parameter
pullTheta
Std Dev 1.325
Constant 0.0752
Mean −0.03516
Sigma 0.9946
pullTheta
Std Dev 1.325
Constant 0.0752
Mean −0.03455
Sigma 0.9944
pullTheta
Std Dev 1.325
Constant 0.07514
Mean −0.03433
Sigma 0.9953
pullTheta
Std Dev 1.326
Constant 0.07499
Mean −0.03729
Sigma 0.997
pull of dxy parameter
pullDxy
Std Dev 1.989
Constant 0.05408
Mean −0.0317
Sigma 1.29
pullDxy
Std Dev 1.991
Constant 0.05401
Mean −0.02933
Sigma 1.291
pullDxy
Std Dev 1.992
Constant 0.05394
Mean −0.02998
Sigma 1.293
pullDxy
Std Dev 1.992
Constant 0.05391
Mean −0.02975
Sigma 1.294
pull of dz parameter
pullDz
Std Dev 1.466
Constant 0.07138
Mean 0.04204
Sigma 1.025
pullDz
Std Dev 1.464
Constant 0.07142
Mean 0.04146
Sigma 1.026
pullDz
Std Dev 1.465
Constant 0.07136
Mean 0.0413
Sigma 1.027
pullDz
Std Dev 1.467
Constant 0.07127
Mean 0.04531
Sigma 1.025
Ratio