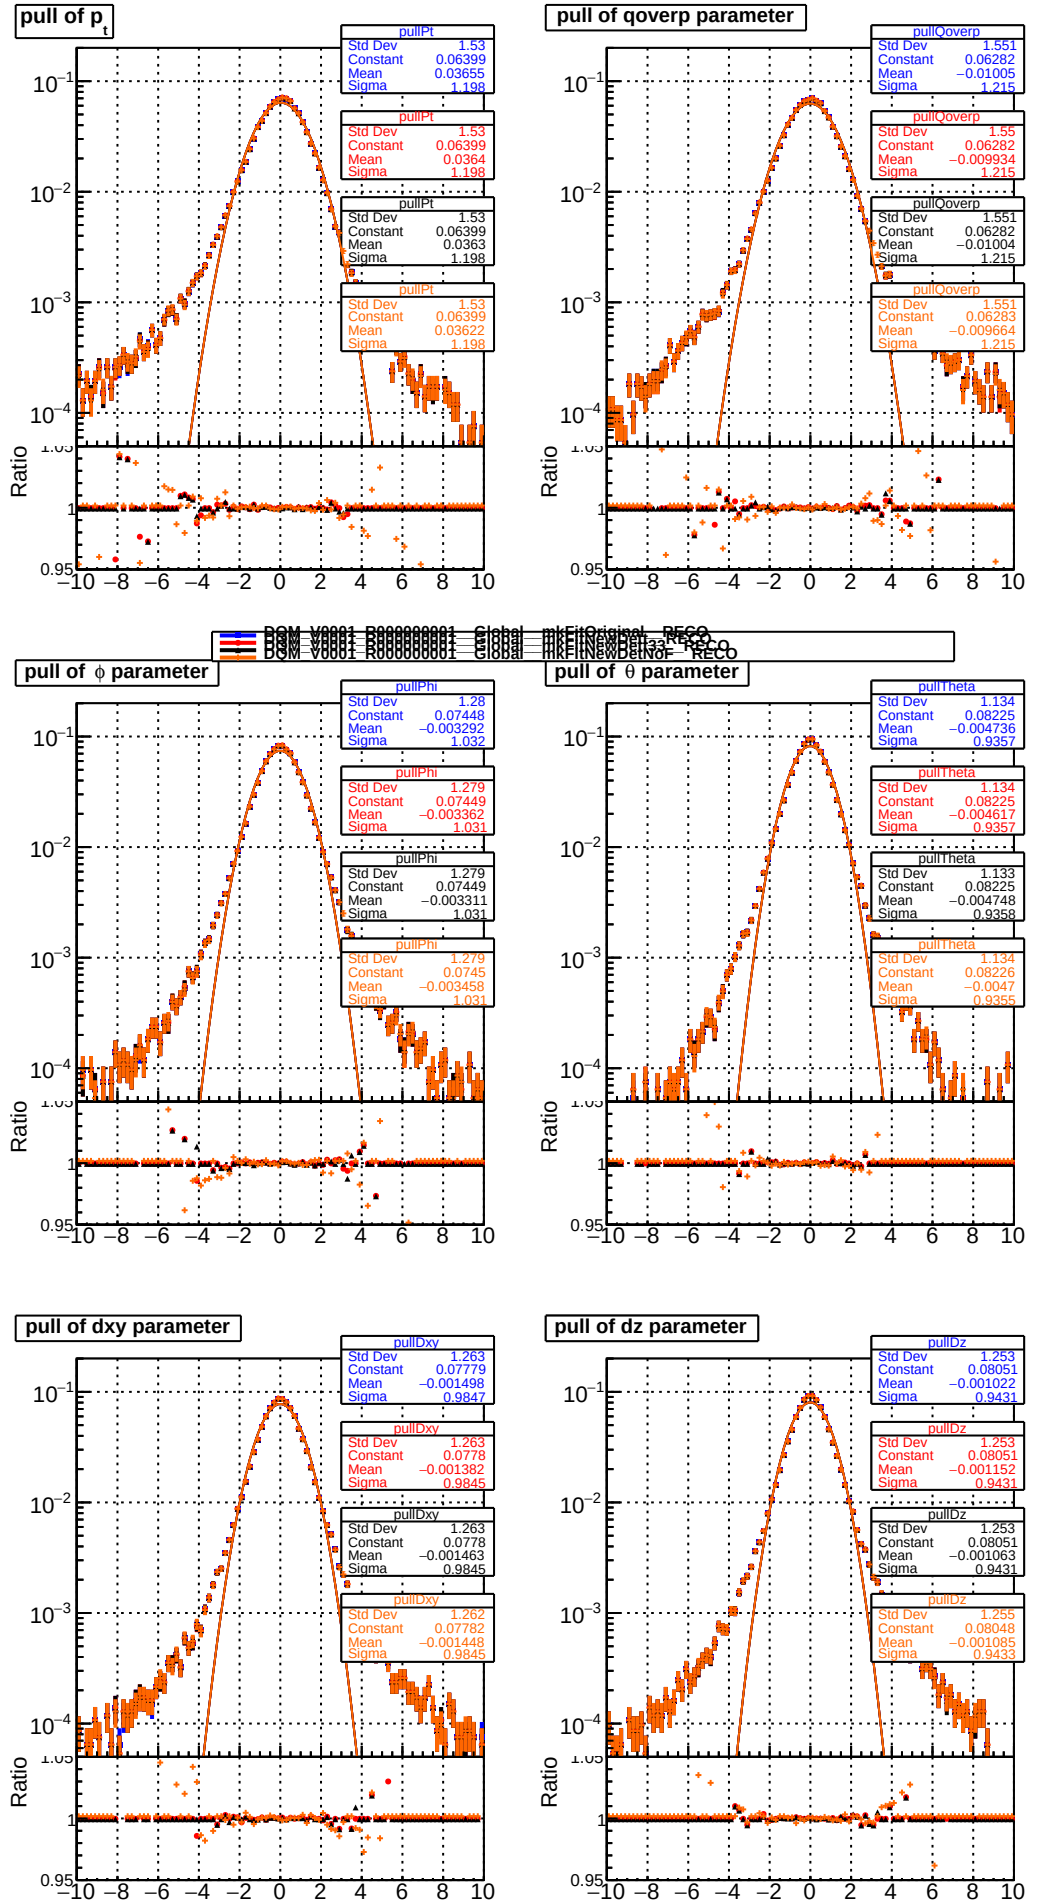
pull of p_t
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.03655
Sigma 1.198
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.0364
Sigma 1.198
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.0363
Sigma 1.198
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.03622
Sigma 1.198
pull of qoverp parameter
pullQoverp
Std Dev 1.551
Constant 0.06282
Mean −0.01005
Sigma 1.215
pullQoverp
Std Dev 1.55
Constant 0.06282
Mean −0.009934
Sigma 1.215
pullQoverp
Std Dev 1.551
Constant 0.06282
Mean −0.01004
Sigma 1.215
pullQoverp
Std Dev 1.551
Constant 0.06283
Mean −0.009664
Sigma 1.215
DQM V0001 R000000001 Global mkFitOriginal RECO
DQM V0001 R000000001 Global mkFitNewDetIn33 RECO
DQM V0001 R000000001 Global mkFitNewDetNoF RECO
pull of ϕ parameter
pullPhi
Std Dev 1.28
Constant 0.07448
Mean −0.003292
Sigma 1.032
pullPhi
Std Dev 1.279
Constant 0.07449
Mean −0.003362
Sigma 1.031
pullPhi
Std Dev 1.279
Constant 0.07449
Mean −0.003311
Sigma 1.031
pullPhi
Std Dev 1.279
Constant 0.0745
Mean −0.003458
Sigma 1.031
pull of θ parameter
pullTheta
Std Dev 1.134
Constant 0.08225
Mean −0.004736
Sigma 0.9357
pullTheta
Std Dev 1.134
Constant 0.08225
Mean −0.004617
Sigma 0.9357
pullTheta
Std Dev 1.133
Constant 0.08225
Mean −0.004748
Sigma 0.9358
pullTheta
Std Dev 1.134
Constant 0.08226
Mean −0.0047
Sigma 0.9355
pull of dxy parameter
pullDxy
Std Dev 1.263
Constant 0.07779
Mean −0.001498
Sigma 0.9847
pullDxy
Std Dev 1.263
Constant 0.0778
Mean −0.001382
Sigma 0.9845
pullDxy
Std Dev 1.263
Constant 0.0778
Mean −0.001463
Sigma 0.9845
pullDxy
Std Dev 1.262
Constant 0.07782
Mean −0.001448
Sigma 0.9845
pull of dz parameter
pullDz
Std Dev 1.253
Constant 0.08051
Mean −0.001022
Sigma 0.9431
pullDz
Std Dev 1.253
Constant 0.08051
Mean −0.001152
Sigma 0.9431
pullDz
Std Dev 1.253
Constant 0.08051
Mean −0.001063
Sigma 0.9431
pullDz
Std Dev 1.255
Constant 0.08048
Mean −0.001085
Sigma 0.9433
Ratio