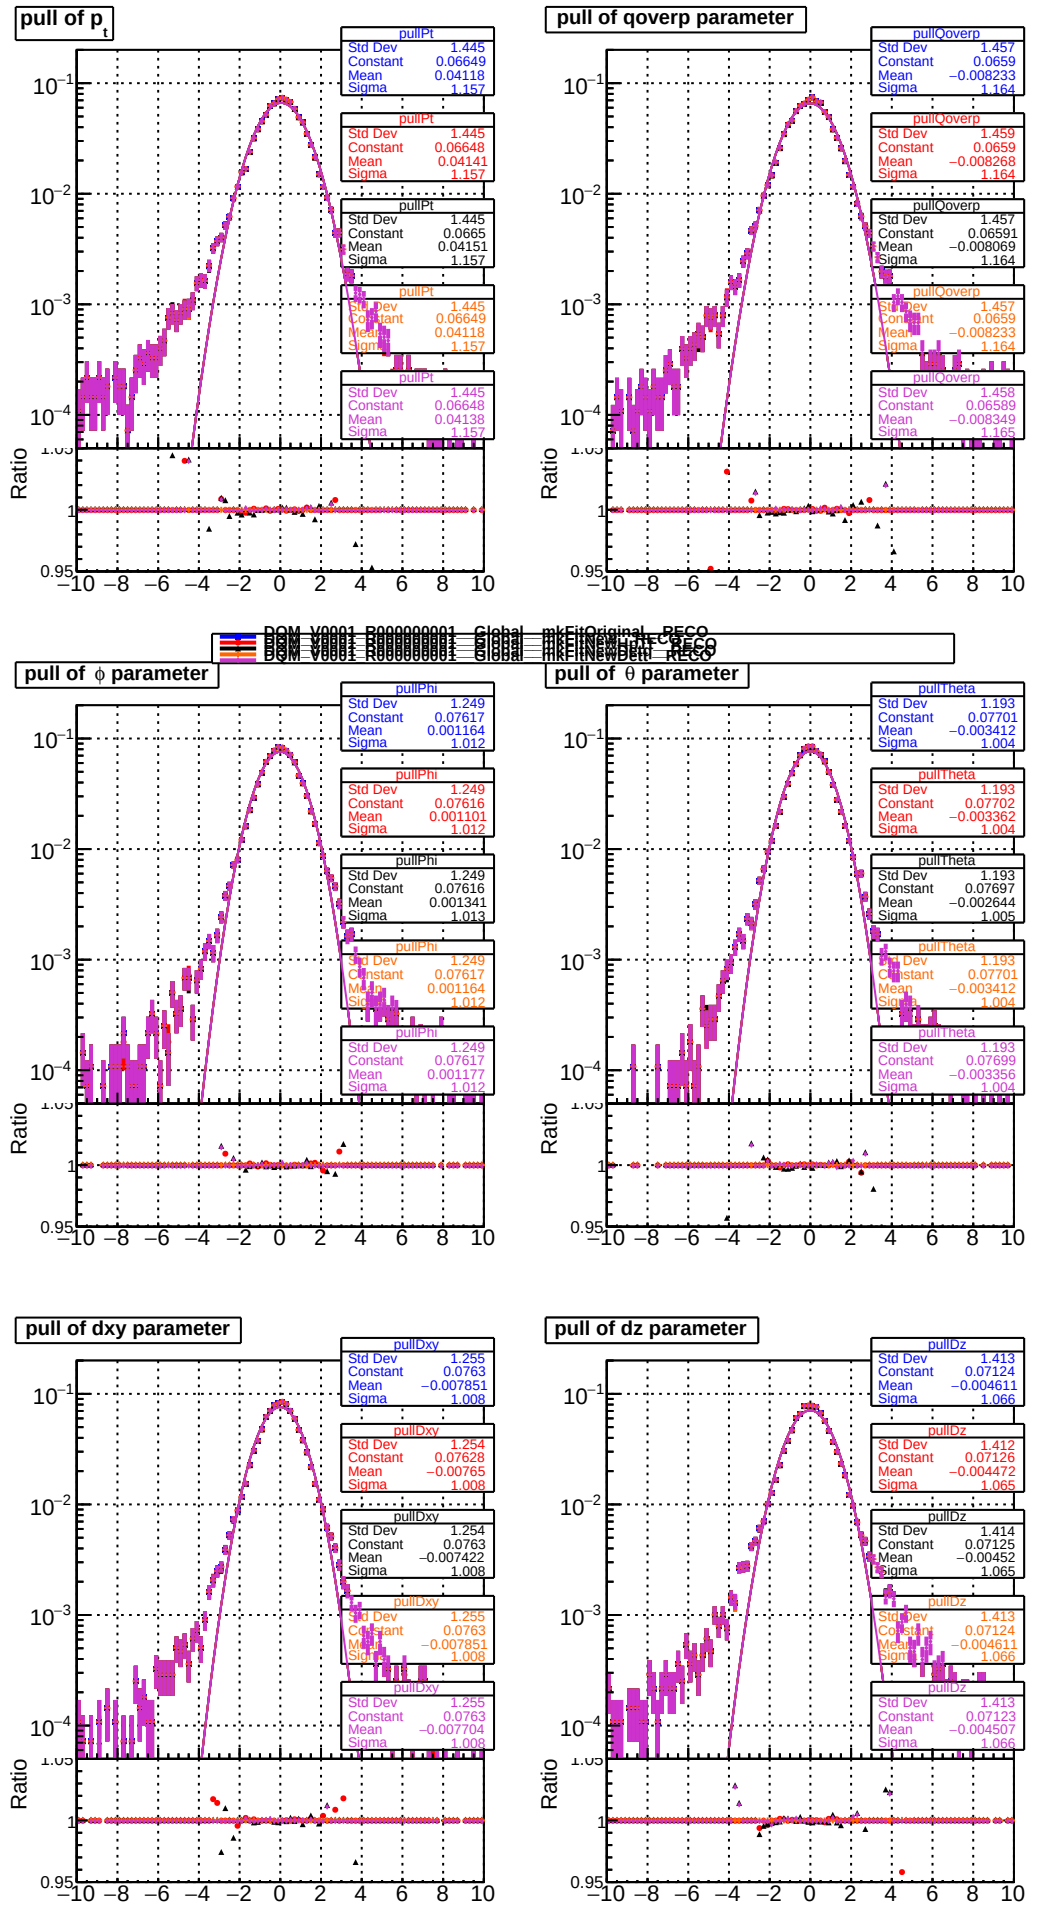
pull of p_t
pullPt
Std Dev 1.445
Constant 0.06649
Mean 0.04118
Sigma 1.157
pullPt
Std Dev 1.445
Constant 0.06648
Mean 0.04141
Sigma 1.157
pullPt
Std Dev 1.445
Constant 0.0665
Mean 0.04151
Sigma 1.157
pullPt
Std Dev 1.445
Constant 0.06649
Mean 0.04118
Sigma 1.157
pullPt
Std Dev 1.445
Constant 0.06648
Mean 0.04138
Sigma 1.157
pull of qoverp parameter
pullQoverp
Std Dev 1.457
Constant 0.0659
Mean −0.008233
Sigma 1.164
pullQoverp
Std Dev 1.459
Constant 0.0659
Mean −0.008268
Sigma 1.164
pullQoverp
Std Dev 1.457
Constant 0.06591
Mean −0.008069
Sigma 1.164
pullQoverp
Std Dev 1.457
Constant 0.0659
Mean −0.008233
Sigma 1.164
pullQoverp
Std Dev 1.458
Constant 0.06589
Mean −0.008349
Sigma 1.165
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBeff__RECO
DQM_V0001_R000000001__Global__mkFitNewBeff__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.249
Constant 0.07617
Mean 0.001164
Sigma 1.012
pullPhi
Std Dev 1.249
Constant 0.07616
Mean 0.001101
Sigma 1.012
pullPhi
Std Dev 1.249
Constant 0.07616
Mean 0.001341
Sigma 1.013
pullPhi
Std Dev 1.249
Constant 0.07617
Mean 0.001164
Sigma 1.012
pullPhi
Std Dev 1.249
Constant 0.07617
Mean 0.001177
Sigma 1.012
pull of θ parameter
pullTheta
Std Dev 1.193
Constant 0.07701
Mean −0.003412
Sigma 1.004
pullTheta
Std Dev 1.193
Constant 0.07702
Mean −0.003362
Sigma 1.004
pullTheta
Std Dev 1.193
Constant 0.07697
Mean −0.002644
Sigma 1.005
pullTheta
Std Dev 1.193
Constant 0.07701
Mean −0.003412
Sigma 1.004
pullTheta
Std Dev 1.193
Constant 0.07699
Mean −0.003356
Sigma 1.004
pull of dxy parameter
pullDxy
Std Dev 1.255
Constant 0.0763
Mean −0.007851
Sigma 1.008
pullDxy
Std Dev 1.254
Constant 0.07628
Mean −0.00765
Sigma 1.008
pullDxy
Std Dev 1.254
Constant 0.0763
Mean −0.007422
Sigma 1.008
pullDxy
Std Dev 1.255
Constant 0.0763
Mean −0.007851
Sigma 1.008
pullDxy
Std Dev 1.255
Constant 0.0763
Mean −0.007704
Sigma 1.008
pull of dz parameter
pullDz
Std Dev 1.413
Constant 0.07124
Mean −0.004611
Sigma 1.066
pullDz
Std Dev 1.412
Constant 0.07126
Mean −0.004472
Sigma 1.065
pullDz
Std Dev 1.414
Constant 0.07125
Mean −0.00452
Sigma 1.065
pullDz
Std Dev 1.413
Constant 0.07124
Mean −0.004611
Sigma 1.066
pullDz
Std Dev 1.413
Constant 0.07123
Mean −0.004507
Sigma 1.066
Ratio