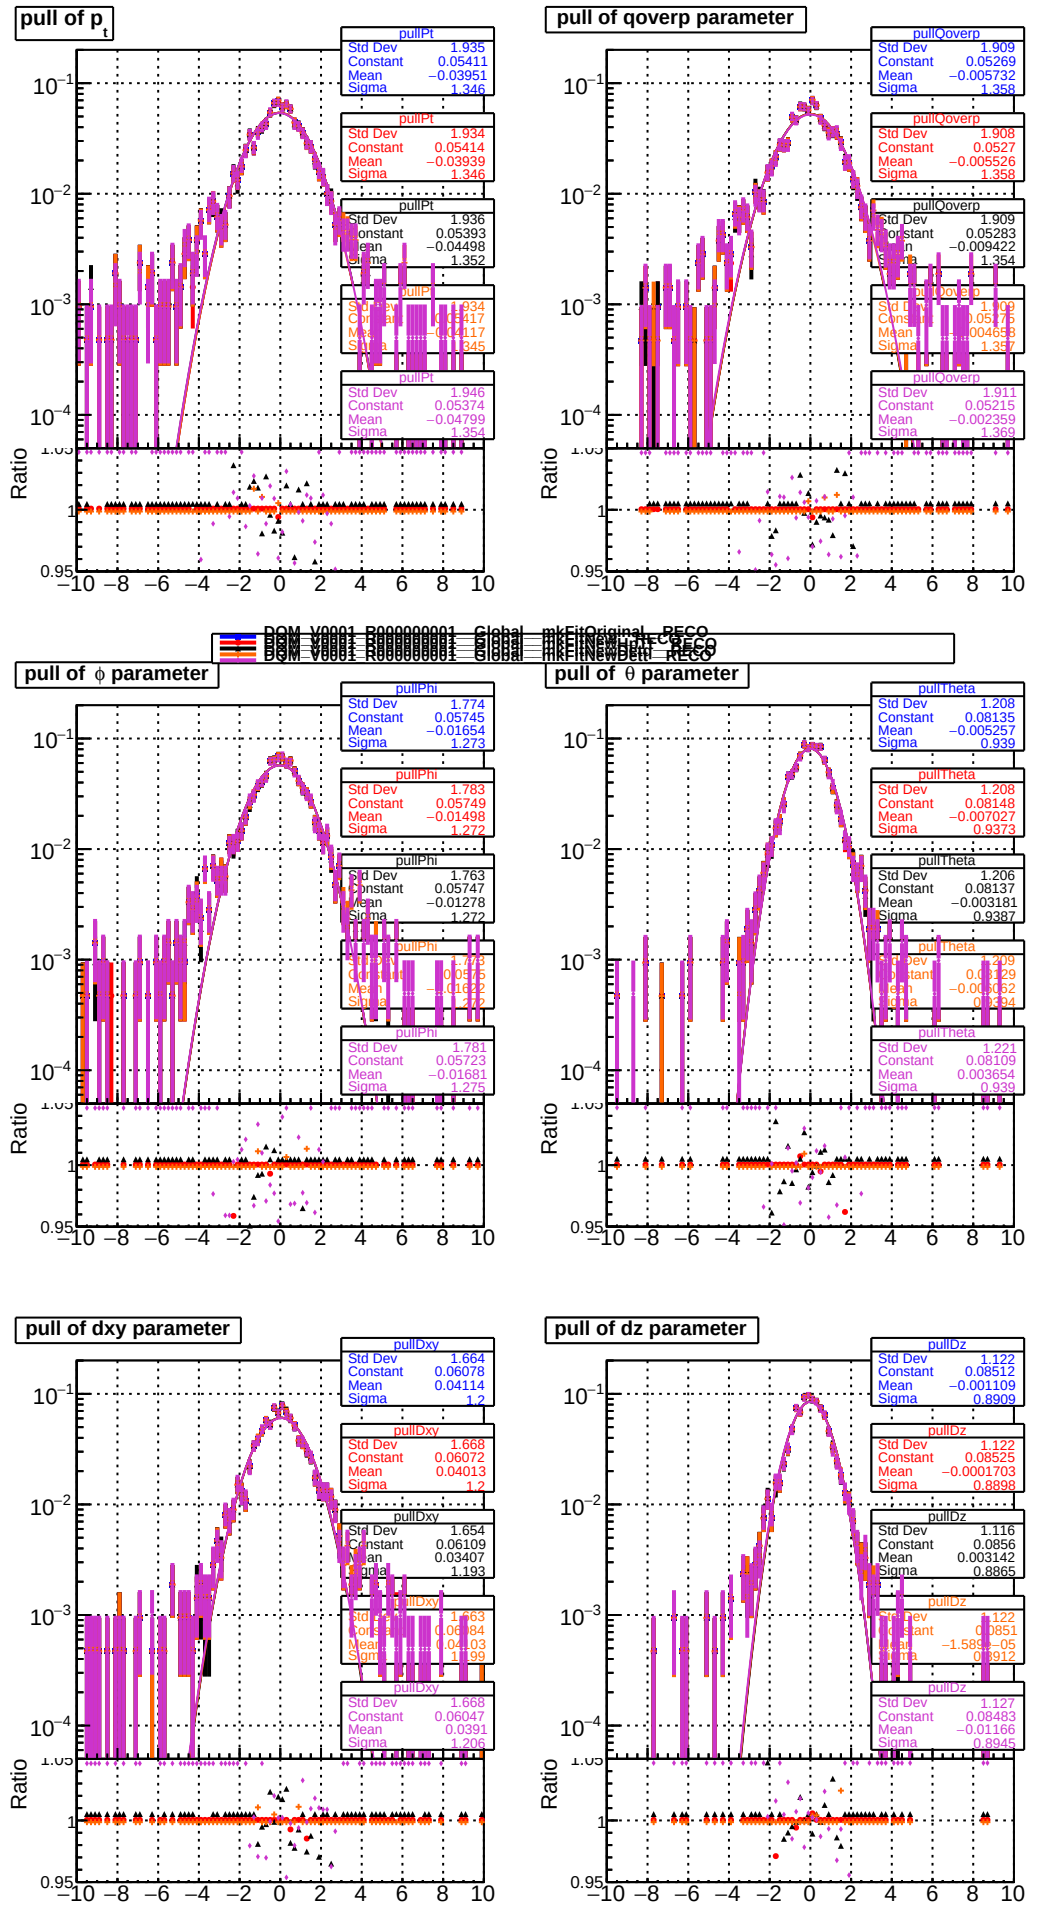
pull of p_t
pullPt
Std Dev 1.935
Constant 0.05411
Mean −0.03951
Sigma 1.346
pullPt
Std Dev 1.934
Constant 0.05414
Mean −0.03939
Sigma 1.346
pullPt
Std Dev 1.936
Constant 0.05393
Mean −0.04498
Sigma 1.352
pullPt
Std Dev 1.946
Constant 0.05374
Mean −0.04799
Sigma 1.354
pull of qoverp parameter
pullQoverp
Std Dev 1.909
Constant 0.05269
Mean −0.005732
Sigma 1.358
pullQoverp
Std Dev 1.908
Constant 0.0527
Mean −0.005526
Sigma 1.358
pullQoverp
Std Dev 1.909
Constant 0.05283
Mean −0.009422
Sigma 1.354
pullQoverp
Std Dev 1.911
Constant 0.05215
Mean −0.002359
Sigma 1.369
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.774
Constant 0.05745
Mean −0.01654
Sigma 1.273
pullPhi
Std Dev 1.783
Constant 0.05749
Mean −0.01498
Sigma 1.272
pullPhi
Std Dev 1.763
Constant 0.05747
Mean −0.01278
Sigma 1.272
pullPhi
Std Dev 1.781
Constant 0.05723
Mean −0.01681
Sigma 1.275
pull of θ parameter
pullTheta
Std Dev 1.208
Constant 0.08135
Mean −0.005257
Sigma 0.939
pullTheta
Std Dev 1.208
Constant 0.08148
Mean −0.007027
Sigma 0.9373
pullTheta
Std Dev 1.206
Constant 0.08137
Mean −0.003181
Sigma 0.9387
pullTheta
Std Dev 1.221
Constant 0.08109
Mean 0.003654
Sigma 0.939
pull of dxy parameter
pullDxy
Std Dev 1.664
Constant 0.06078
Mean 0.04114
Sigma 1.2
pullDxy
Std Dev 1.668
Constant 0.06072
Mean 0.04013
Sigma 1.2
pullDxy
Std Dev 1.654
Constant 0.06109
Mean 0.03407
Sigma 1.193
pullDxy
Std Dev 1.668
Constant 0.06047
Mean 0.0391
Sigma 1.206
pull of dz parameter
pullDz
Std Dev 1.122
Constant 0.08512
Mean −0.001109
Sigma 0.8909
pullDz
Std Dev 1.122
Constant 0.08525
Mean −0.0001703
Sigma 0.8898
pullDz
Std Dev 1.116
Constant 0.0856
Mean 0.003142
Sigma 0.8865
pullDz
Std Dev 1.127
Constant 0.08483
Mean −0.01166
Sigma 0.8945
Ratio