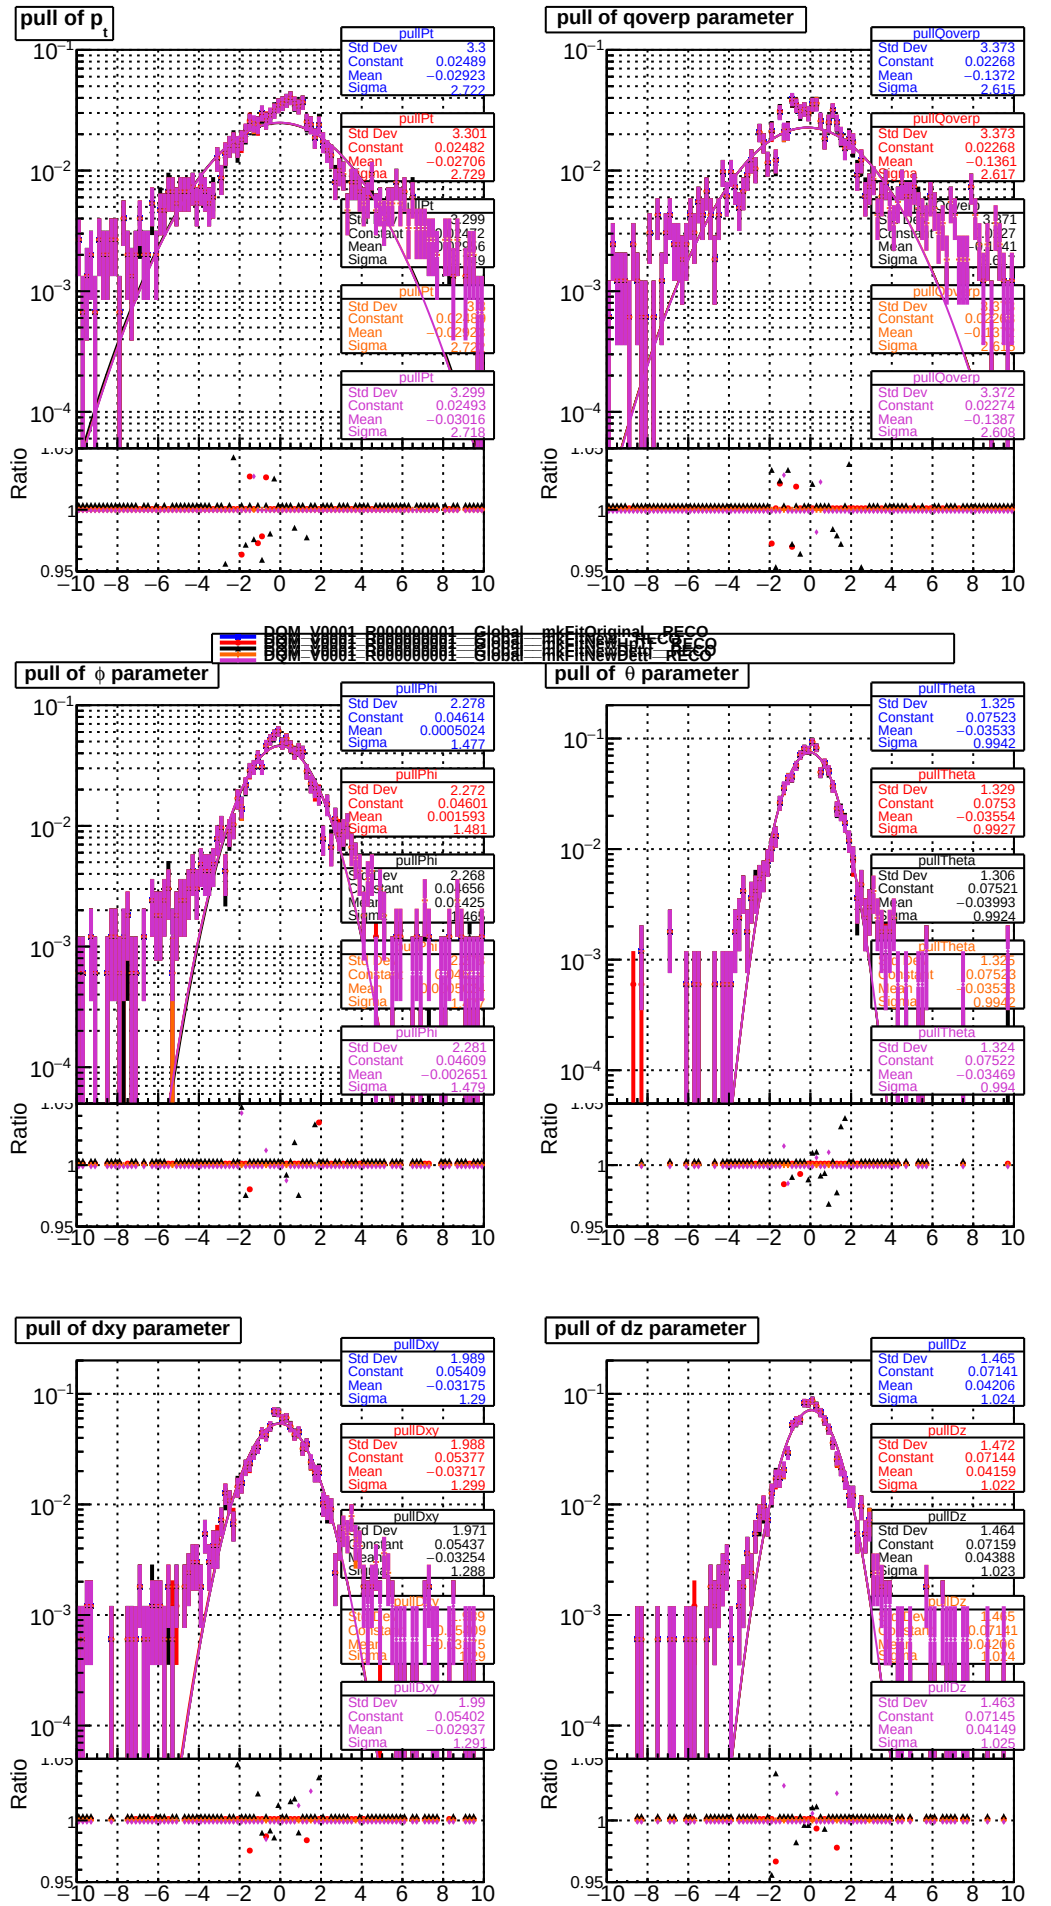
pull of p_t
pullPt
Std Dev 3.3
Constant 0.02489
Mean −0.02923
Sigma 2.722
pullPt
Std Dev 3.301
Constant 0.02482
Mean −0.02706
Sigma 2.729
pullPt
Std Dev 3.299
Constant 0.02493
Mean −0.03016
Sigma 2.718
pull of qoverp parameter
pullQoverp
Std Dev 3.373
Constant 0.02268
Mean −0.1372
Sigma 2.615
pullQoverp
Std Dev 3.373
Constant 0.02268
Mean −0.1361
Sigma 2.617
pullQoverp
Std Dev 3.372
Constant 0.02274
Mean −0.1387
Sigma 2.608
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBeff__RECO
DQM_V0001_R000000001__Global__mkFitNewBeff__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.278
Constant 0.04614
Mean 0.0005024
Sigma 1.477
pullPhi
Std Dev 2.272
Constant 0.04601
Mean 0.001593
Sigma 1.481
pullPhi
Std Dev 2.281
Constant 0.04609
Mean −0.002651
Sigma 1.479
pull of θ parameter
pullTheta
Std Dev 1.325
Constant 0.07523
Mean −0.03533
Sigma 0.9942
pullTheta
Std Dev 1.329
Constant 0.0753
Mean −0.03554
Sigma 0.9927
pullTheta
Std Dev 1.324
Constant 0.07522
Mean −0.03469
Sigma 0.994
pull of dxy parameter
pullDxy
Std Dev 1.989
Constant 0.05409
Mean −0.03175
Sigma 1.29
pullDxy
Std Dev 1.988
Constant 0.05377
Mean −0.03717
Sigma 1.299
pullDxy
Std Dev 1.99
Constant 0.05402
Mean −0.02937
Sigma 1.291
pull of dz parameter
pullDz
Std Dev 1.465
Constant 0.07141
Mean 0.04206
Sigma 1.024
pullDz
Std Dev 1.472
Constant 0.07144
Mean 0.04159
Sigma 1.022
pullDz
Std Dev 1.463
Constant 0.07145
Mean 0.04149
Sigma 1.025
Ratio