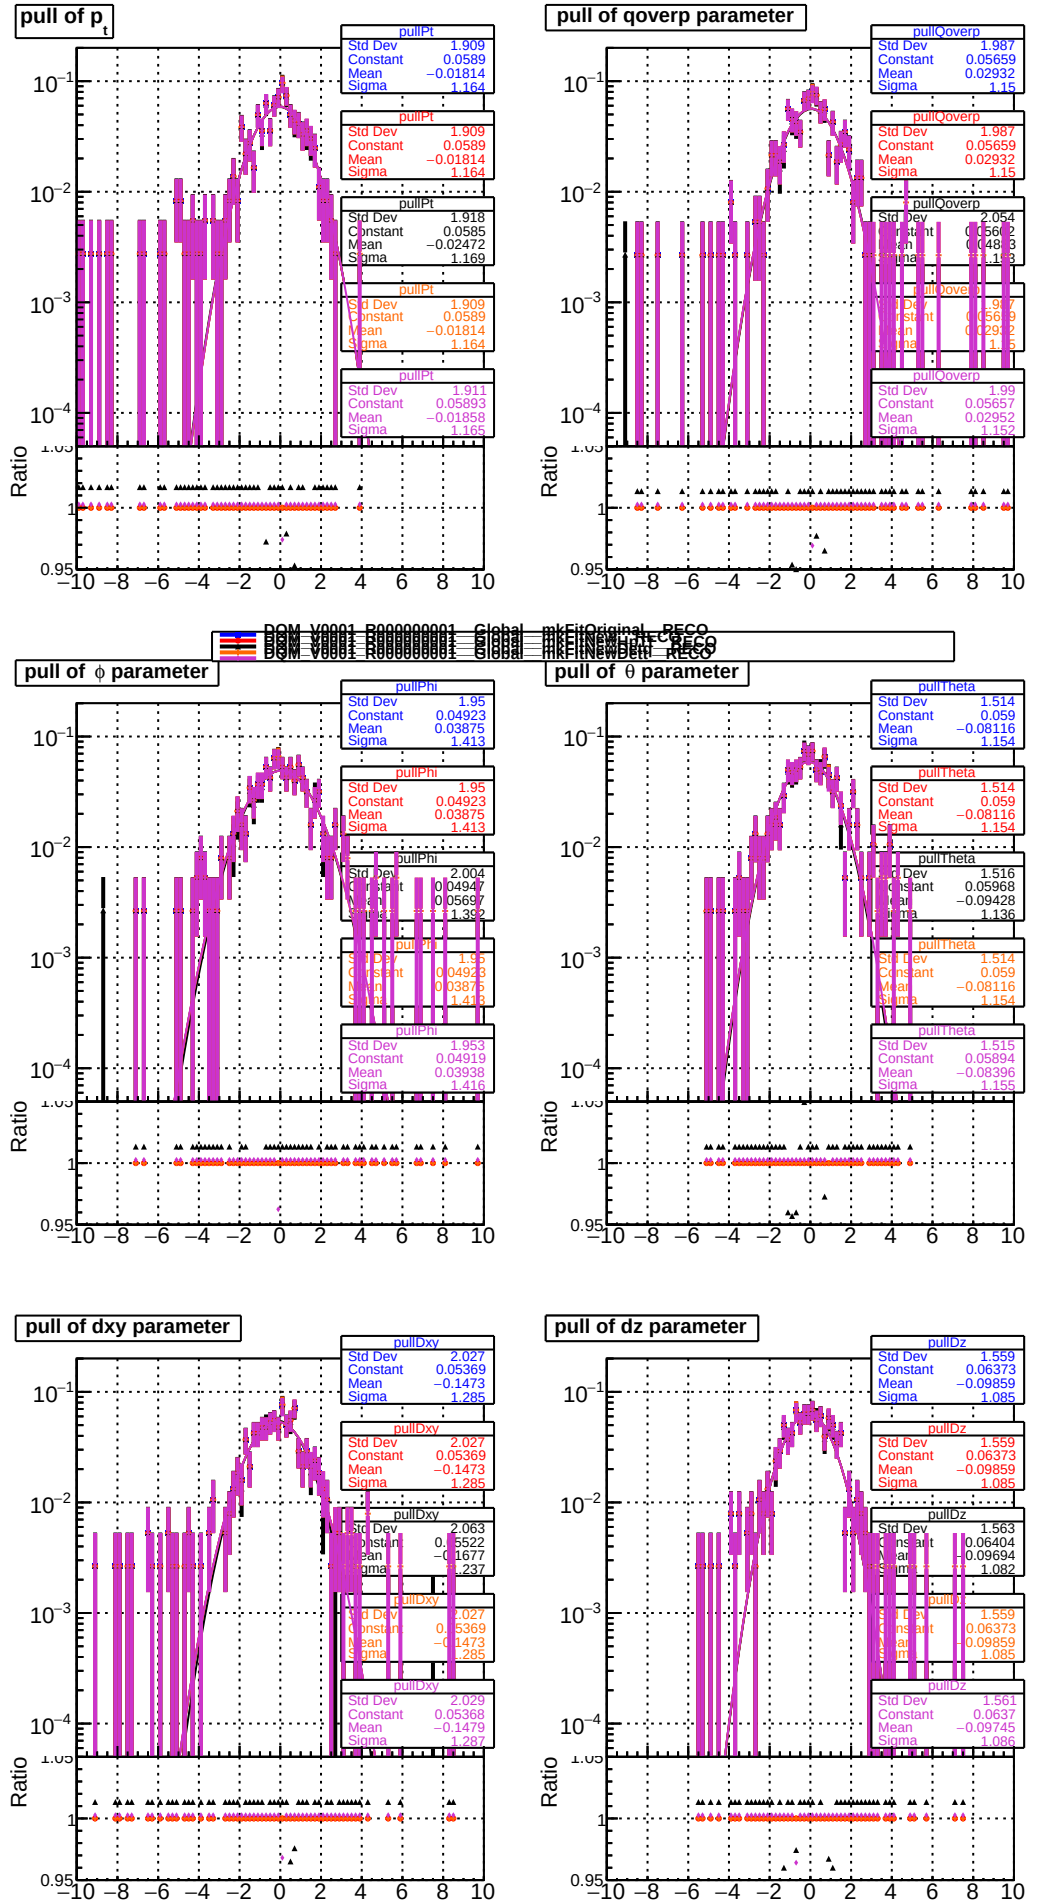
pull of p_t
pullPt
Std Dev 1.909
Constant 0.0589
Mean −0.01814
Sigma 1.164
pullPt
Std Dev 1.909
Constant 0.0589
Mean −0.01814
Sigma 1.164
pullPt
Std Dev 1.918
Constant 0.0585
Mean −0.02472
Sigma 1.169
pullPt
Std Dev 1.909
Constant 0.0589
Mean −0.01814
Sigma 1.164
pullPt
Std Dev 1.911
Constant 0.05893
Mean −0.01858
Sigma 1.165
pull of qoverp parameter
pullQoverp
Std Dev 1.987
Constant 0.05659
Mean 0.02932
Sigma 1.15
pullQoverp
Std Dev 1.987
Constant 0.05659
Mean 0.02932
Sigma 1.15
pullQoverp
Std Dev 2.054
pullQoverp
Std Dev 1.99
Constant 0.05657
Mean 0.02952
Sigma 1.152
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.95
Constant 0.04923
Mean 0.03875
Sigma 1.413
pullPhi
Std Dev 1.95
Constant 0.04923
Mean 0.03875
Sigma 1.413
pullPhi
Std Dev 2.004
pullPhi
Std Dev 1.953
Constant 0.04919
Mean 0.03938
Sigma 1.416
pull of θ parameter
pullTheta
Std Dev 1.514
Constant 0.059
Mean −0.08116
Sigma 1.154
pullTheta
Std Dev 1.514
Constant 0.059
Mean −0.08116
Sigma 1.154
pullTheta
Std Dev 1.516
Constant 0.05968
Mean −0.09428
Sigma 1.136
pullTheta
Std Dev 1.515
Constant 0.05894
Mean −0.08396
Sigma 1.155
pull of dxy parameter
pullDxy
Std Dev 2.027
Constant 0.05369
Mean −0.1473
Sigma 1.285
pullDxy
Std Dev 2.027
Constant 0.05369
Mean −0.1473
Sigma 1.285
pullDxy
Std Dev 2.063
pullDxy
Std Dev 2.029
Constant 0.05368
Mean −0.1479
Sigma 1.287
pull of dz parameter
pullDz
Std Dev 1.559
Constant 0.06373
Mean −0.09859
Sigma 1.085
pullDz
Std Dev 1.559
Constant 0.06373
Mean −0.09859
Sigma 1.085
pullDz
Std Dev 1.563
Constant 0.06404
Mean −0.09694
Sigma 1.082
pullDz
Std Dev 1.561
Constant 0.0637
Mean −0.09745
Sigma 1.086
Ratio