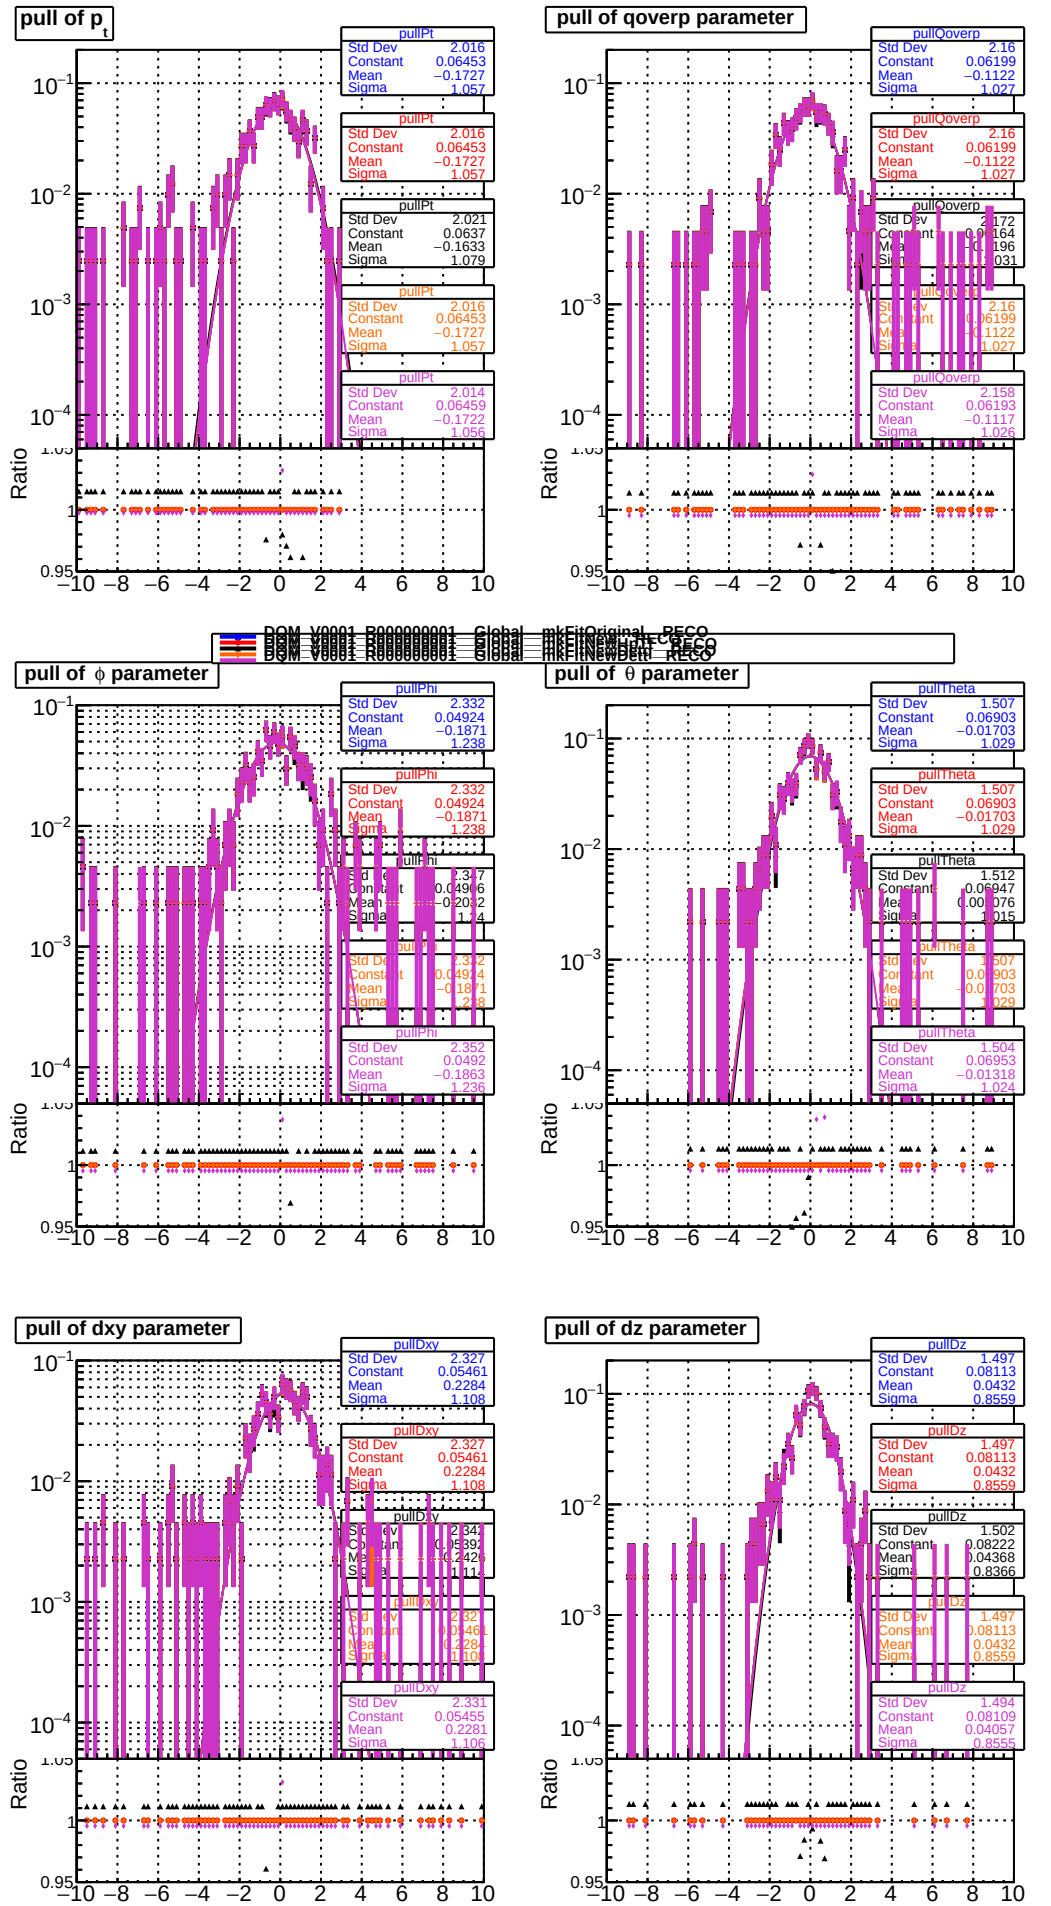
pull of p_t
pullPt
Std Dev 2.016
Constant 0.06453
Mean −0.1727
Sigma 1.057
pullPt
Std Dev 2.016
Constant 0.06453
Mean −0.1727
Sigma 1.057
pullPt
Std Dev 2.021
Constant 0.0637
Mean −0.1633
Sigma 1.079
pullPt
Std Dev 2.016
Constant 0.06453
Mean −0.1727
Sigma 1.057
pullPt
Std Dev 2.014
Constant 0.06459
Mean −0.1722
Sigma 1.056
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.16
Constant 0.06199
Mean −0.1122
Sigma 1.027
pullQoverp
Std Dev 2.16
Constant 0.06199
Mean −0.1122
Sigma 1.027
pullQoverp
Std Dev 2.172
pullQoverp
Std Dev 2.16
Constant 0.06199
Mean −0.1122
Sigma 1.027
pullQoverp
Std Dev 2.158
Constant 0.06193
Mean −0.1117
Sigma 1.026
Ratio
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.332
Constant 0.04924
Mean −0.1871
Sigma 1.238
pullPhi
Std Dev 2.332
Constant 0.04924
Mean −0.1871
Sigma 1.238
pullPhi
pullPhi
Std Dev 2.352
Constant 0.0492
Mean −0.1863
Sigma 1.236
Ratio
pull of θ parameter
pullTheta
Std Dev 1.507
Constant 0.06903
Mean −0.01703
Sigma 1.029
pullTheta
Std Dev 1.507
Constant 0.06903
Mean −0.01703
Sigma 1.029
pullTheta
Std Dev 1.512
pullTheta
pullTheta
Std Dev 1.504
Constant 0.06953
Mean −0.01318
Sigma 1.024
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.327
Constant 0.05461
Mean 0.2284
Sigma 1.108
pullDxy
Std Dev 2.327
Constant 0.05461
Mean 0.2284
Sigma 1.108
pullDxy
pullDxy
pullDxy
Std Dev 2.331
Constant 0.05455
Mean 0.2281
Sigma 1.106
Ratio
pull of dz parameter
pullDz
Std Dev 1.497
Constant 0.08113
Mean 0.0432
Sigma 0.8559
pullDz
Std Dev 1.497
Constant 0.08113
Mean 0.0432
Sigma 0.8559
pullDz
Std Dev 1.502
Constant 0.08222
Mean 0.04368
pullDz
pullDz
Std Dev 1.494
Constant 0.08109
Mean 0.04057
Sigma 0.8555
Ratio