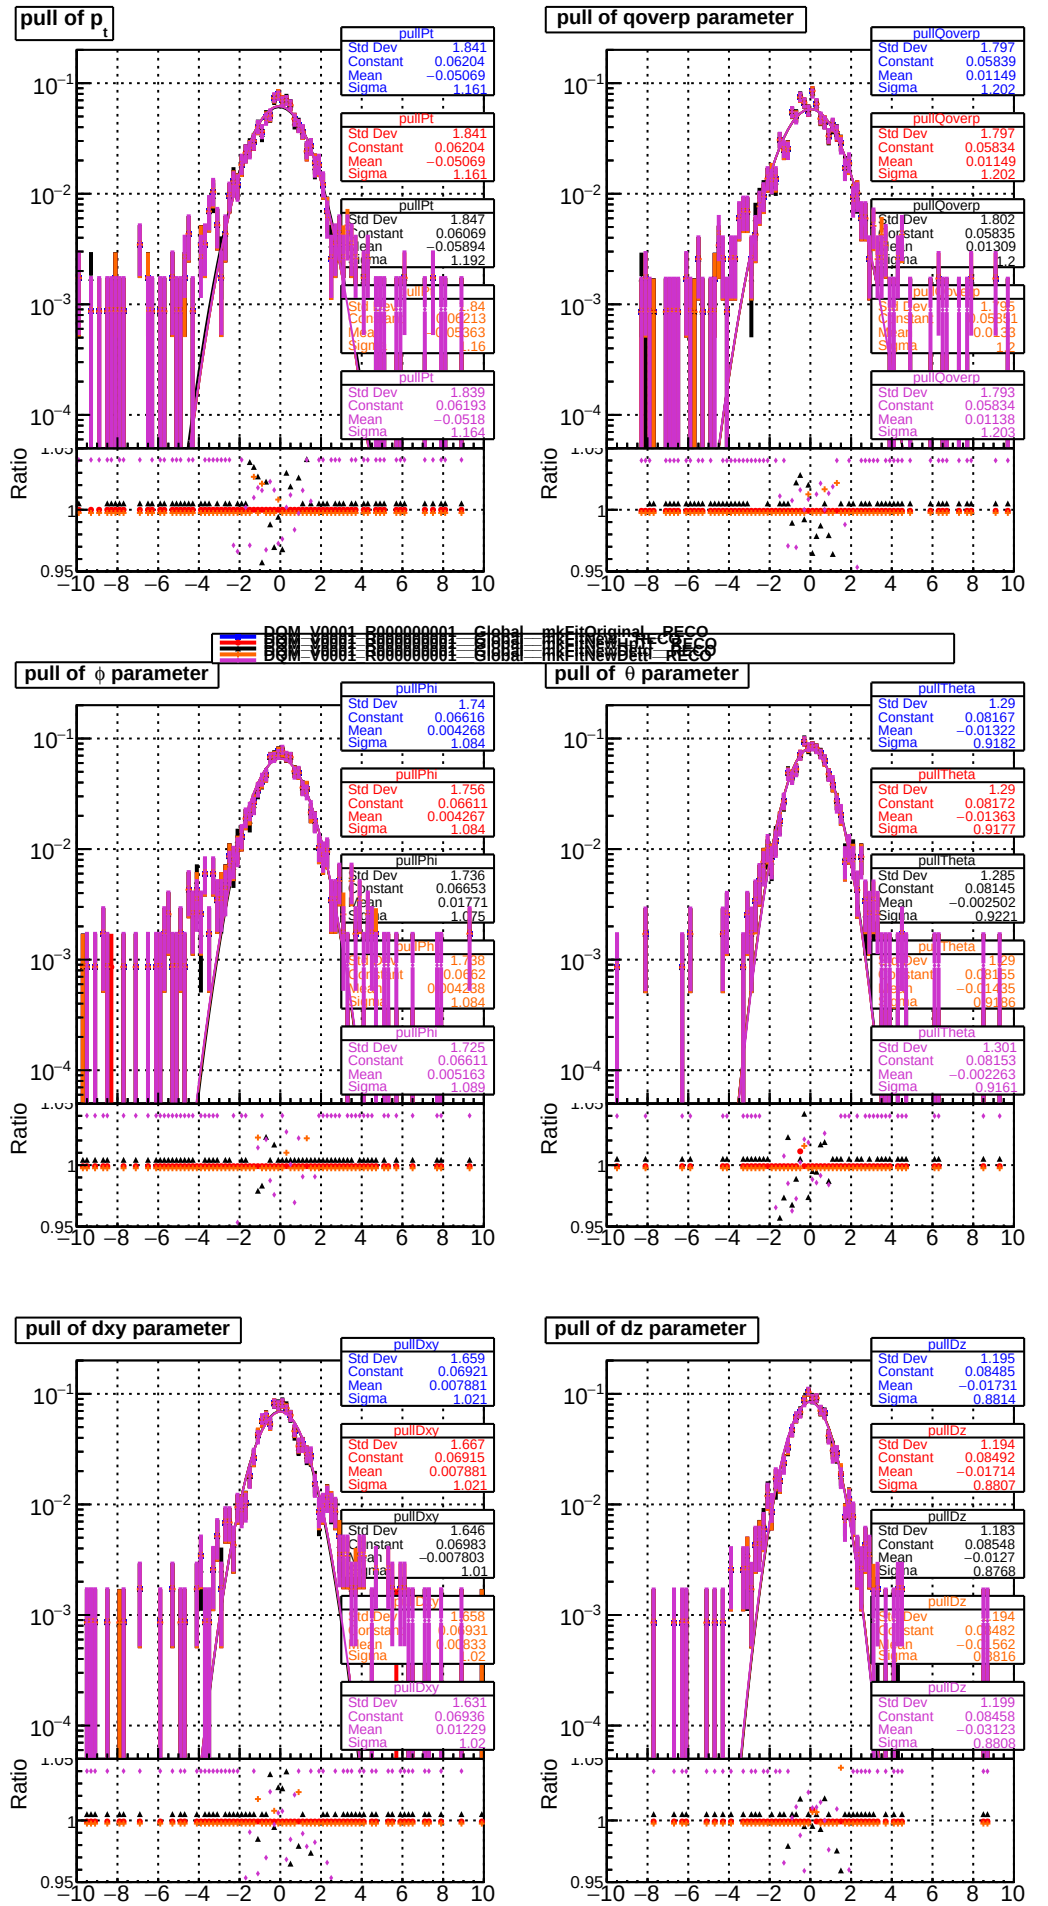
pull of p_t
pullPt
Std Dev 1.841
Constant 0.06204
Mean −0.05069
Sigma 1.161
pullPt
Std Dev 1.841
Constant 0.06204
Mean −0.05069
Sigma 1.161
pullPt
Std Dev 1.847
Constant 0.06069
Mean −0.05894
Sigma 1.192
pullPt
Std Dev 1.839
Constant 0.06193
Mean −0.0518
Sigma 1.164
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.797
Constant 0.05839
Mean 0.01149
Sigma 1.202
pullQoverp
Std Dev 1.797
Constant 0.05834
Mean 0.01149
Sigma 1.202
pullQoverp
Std Dev 1.802
Constant 0.05835
Mean 0.01309
pullQoverp
Std Dev 1.793
Constant 0.05834
Mean 0.01138
Sigma 1.203
Ratio
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.74
Constant 0.06616
Mean 0.004268
Sigma 1.084
pullPhi
Std Dev 1.756
Constant 0.06611
Mean 0.004267
Sigma 1.084
pullPhi
Std Dev 1.736
Constant 0.06653
Mean 0.01771
pullPhi
Std Dev 1.725
Constant 0.06611
Mean 0.005163
Sigma 1.089
Ratio
pull of θ parameter
pullTheta
Std Dev 1.29
Constant 0.08167
Mean −0.01322
Sigma 0.9182
pullTheta
Std Dev 1.29
Constant 0.08172
Mean −0.01363
Sigma 0.9177
pullTheta
Std Dev 1.285
Constant 0.08145
Mean −0.002502
Sigma 0.9221
pullTheta
Std Dev 1.301
Constant 0.08153
Mean −0.002263
Sigma 0.9161
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.659
Constant 0.06921
Mean 0.007881
Sigma 1.021
pullDxy
Std Dev 1.667
Constant 0.06915
Mean 0.007881
Sigma 1.021
pullDxy
Std Dev 1.646
Constant 0.06983
Mean −0.007803
pullDxy
Std Dev 1.631
Constant 0.06936
Mean 0.01229
Sigma 1.02
Ratio
pull of dz parameter
pullDz
Std Dev 1.195
Constant 0.08485
Mean −0.01731
Sigma 0.8814
pullDz
Std Dev 1.194
Constant 0.08492
Mean −0.01714
Sigma 0.8807
pullDz
Std Dev 1.183
Constant 0.08548
Mean −0.0127
pullDz
Std Dev 1.199
Constant 0.08458
Mean −0.03123
Sigma 0.8808
Ratio