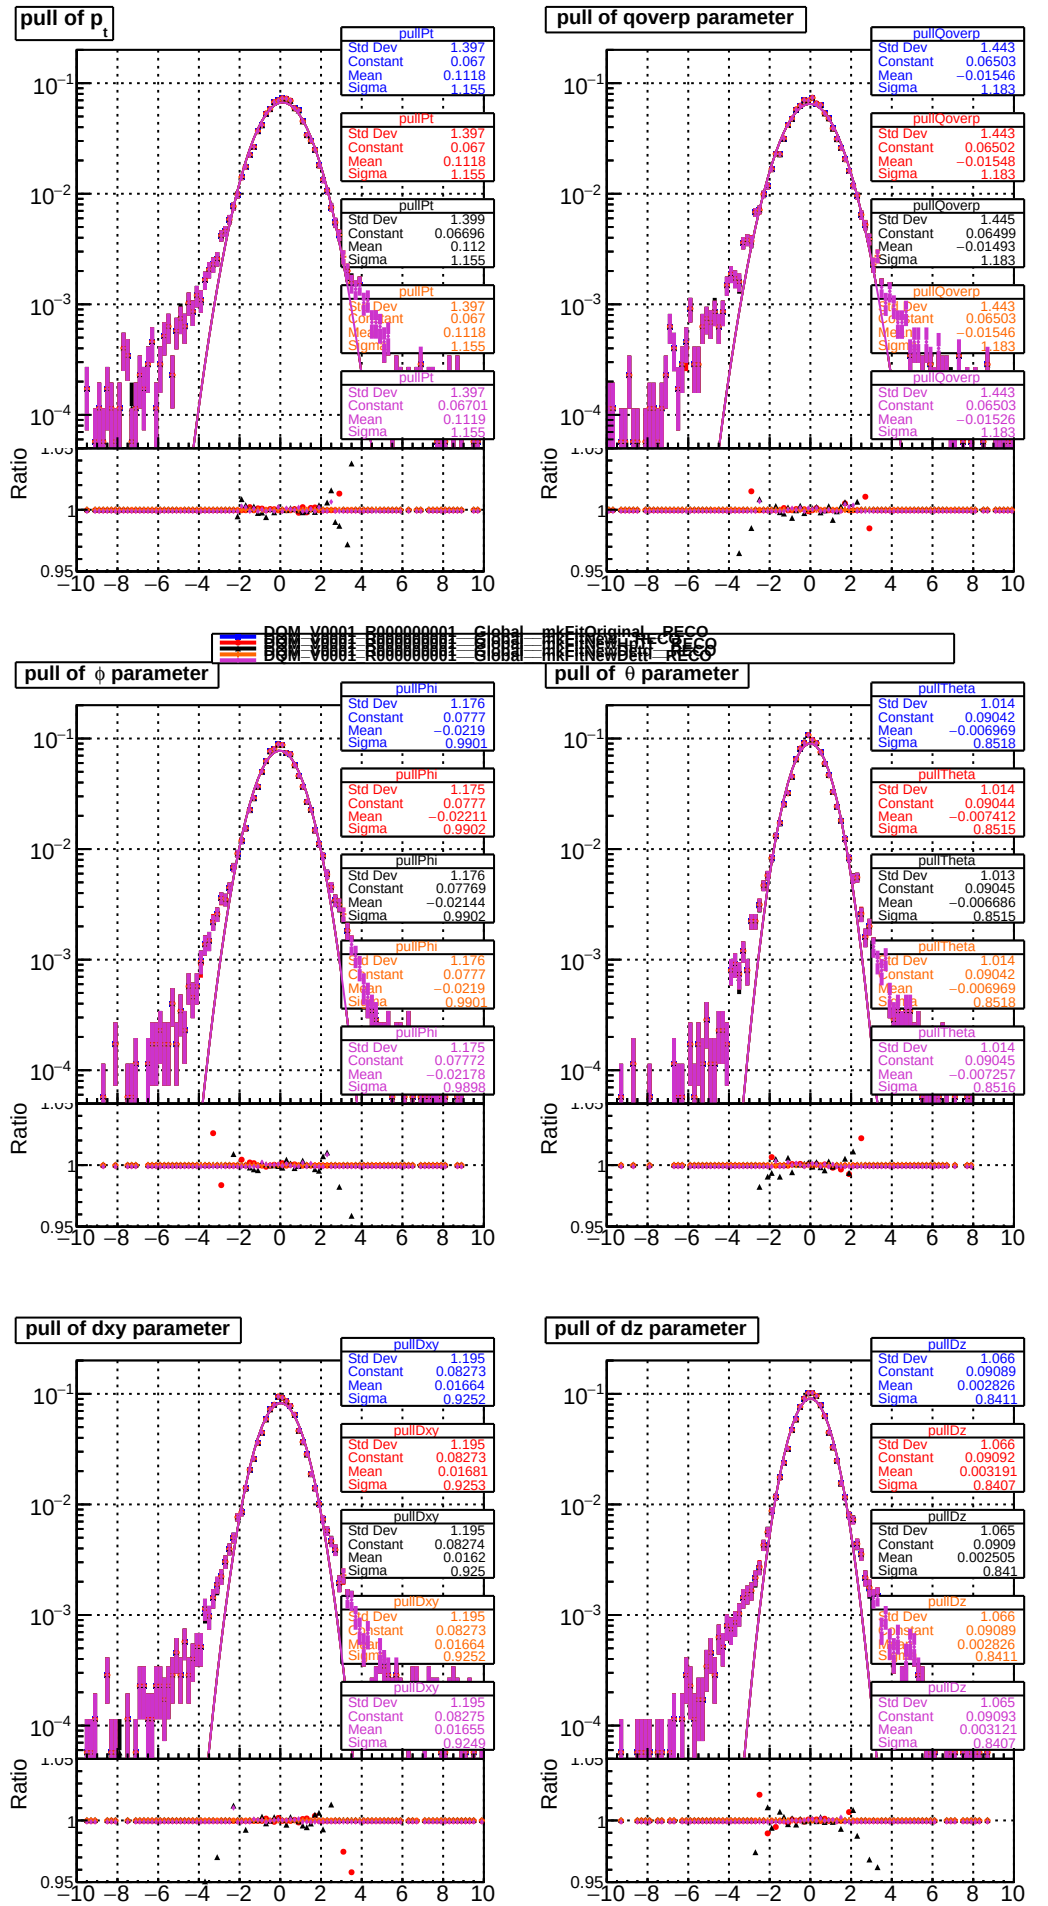
pull of p_t
pullPt
Std Dev 1.397
Constant 0.067
Mean 0.1118
Sigma 1.155
pullPt
Std Dev 1.397
Constant 0.067
Mean 0.1118
Sigma 1.155
pullPt
Std Dev 1.399
Constant 0.06696
Mean 0.112
Sigma 1.155
pullPt
Std Dev 1.397
Constant 0.067
Mean 0.1118
Sigma 1.155
pullPt
Std Dev 1.397
Constant 0.06701
Mean 0.1119
Sigma 1.155
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.443
Constant 0.06503
Mean −0.01546
Sigma 1.183
pullQoverp
Std Dev 1.443
Constant 0.06502
Mean −0.01548
Sigma 1.183
pullQoverp
Std Dev 1.445
Constant 0.06499
Mean −0.01493
Sigma 1.183
pullQoverp
Std Dev 1.443
Constant 0.06503
Mean −0.01546
Sigma 1.183
pullQoverp
Std Dev 1.443
Constant 0.06503
Mean −0.01526
Sigma 1.183
Ratio
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.176
Constant 0.0777
Mean −0.0219
Sigma 0.9901
pullPhi
Std Dev 1.175
Constant 0.0777
Mean −0.02211
Sigma 0.9902
pullPhi
Std Dev 1.176
Constant 0.07769
Mean −0.02144
Sigma 0.9902
pullPhi
Std Dev 1.176
Constant 0.0777
Mean −0.0219
Sigma 0.9901
pullPhi
Std Dev 1.175
Constant 0.07772
Mean −0.02178
Sigma 0.9898
Ratio
pull of θ parameter
pullTheta
Std Dev 1.014
Constant 0.09042
Mean −0.006969
Sigma 0.8518
pullTheta
Std Dev 1.014
Constant 0.09044
Mean −0.007412
Sigma 0.8515
pullTheta
Std Dev 1.013
Constant 0.09045
Mean −0.006686
Sigma 0.8515
pullTheta
Std Dev 1.014
Constant 0.09042
Mean −0.006969
Sigma 0.8518
pullTheta
Std Dev 1.014
Constant 0.09045
Mean −0.007257
Sigma 0.8516
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.195
Constant 0.08273
Mean 0.01664
Sigma 0.9252
pullDxy
Std Dev 1.195
Constant 0.08273
Mean 0.01681
Sigma 0.9253
pullDxy
Std Dev 1.195
Constant 0.08274
Mean 0.0162
Sigma 0.925
pullDxy
Std Dev 1.195
Constant 0.08273
Mean 0.01664
Sigma 0.9252
pullDxy
Std Dev 1.195
Constant 0.08275
Mean 0.01655
Sigma 0.9249
Ratio
pull of dz parameter
pullDz
Std Dev 1.066
Constant 0.09089
Mean 0.002826
Sigma 0.8411
pullDz
Std Dev 1.066
Constant 0.09092
Mean 0.003191
Sigma 0.8407
pullDz
Std Dev 1.065
Constant 0.0909
Mean 0.002505
Sigma 0.841
pullDz
Std Dev 1.066
Constant 0.09089
Mean 0.002826
Sigma 0.8411
pullDz
Std Dev 1.065
Constant 0.09093
Mean 0.003121
Sigma 0.8407
Ratio