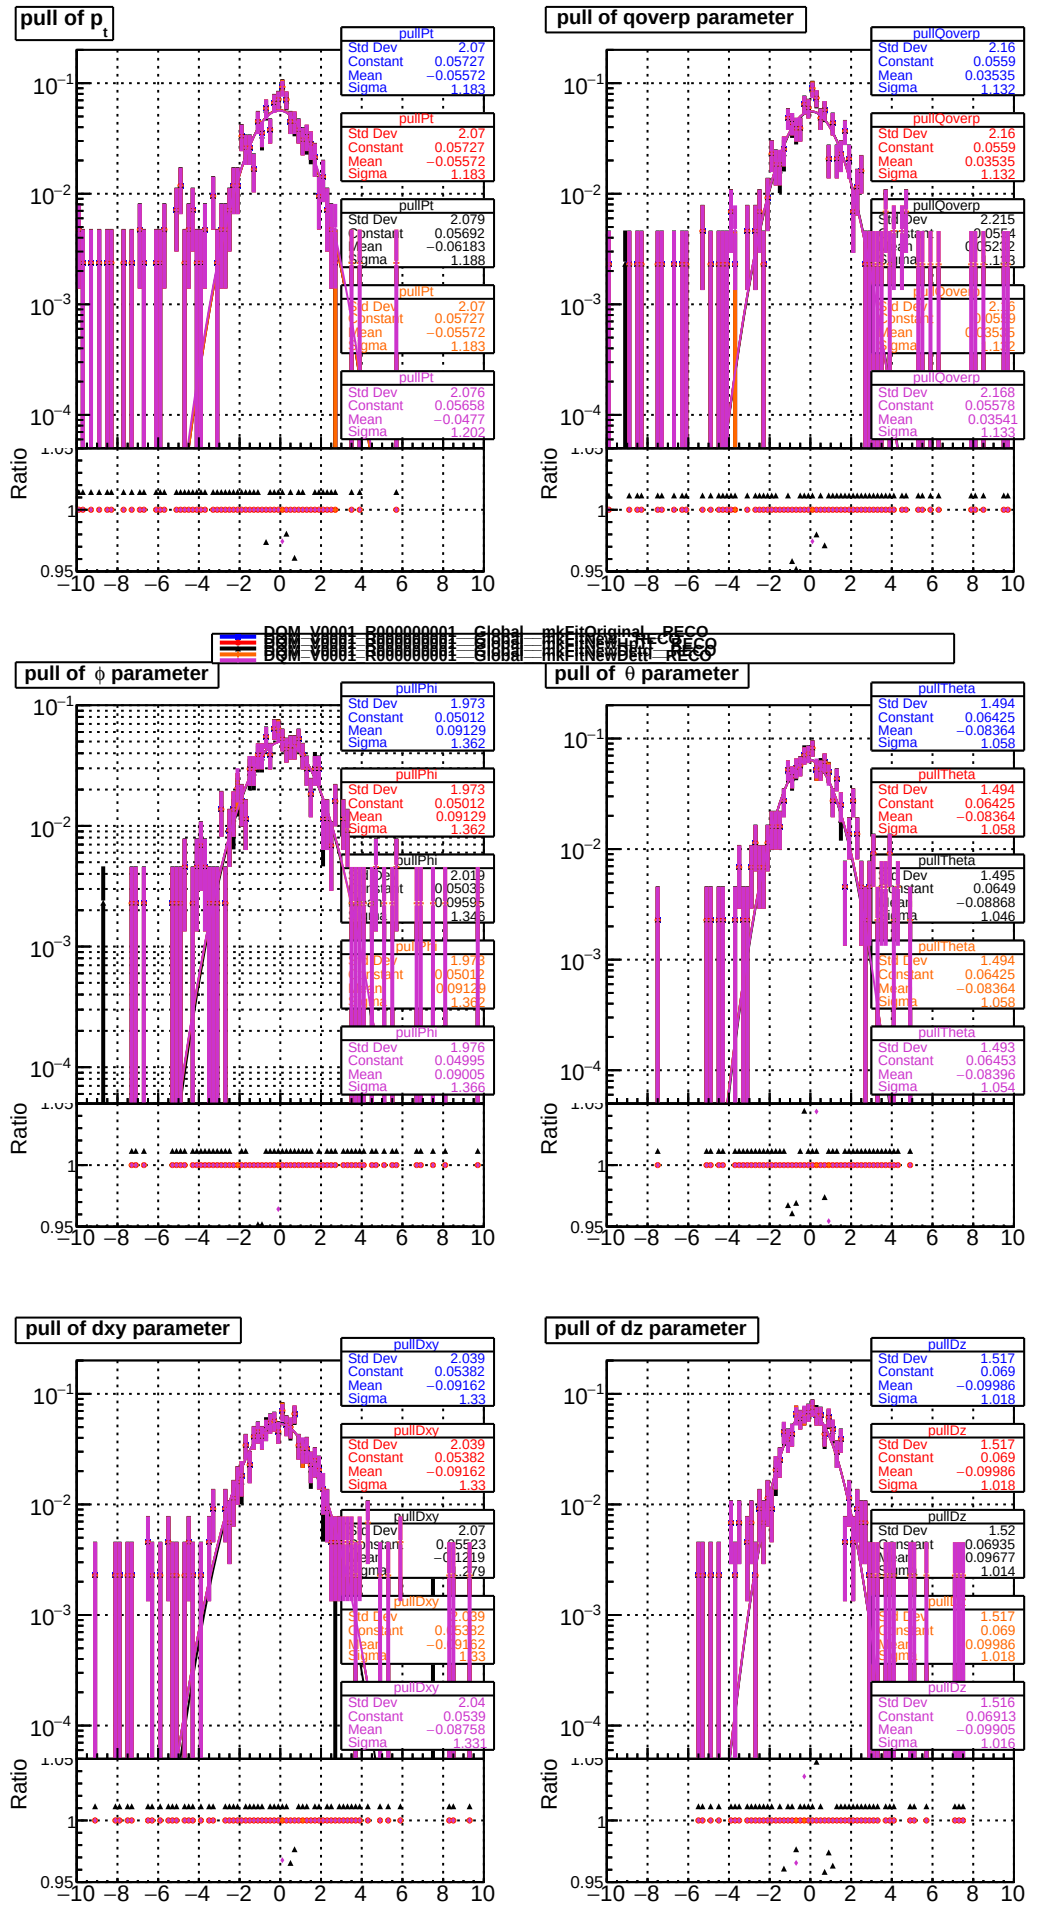
pull of p_t
pullPt
Std Dev 2.07
Constant 0.05727
Mean −0.05572
Sigma 1.183
pullPt
Std Dev 2.07
Constant 0.05727
Mean −0.05572
Sigma 1.183
pullPt
Std Dev 2.079
Constant 0.05692
Mean −0.06183
Sigma 1.188
pullPt
Std Dev 2.07
Constant 0.05727
Mean −0.05572
Sigma 1.183
pullPt
Std Dev 2.076
Constant 0.05658
Mean −0.0477
Sigma 1.202
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.16
Constant 0.0559
Mean 0.03535
Sigma 1.132
pullQoverp
Std Dev 2.16
Constant 0.0559
Mean 0.03535
Sigma 1.132
pullQoverp
Std Dev 2.215
pullQoverp
Std Dev 2.168
Constant 0.05578
Mean 0.03541
Sigma 1.133
Ratio
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.973
Constant 0.05012
Mean 0.09129
Sigma 1.362
pullPhi
Std Dev 1.973
Constant 0.05012
Mean 0.09129
Sigma 1.362
pullPhi
Std Dev 2.019
Constant 0.05036
Mean 0.09595
Sigma 1.346
pullPhi
Std Dev 1.976
Constant 0.04995
Mean 0.09005
Sigma 1.366
Ratio
pull of θ parameter
pullTheta
Std Dev 1.494
Constant 0.06425
Mean −0.08364
Sigma 1.058
pullTheta
Std Dev 1.494
Constant 0.06425
Mean −0.08364
Sigma 1.058
pullTheta
Std Dev 1.495
Constant 0.0649
Mean −0.08868
Sigma 1.046
pullTheta
Std Dev 1.493
Constant 0.06453
Mean −0.08396
Sigma 1.054
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.039
Constant 0.05382
Mean −0.09162
Sigma 1.33
pullDxy
Std Dev 2.039
Constant 0.05382
Mean −0.09162
Sigma 1.33
pullDxy
Std Dev 2.07
pullDxy
Std Dev 2.04
Constant 0.0539
Mean −0.08758
Sigma 1.331
Ratio
pull of dz parameter
pullDz
Std Dev 1.517
Constant 0.069
Mean −0.09986
Sigma 1.018
pullDz
Std Dev 1.517
Constant 0.069
Mean −0.09986
Sigma 1.018
pullDz
Std Dev 1.52
Constant 0.06935
Mean 0.09677
Sigma 1.014
pullDz
Std Dev 1.516
Constant 0.06913
Mean −0.09905
Sigma 1.016
Ratio