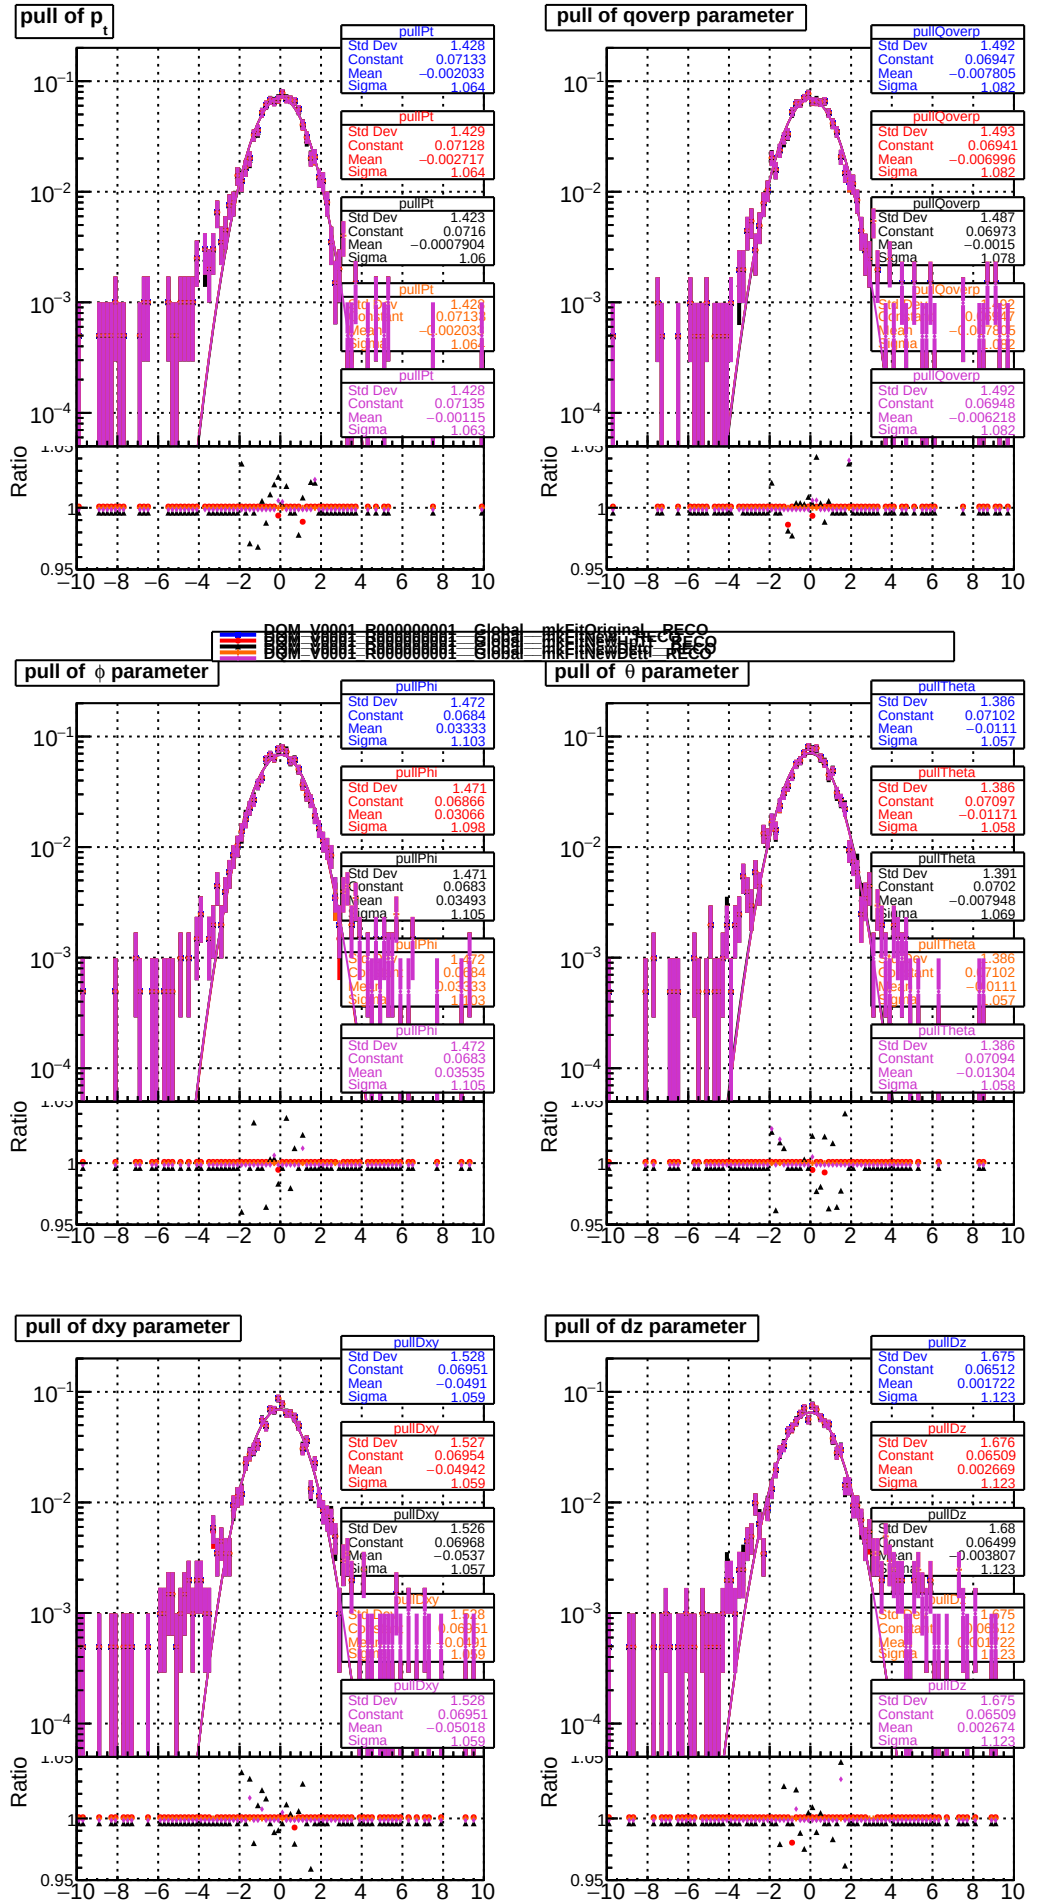
pull of p_t
pullPt
Std Dev 1.428
Constant 0.07133
Mean −0.002033
Sigma 1.064
pullPt
Std Dev 1.429
Constant 0.07128
Mean −0.002717
Sigma 1.064
pullPt
Std Dev 1.423
Constant 0.0716
Mean −0.0007904
Sigma 1.06
pullPt
Std Dev 1.428
Constant 0.07135
Mean −0.00115
Sigma 1.063
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.492
Constant 0.06947
Mean −0.007805
Sigma 1.082
pullQoverp
Std Dev 1.493
Constant 0.06941
Mean −0.006996
Sigma 1.082
pullQoverp
Std Dev 1.487
Constant 0.06973
Mean −0.0015
Sigma 1.078
pullQoverp
Std Dev 1.492
Constant 0.06948
Mean −0.006218
Sigma 1.082
Ratio
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.472
Constant 0.0684
Mean 0.03333
Sigma 1.103
pullPhi
Std Dev 1.471
Constant 0.06866
Mean 0.03066
Sigma 1.098
pullPhi
Std Dev 1.471
Constant 0.0683
Mean 0.03493
Sigma 1.105
pullPhi
Std Dev 1.472
Constant 0.0684
Mean 0.03333
Sigma 1.103
pullPhi
Std Dev 1.472
Constant 0.0683
Mean 0.03535
Sigma 1.105
Ratio
pull of θ parameter
pullTheta
Std Dev 1.386
Constant 0.07102
Mean −0.0111
Sigma 1.057
pullTheta
Std Dev 1.386
Constant 0.07097
Mean −0.01171
Sigma 1.058
pullTheta
Std Dev 1.391
Constant 0.0702
Mean −0.007948
Sigma 1.069
pullTheta
Std Dev 1.386
Constant 0.07102
Mean −0.0111
Sigma 1.057
pullTheta
Std Dev 1.386
Constant 0.07094
Mean −0.01304
Sigma 1.058
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.528
Constant 0.06951
Mean −0.0491
Sigma 1.059
pullDxy
Std Dev 1.527
Constant 0.06954
Mean −0.04942
Sigma 1.059
pullDxy
Std Dev 1.526
Constant 0.06968
Mean −0.0537
Sigma 1.057
pullDxy
Std Dev 1.528
Constant 0.06951
Mean −0.0491
Sigma 1.059
pullDxy
Std Dev 1.528
Constant 0.06951
Mean −0.05018
Sigma 1.059
Ratio
pull of dz parameter
pullDz
Std Dev 1.675
Constant 0.06512
Mean 0.001722
Sigma 1.123
pullDz
Std Dev 1.676
Constant 0.06509
Mean 0.002669
Sigma 1.123
pullDz
Std Dev 1.68
Constant 0.06499
Mean −0.003807
Sigma 1.123
pullDz
Std Dev 1.675
Constant 0.06512
Mean 0.001722
Sigma 1.123
pullDz
Std Dev 1.675
Constant 0.06509
Mean 0.002674
Sigma 1.123
Ratio