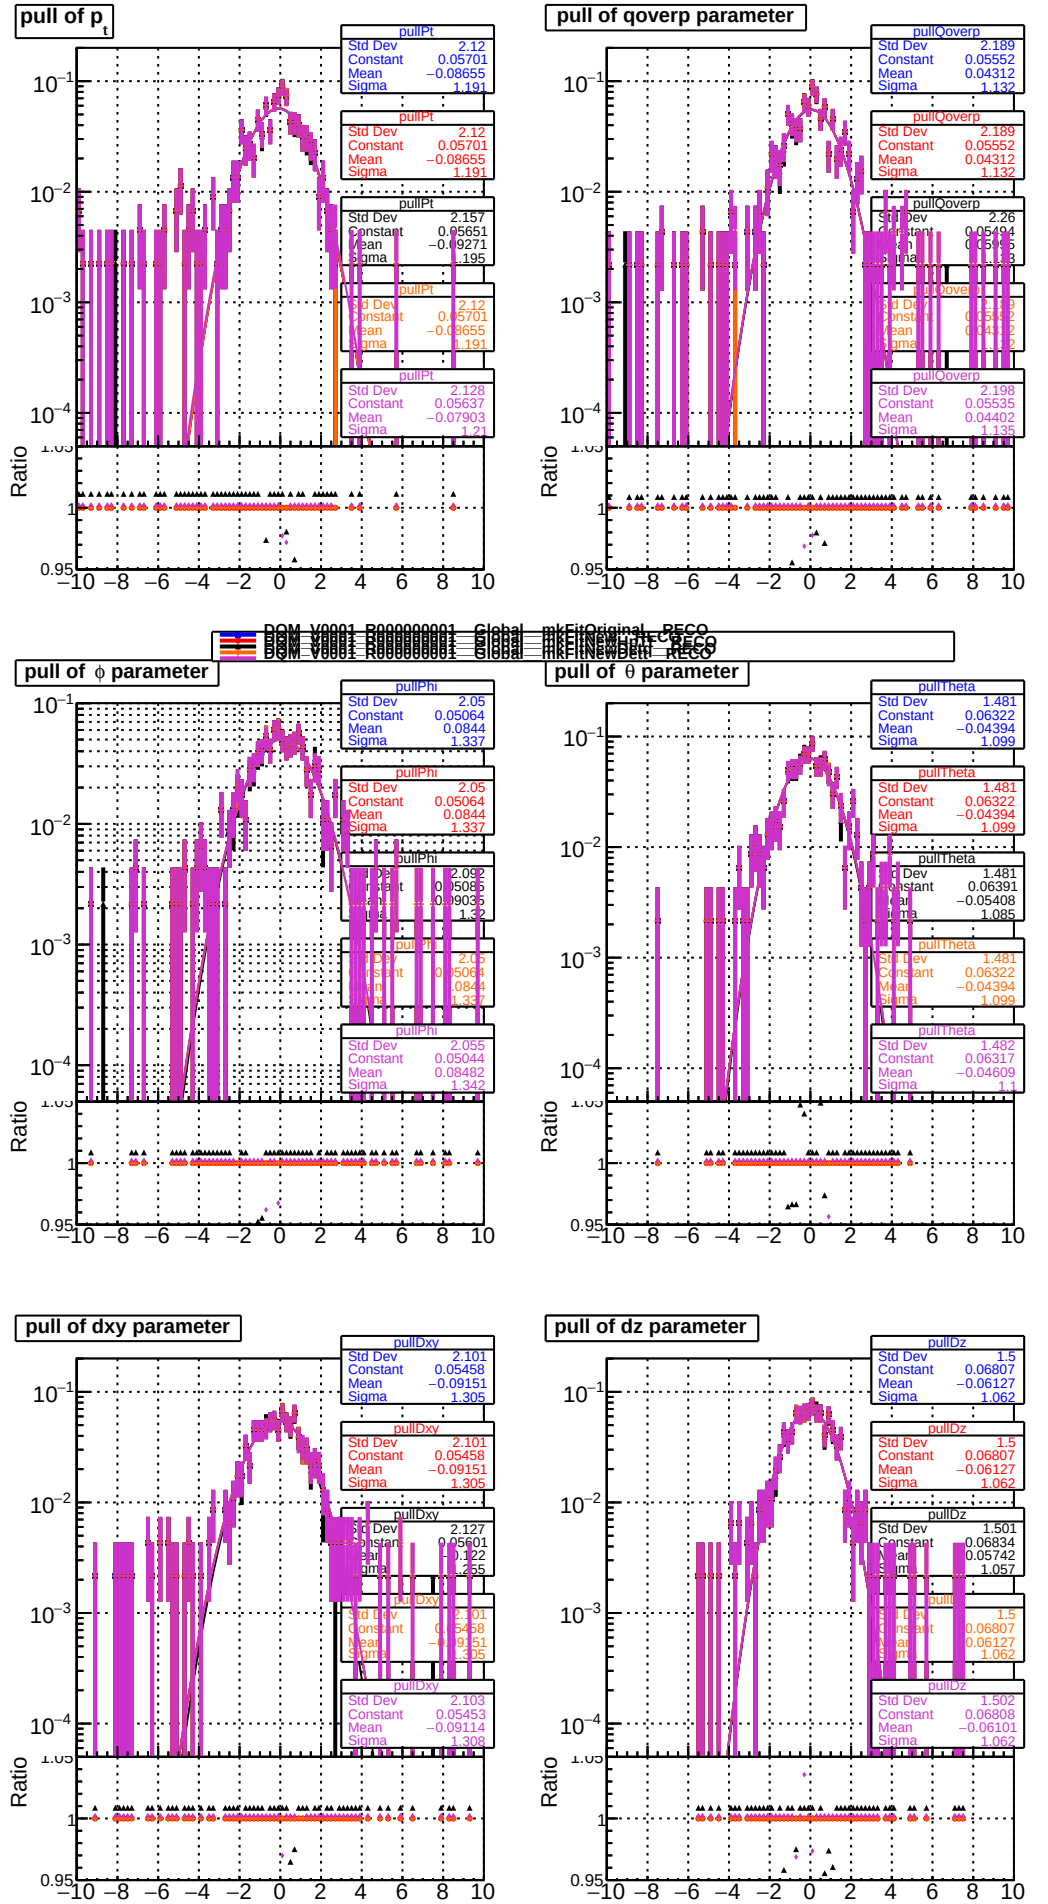
pull of p_t
pullPt
Std Dev 2.12
Constant 0.05701
Mean −0.08655
Sigma 1.191
pullPt
Std Dev 2.12
Constant 0.05701
Mean −0.08655
Sigma 1.191
pullPt
Std Dev 2.157
Constant 0.05651
Mean −0.09271
Sigma 1.195
pullPt
Std Dev 2.12
Constant 0.05701
Mean −0.08655
Sigma 1.191
pullPt
Std Dev 2.128
Constant 0.05637
Mean −0.07903
Sigma 1.21
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.189
Constant 0.05552
Mean 0.04312
Sigma 1.132
pullQoverp
Std Dev 2.189
Constant 0.05552
Mean 0.04312
Sigma 1.132
pullQoverp
Std Dev 2.26
pullQoverp
pullQoverp
Std Dev 2.198
Constant 0.05535
Mean 0.04402
Sigma 1.135
Ratio
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.05
Constant 0.05064
Mean 0.0844
Sigma 1.337
pullPhi
Std Dev 2.05
Constant 0.05064
Mean 0.0844
Sigma 1.337
pullPhi
Std Dev 2.092
pullPhi
pullPhi
Std Dev 2.055
Constant 0.05044
Mean 0.08482
Sigma 1.342
Ratio
pull of θ parameter
pullTheta
Std Dev 1.481
Constant 0.06322
Mean −0.04394
Sigma 1.099
pullTheta
Std Dev 1.481
Constant 0.06322
Mean −0.04394
Sigma 1.099
pullTheta
Std Dev 1.481
Constant 0.06391
Mean −0.05408
Sigma 1.085
pullTheta
Std Dev 1.481
Constant 0.06322
Mean −0.04394
Sigma 1.099
pullTheta
Std Dev 1.482
Constant 0.06317
Mean −0.04609
Sigma 1.1
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.101
Constant 0.05458
Mean −0.09151
Sigma 1.305
pullDxy
Std Dev 2.101
Constant 0.05458
Mean −0.09151
Sigma 1.305
pullDxy
Std Dev 2.127
Constant 0.05601
pullDxy
pullDxy
Std Dev 2.103
Constant 0.05453
Mean −0.09114
Sigma 1.308
Ratio
pull of dz parameter
pullDz
Std Dev 1.5
Constant 0.06807
Mean −0.06127
Sigma 1.062
pullDz
Std Dev 1.5
Constant 0.06807
Mean −0.06127
Sigma 1.062
pullDz
Std Dev 1.501
Constant 0.06834
Mean 0.05742
Sigma 1.057
pullDz
Std Dev 1.502
Constant 0.06808
Mean −0.06101
Sigma 1.062
Ratio