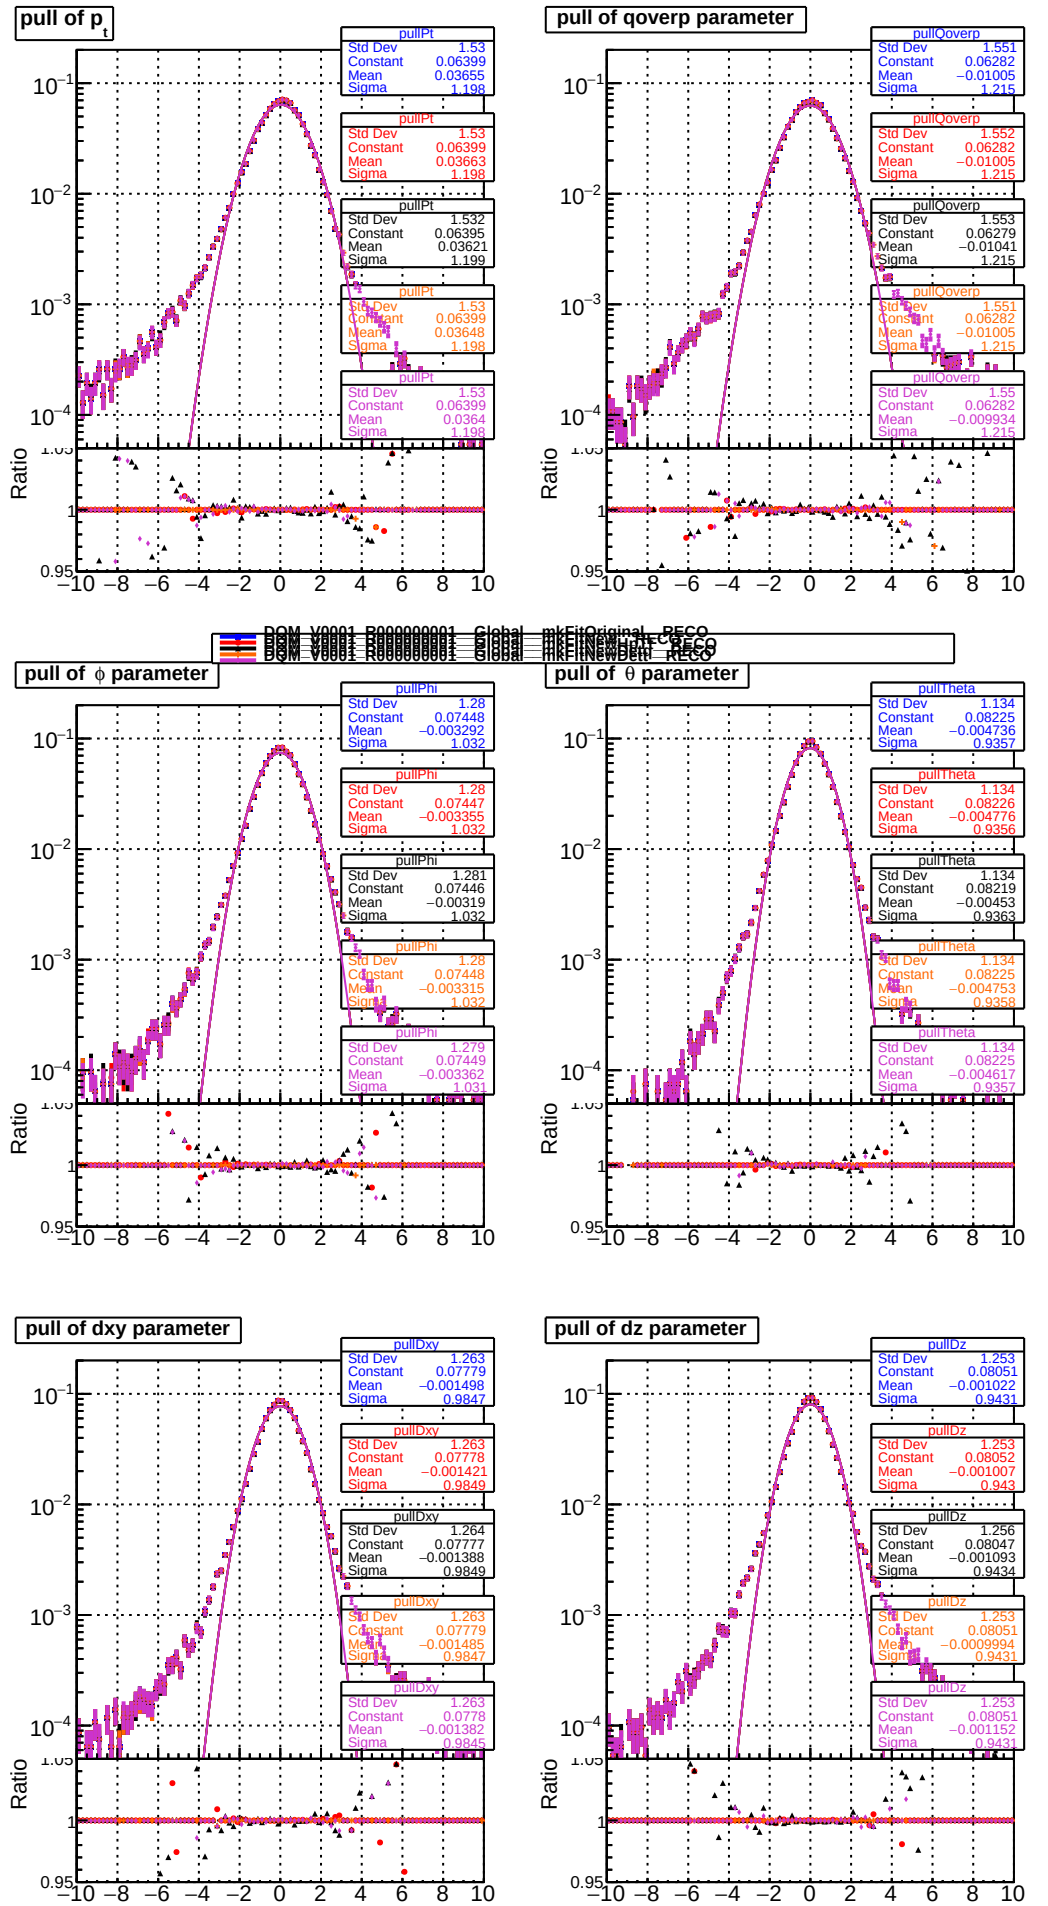
pull of p_t
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.03655
Sigma 1.198
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.03663
Sigma 1.198
pullPt
Std Dev 1.532
Constant 0.06395
Mean 0.03621
Sigma 1.199
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.03648
Sigma 1.198
pullPt
Std Dev 1.53
Constant 0.06399
Mean 0.0364
Sigma 1.198
pull of qoverp parameter
pullQoverp
Std Dev 1.551
Constant 0.06282
Mean −0.01005
Sigma 1.215
pullQoverp
Std Dev 1.552
Constant 0.06282
Mean −0.01005
Sigma 1.215
pullQoverp
Std Dev 1.553
Constant 0.06279
Mean −0.01041
Sigma 1.215
pullQoverp
Std Dev 1.551
Constant 0.06282
Mean −0.01005
Sigma 1.215
pullQoverp
Std Dev 1.55
Constant 0.06282
Mean −0.009934
Sigma 1.215
Ratio
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
DQM_V0001_R000000001__Global__mkFitNewBefit__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.28
Constant 0.07448
Mean −0.003292
Sigma 1.032
pullPhi
Std Dev 1.28
Constant 0.07447
Mean −0.003355
Sigma 1.032
pullPhi
Std Dev 1.281
Constant 0.07446
Mean −0.00319
Sigma 1.032
pullPhi
Std Dev 1.28
Constant 0.07448
Mean −0.003315
Sigma 1.032
pullPhi
Std Dev 1.279
Constant 0.07449
Mean −0.003362
Sigma 1.031
pull of θ parameter
pullTheta
Std Dev 1.134
Constant 0.08225
Mean −0.004736
Sigma 0.9357
pullTheta
Std Dev 1.134
Constant 0.08226
Mean −0.004776
Sigma 0.9356
pullTheta
Std Dev 1.134
Constant 0.08219
Mean −0.00453
Sigma 0.9363
pullTheta
Std Dev 1.134
Constant 0.08225
Mean −0.004753
Sigma 0.9358
pullTheta
Std Dev 1.134
Constant 0.08225
Mean −0.004617
Sigma 0.9357
pull of dxy parameter
pullDxy
Std Dev 1.263
Constant 0.07779
Mean −0.001498
Sigma 0.9847
pullDxy
Std Dev 1.263
Constant 0.07778
Mean −0.001421
Sigma 0.9849
pullDxy
Std Dev 1.264
Constant 0.07777
Mean −0.001388
Sigma 0.9849
pullDxy
Std Dev 1.263
Constant 0.07779
Mean −0.001485
Sigma 0.9847
pullDxy
Std Dev 1.263
Constant 0.0778
Mean −0.001382
Sigma 0.9845
pull of dz parameter
pullDz
Std Dev 1.253
Constant 0.08051
Mean −0.001022
Sigma 0.9431
pullDz
Std Dev 1.253
Constant 0.08052
Mean −0.001007
Sigma 0.943
pullDz
Std Dev 1.256
Constant 0.08047
Mean −0.001093
Sigma 0.9434
pullDz
Std Dev 1.253
Constant 0.08051
Mean −0.0009994
Sigma 0.9431
pullDz
Std Dev 1.253
Constant 0.08051
Mean −0.001152
Sigma 0.9431