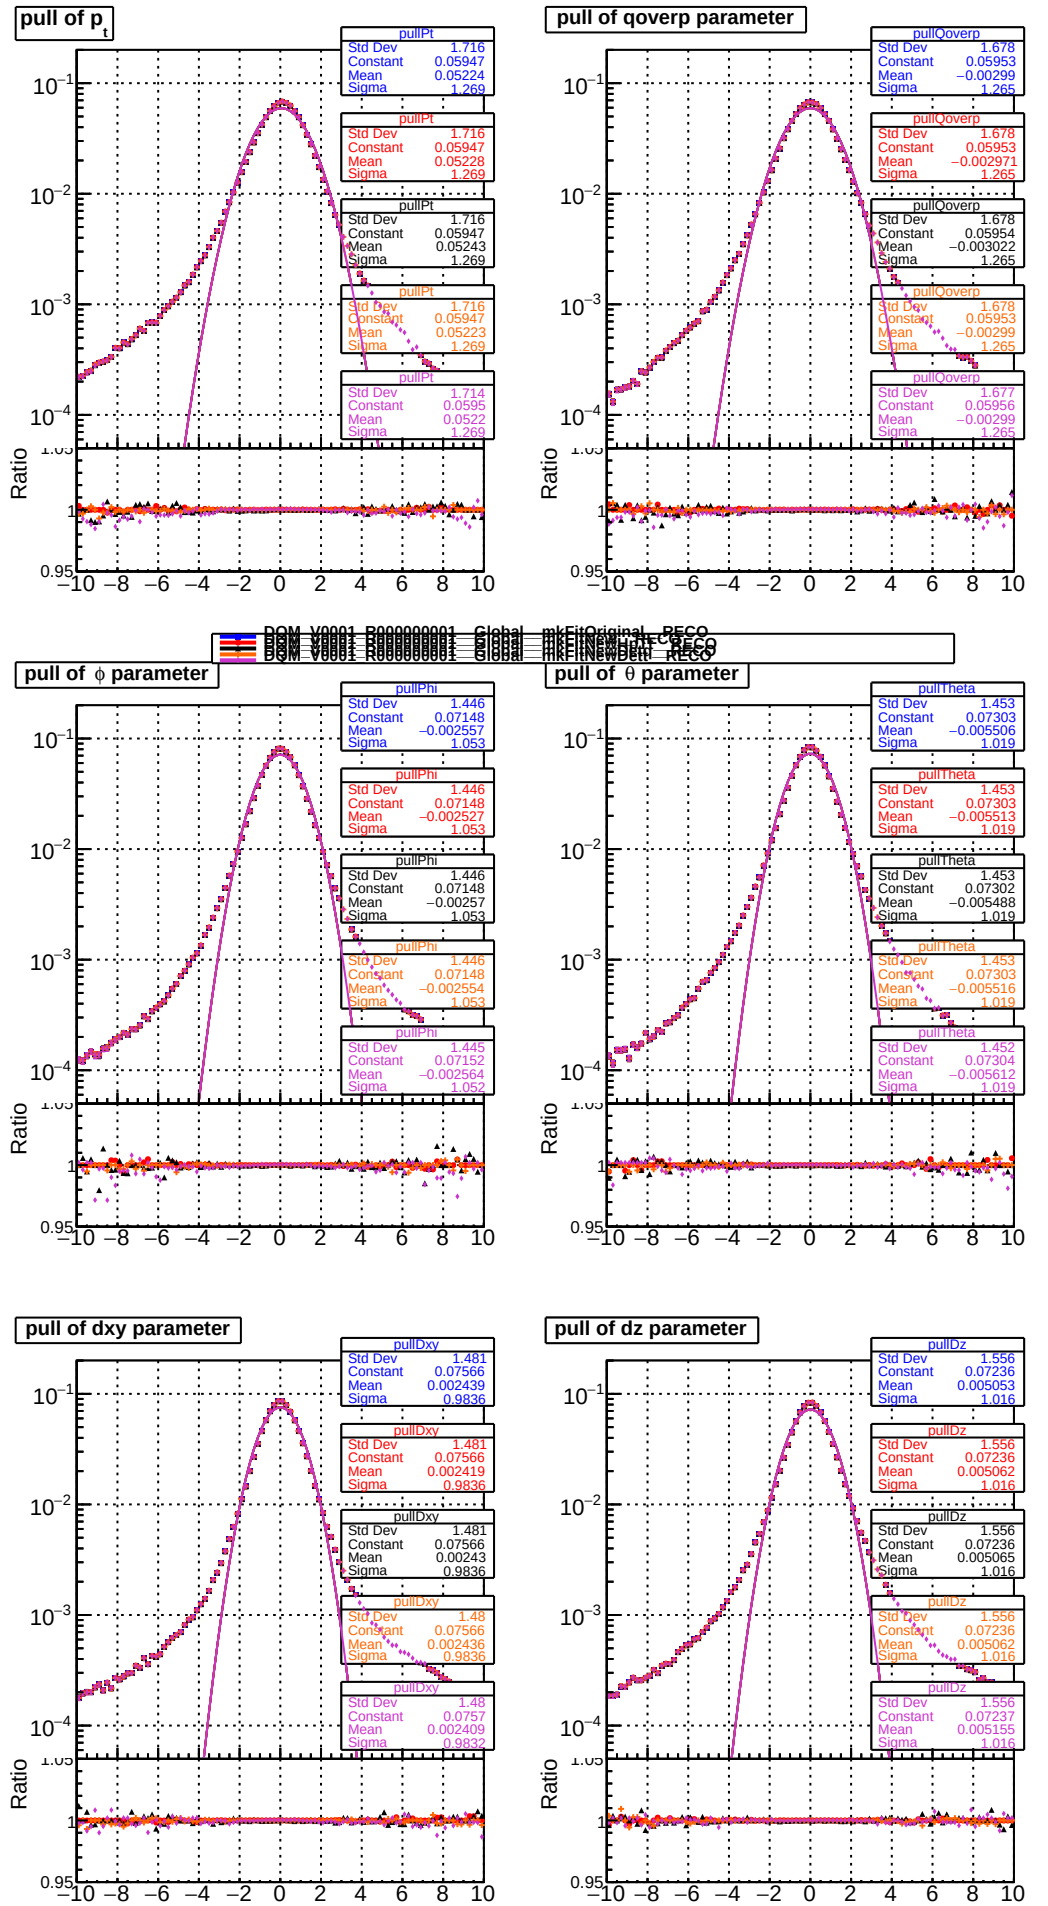
pull of p_t
pullPt
Std Dev 1.716
Constant 0.05947
Mean 0.05224
Sigma 1.269
pullPt
Std Dev 1.716
Constant 0.05947
Mean 0.05228
Sigma 1.269
pullPt
Std Dev 1.716
Constant 0.05947
Mean 0.05243
Sigma 1.269
pullPt
Std Dev 1.716
Constant 0.05947
Mean 0.05223
Sigma 1.269
pullPt
Std Dev 1.714
Constant 0.0595
Mean 0.0522
Sigma 1.269
pull of qoverp parameter
pullQoverp
Std Dev 1.678
Constant 0.05953
Mean −0.00299
Sigma 1.265
pullQoverp
Std Dev 1.678
Constant 0.05953
Mean −0.002971
Sigma 1.265
pullQoverp
Std Dev 1.678
Constant 0.05954
Mean −0.003022
Sigma 1.265
pullQoverp
Std Dev 1.678
Constant 0.05953
Mean −0.00299
Sigma 1.265
pullQoverp
Std Dev 1.677
Constant 0.05956
Mean −0.00299
Sigma 1.265
DQM_V0001_R000000001__Global__mkFitOriginal__RECO
DQM_V0001_R000000001__Global__mkFitNewBeff__RECO
DQM_V0001_R000000001__Global__mkFitNewBeff__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.446
Constant 0.07148
Mean −0.002557
Sigma 1.053
pullPhi
Std Dev 1.446
Constant 0.07148
Mean −0.002527
Sigma 1.053
pullPhi
Std Dev 1.446
Constant 0.07148
Mean −0.00257
Sigma 1.053
pullPhi
Std Dev 1.446
Constant 0.07148
Mean −0.002554
Sigma 1.053
pullPhi
Std Dev 1.445
Constant 0.07152
Mean −0.002564
Sigma 1.052
pull of θ parameter
pullTheta
Std Dev 1.453
Constant 0.07303
Mean −0.005506
Sigma 1.019
pullTheta
Std Dev 1.453
Constant 0.07303
Mean −0.005513
Sigma 1.019
pullTheta
Std Dev 1.453
Constant 0.07302
Mean −0.005488
Sigma 1.019
pullTheta
Std Dev 1.453
Constant 0.07303
Mean −0.005516
Sigma 1.019
pullTheta
Std Dev 1.452
Constant 0.07304
Mean −0.005612
Sigma 1.019
pull of dxy parameter
pullDxy
Std Dev 1.481
Constant 0.07566
Mean 0.002439
Sigma 0.9836
pullDxy
Std Dev 1.481
Constant 0.07566
Mean 0.002419
Sigma 0.9836
pullDxy
Std Dev 1.481
Constant 0.07566
Mean 0.00243
Sigma 0.9836
pullDxy
Std Dev 1.48
Constant 0.07566
Mean 0.002436
Sigma 0.9836
pullDxy
Std Dev 1.48
Constant 0.0757
Mean 0.002409
Sigma 0.9832
pull of dz parameter
pullDz
Std Dev 1.556
Constant 0.07236
Mean 0.005053
Sigma 1.016
pullDz
Std Dev 1.556
Constant 0.07236
Mean 0.005062
Sigma 1.016
pullDz
Std Dev 1.556
Constant 0.07236
Mean 0.005065
Sigma 1.016
pullDz
Std Dev 1.556
Constant 0.07236
Mean 0.005062
Sigma 1.016
pullDz
Std Dev 1.556
Constant 0.07237
Mean 0.005155
Sigma 1.016
Ratio