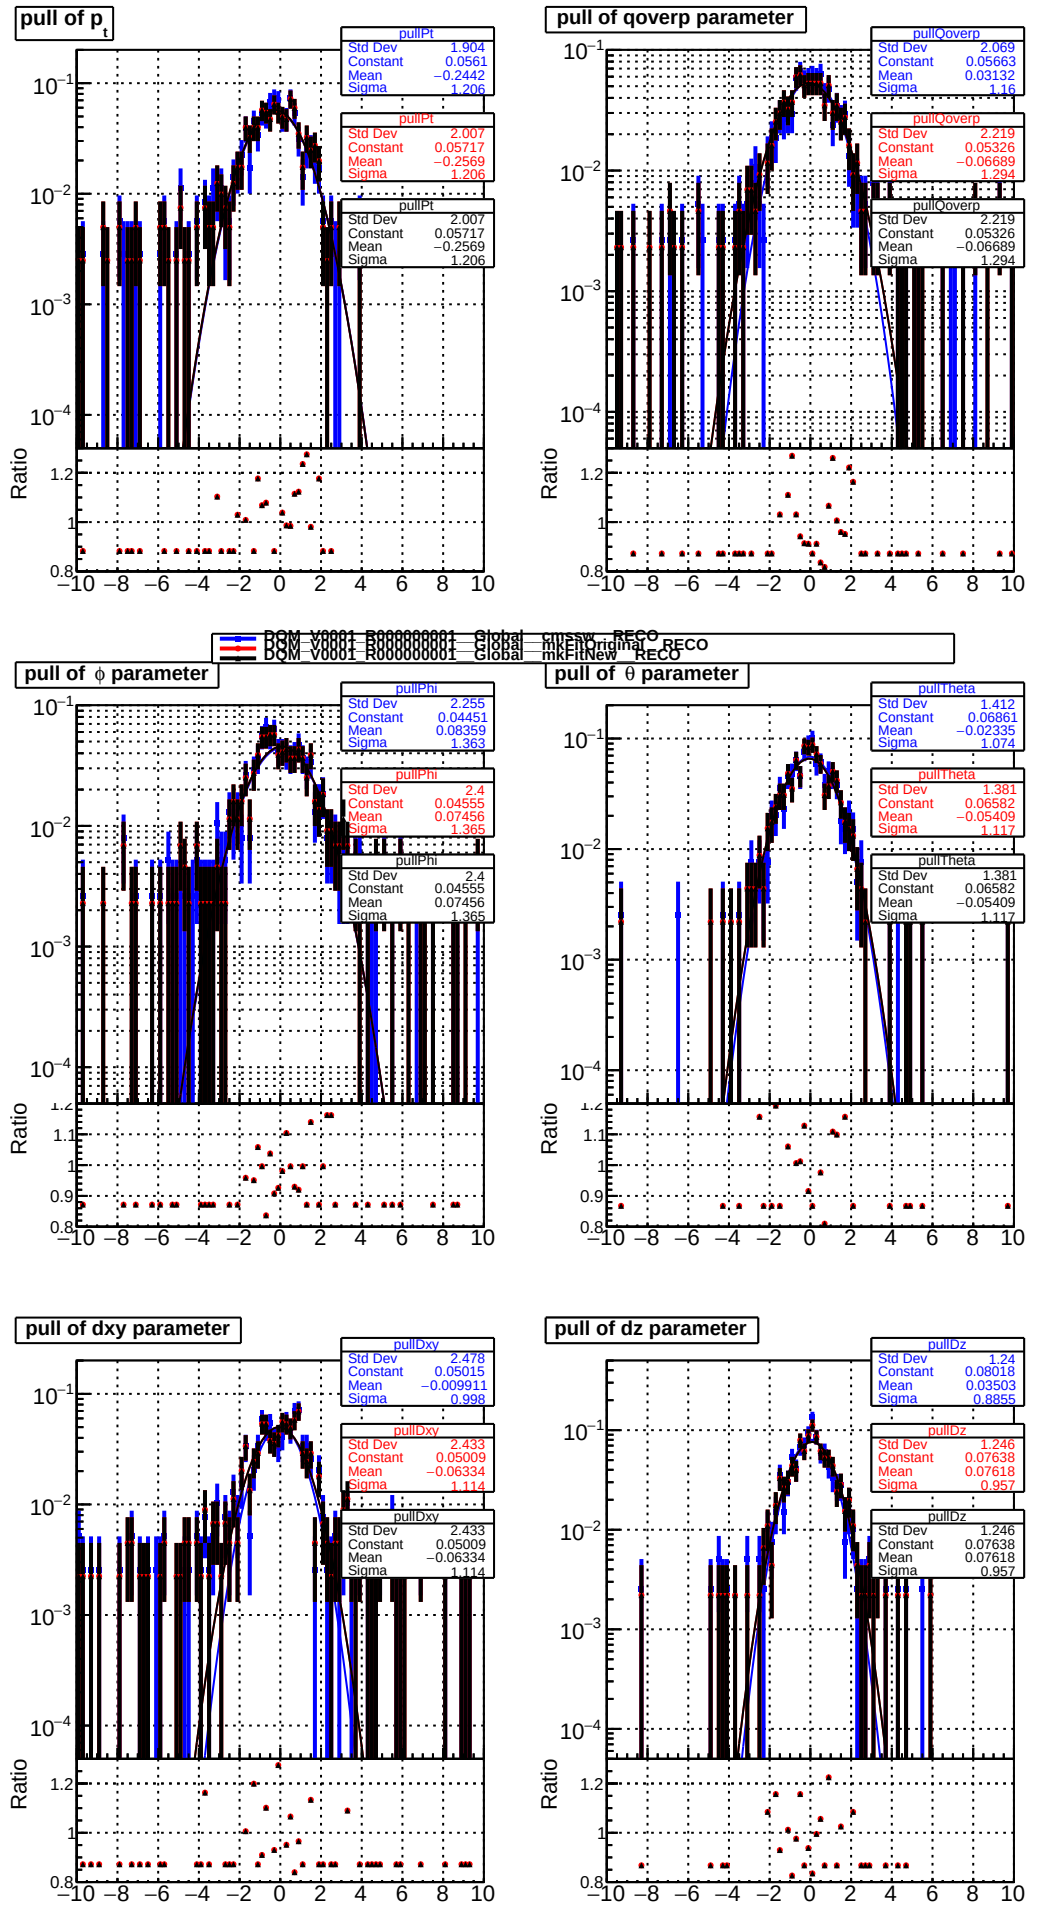
pull of p_t
pullPt
Std Dev 1.904
Constant 0.0561
Mean −0.2442
Sigma 1.206
pullPt
Std Dev 2.007
Constant 0.05717
Mean −0.2569
Sigma 1.206
pullPt
Std Dev 2.007
Constant 0.05717
Mean −0.2569
Sigma 1.206
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 2.069
Constant 0.05663
Mean 0.03132
Sigma 1.16
pullQoverp
Std Dev 2.219
Constant 0.05326
Mean −0.06689
Sigma 1.294
pullQoverp
Std Dev 2.219
Constant 0.05326
Mean −0.06689
Sigma 1.294
Ratio
DQM_V0001_R000000001__Global__ctfWsw__RECO
DQM_V0001_R000000001__Global__mkFitOrigin__RECO
DQM_V0001_R000000001__Global__mkFitNew__RECO
pull of ϕ parameter
pullPhi
Std Dev 2.255
Constant 0.04451
Mean 0.08359
Sigma 1.363
pullPhi
Std Dev 2.4
Constant 0.04555
Mean 0.07456
Sigma 1.365
pullPhi
Std Dev 2.4
Constant 0.04555
Mean 0.07456
Sigma 1.365
Ratio
pull of θ parameter
pullTheta
Std Dev 1.412
Constant 0.06861
Mean −0.02335
Sigma 1.074
pullTheta
Std Dev 1.381
Constant 0.06582
Mean −0.05409
Sigma 1.117
pullTheta
Std Dev 1.381
Constant 0.06582
Mean −0.05409
Sigma 1.117
Ratio
pull of dxy parameter
pullDxy
Std Dev 2.478
Constant 0.05015
Mean −0.009911
Sigma 0.998
pullDxy
Std Dev 2.433
Constant 0.05009
Mean −0.06334
Sigma 1.114
pullDxy
Std Dev 2.433
Constant 0.05009
Mean −0.06334
Sigma 1.114
Ratio
pull of dz parameter
pullDz
Std Dev 1.24
Constant 0.08018
Mean 0.03503
Sigma 0.8855
pullDz
Std Dev 1.246
Constant 0.07638
Mean 0.07618
Sigma 0.957
pullDz
Std Dev 1.246
Constant 0.07638
Mean 0.07618
Sigma 0.957
Ratio