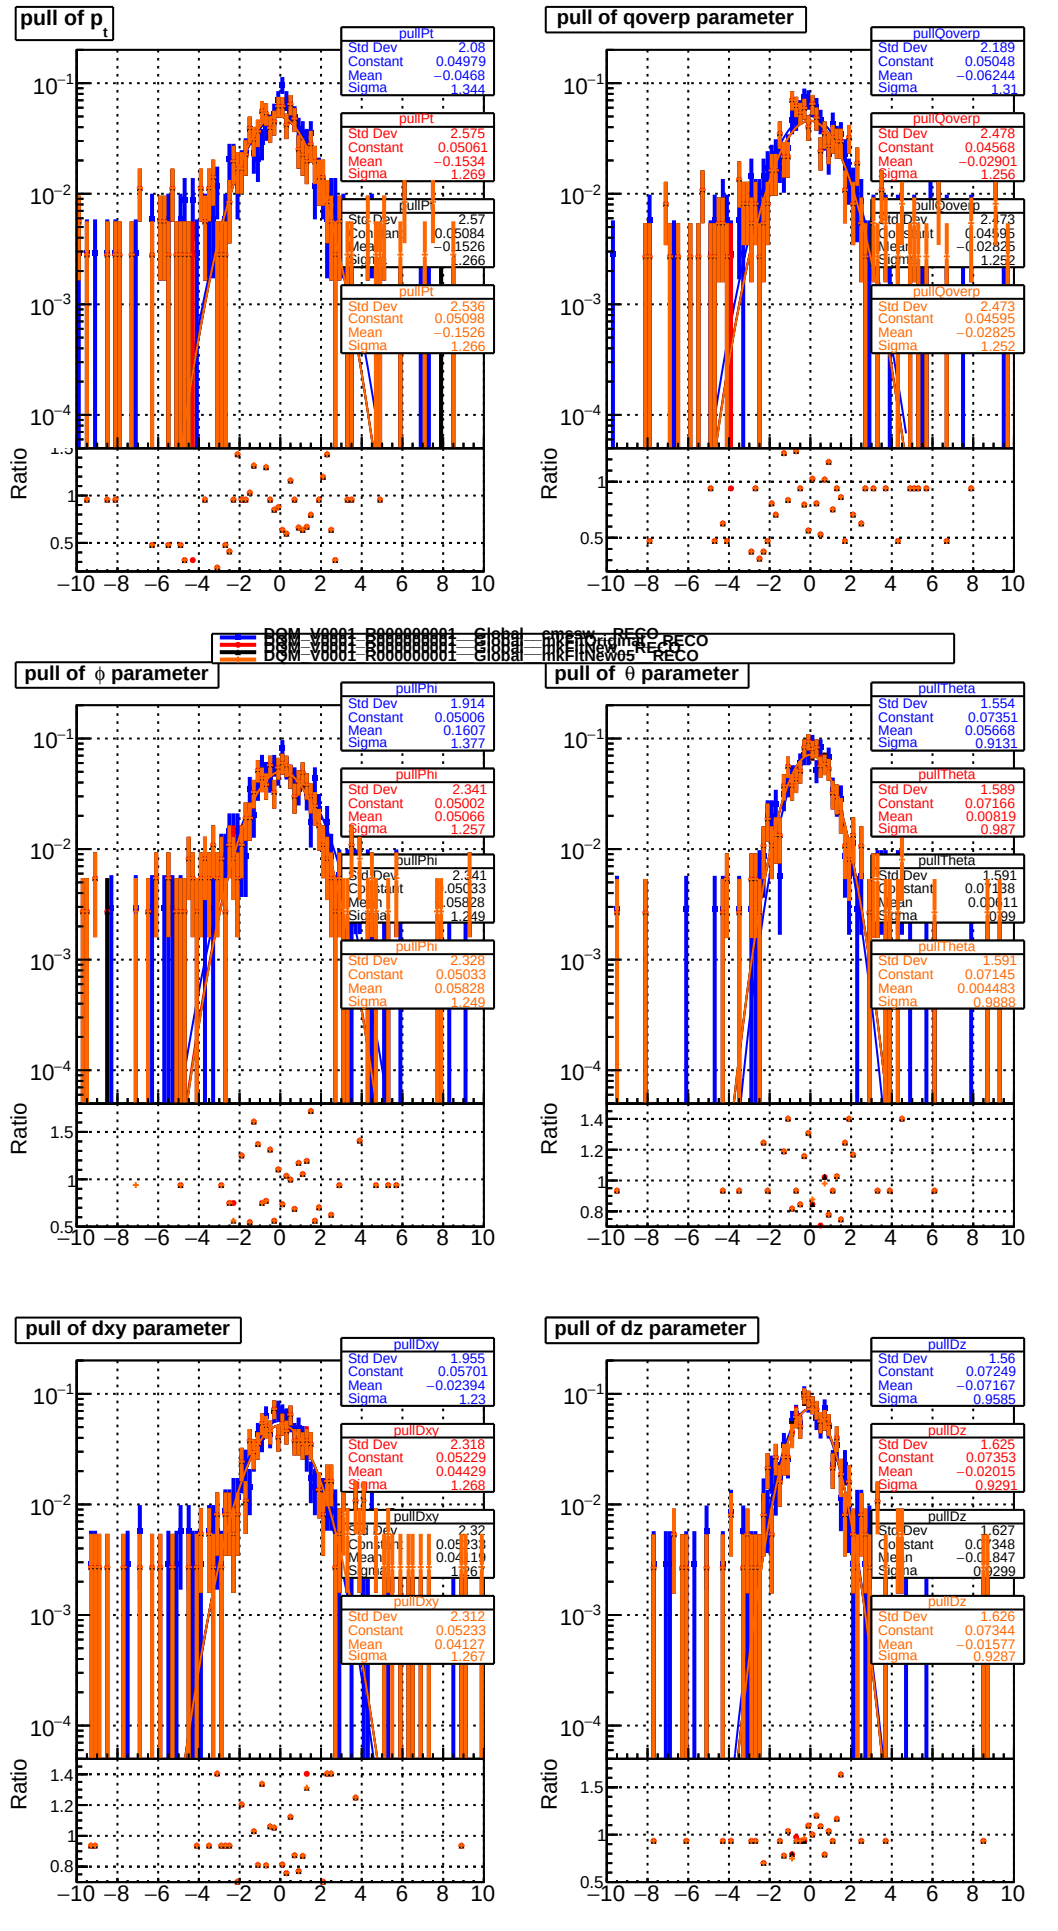
pull of p_t
pullPt
Std Dev 2.08
Constant 0.04979
Mean −0.0468
Sigma 1.344
pullPt
Std Dev 2.575
Constant 0.05061
Mean −0.1534
Sigma 1.269
pullPt
Std Dev 2.57
Constant 0.05084
Mean −0.1526
Sigma 1.266
pullPt
Std Dev 2.536
Constant 0.05098
Mean −0.1526
Sigma 1.266
pull of qoverp parameter
pullQoverp
Std Dev 2.189
Constant 0.05048
Mean −0.06244
Sigma 1.31
pullQoverp
Std Dev 2.478
Constant 0.04568
Mean −0.02901
Sigma 1.256
pullQoverp
Std Dev 2.473
Constant 0.04595
Mean −0.02825
Sigma 1.252
pullQoverp
Std Dev 2.473
Constant 0.04595
Mean −0.02825
Sigma 1.252
DQM V0001 R000000001 Global cmssw_RECO
DQM V0001 R000000001 Global mkFitOriginal_RECO
DQM V0001 R000000001 Global mkFitNew_RECO
DQM V0001 R000000001 Global mkFitNew05_RECO
pull of ϕ parameter
pullPhi
Std Dev 1.914
Constant 0.05006
Mean 0.1607
Sigma 1.377
pullPhi
Std Dev 2.341
Constant 0.05002
Mean 0.05066
Sigma 1.257
pullPhi
Std Dev 2.341
Constant 0.05033
Mean 0.05828
Sigma 1.249
pullPhi
Std Dev 2.328
Constant 0.05033
Mean 0.05828
Sigma 1.249
pull of θ parameter
pullTheta
Std Dev 1.554
Constant 0.07351
Mean 0.05668
Sigma 0.9131
pullTheta
Std Dev 1.589
Constant 0.07166
Mean 0.00819
Sigma 0.987
pullTheta
Std Dev 1.591
Constant 0.07138
Mean 0.00611
Sigma 0.99
pullTheta
Std Dev 1.591
Constant 0.07145
Mean 0.004483
Sigma 0.9888
pull of dxy parameter
pullDxy
Std Dev 1.955
Constant 0.05701
Mean −0.02394
Sigma 1.23
pullDxy
Std Dev 2.318
Constant 0.05229
Mean 0.04429
Sigma 1.268
pullDxy
Std Dev 2.32
Constant 0.05233
Mean 0.04119
Sigma 1.267
pullDxy
Std Dev 2.312
Constant 0.05233
Mean 0.04127
Sigma 1.267
pull of dz parameter
pullDz
Std Dev 1.56
Constant 0.07249
Mean −0.07167
Sigma 0.9585
pullDz
Std Dev 1.625
Constant 0.07353
Mean −0.02015
Sigma 0.9291
pullDz
Std Dev 1.627
Constant 0.07348
Mean −0.01847
Sigma 0.9299
pullDz
Std Dev 1.626
Constant 0.07344
Mean −0.01577
Sigma 0.9287
Ratio