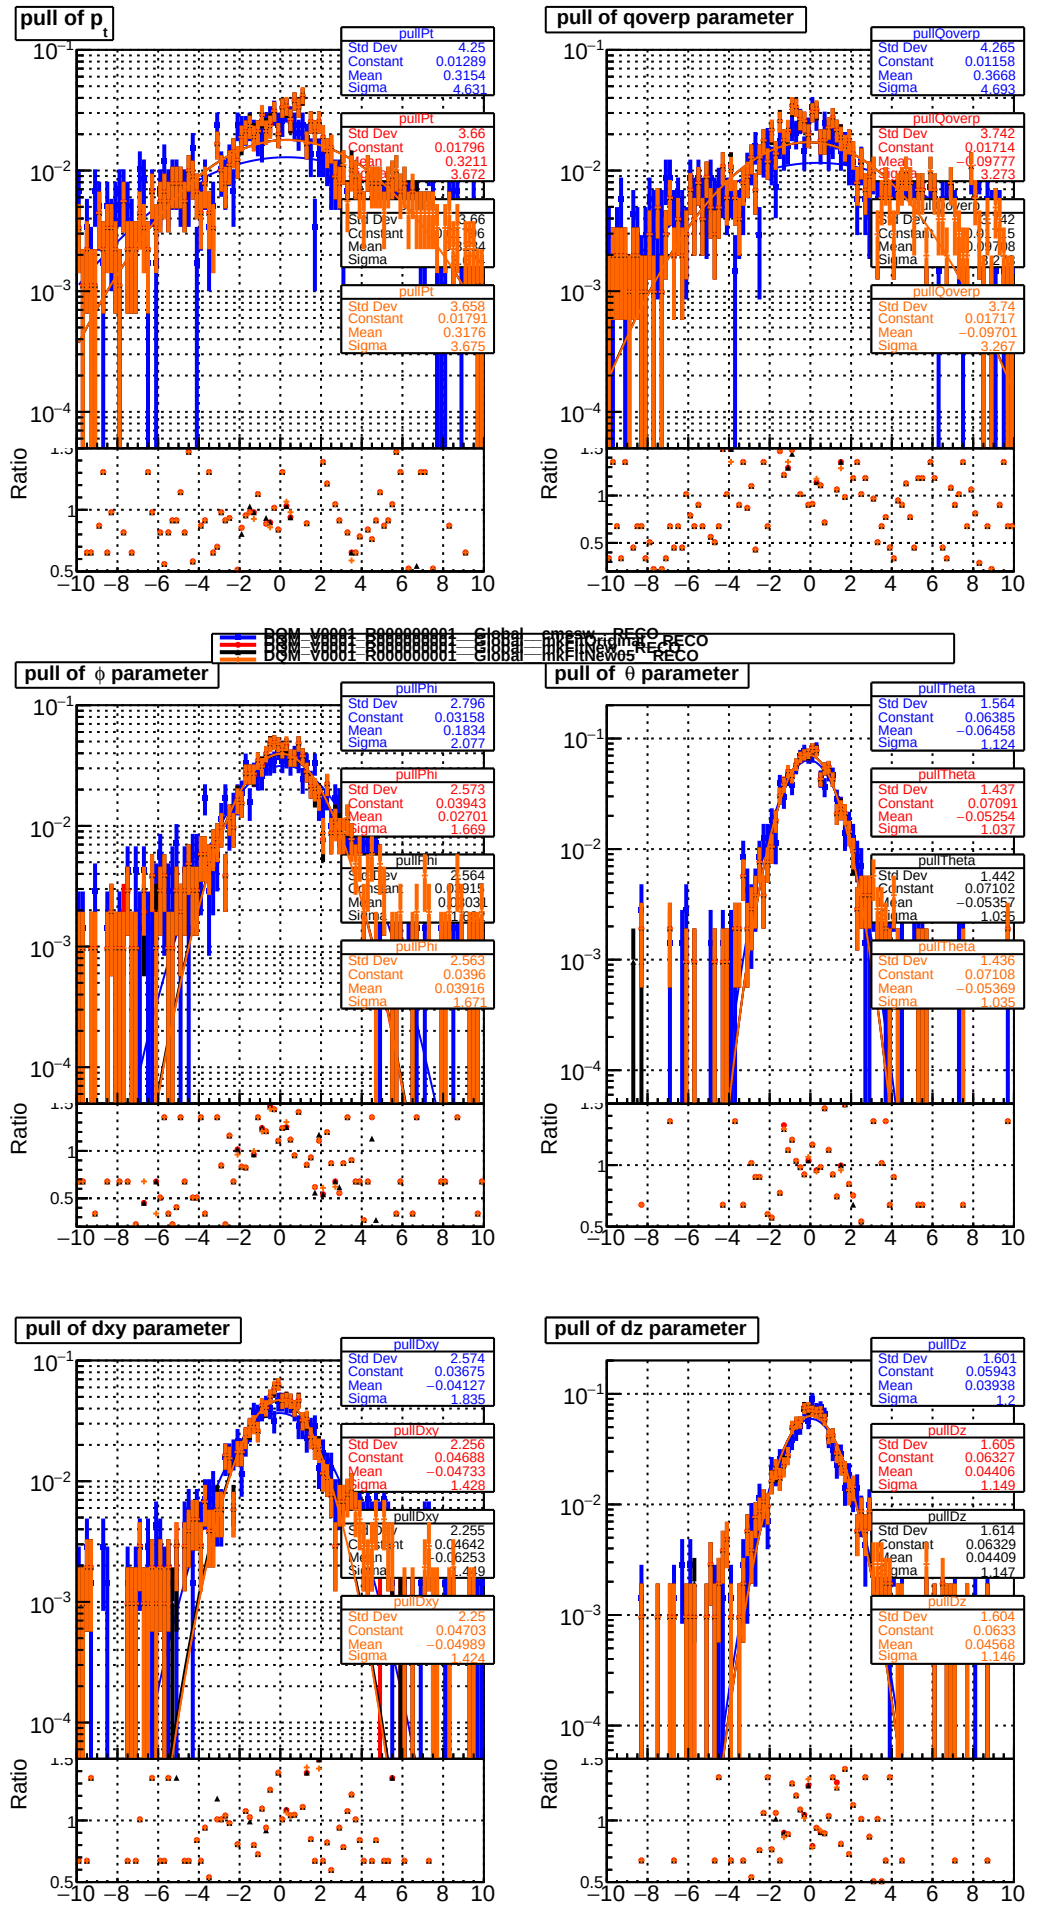
pull of p_t
pullPt
Std Dev 4.25
Constant 0.01289
Mean 0.3154
Sigma 4.631
pullPt
Std Dev 3.66
Constant 0.01796
Mean 0.3211
Sigma 3.672
pullPt
Std Dev 3.658
Constant 0.01791
Mean 0.3176
Sigma 3.675
pull of qoverp parameter
pullQoverp
Std Dev 4.265
Constant 0.01158
Mean 0.3668
Sigma 4.693
pullQoverp
Std Dev 3.742
Constant 0.01714
Mean −0.09777
Sigma 3.273
pullQoverp
Std Dev 3.74
Constant 0.01717
Mean −0.09701
Sigma 3.267
DQM V0001 R000000001 Global cmsswk RECO
DQM V0001 R000000001 Global hlkFitNew RECO
DQM V0001 R000000001 Global hlkFitNew05 RECO
pull of ϕ parameter
pullPhi
Std Dev 2.796
Constant 0.03158
Mean 0.1834
Sigma 2.077
pullPhi
Std Dev 2.573
Constant 0.03943
Mean 0.02701
Sigma 1.669
pullPhi
Std Dev 2.563
Constant 0.0396
Mean 0.03916
Sigma 1.671
pull of θ parameter
pullTheta
Std Dev 1.564
Constant 0.06385
Mean −0.06458
Sigma 1.124
pullTheta
Std Dev 1.437
Constant 0.07091
Mean −0.05254
Sigma 1.037
pullTheta
Std Dev 1.436
Constant 0.07108
Mean −0.05369
Sigma 1.035
pull of dxy parameter
pullDxy
Std Dev 2.574
Constant 0.03675
Mean −0.04127
Sigma 1.835
pullDxy
Std Dev 2.256
Constant 0.04688
Mean −0.04733
Sigma 1.428
pullDxy
Std Dev 2.25
Constant 0.04703
Mean −0.04989
Sigma 1.424
pull of dz parameter
pullDz
Std Dev 1.601
Constant 0.05943
Mean 0.03938
Sigma 1.2
pullDz
Std Dev 1.605
Constant 0.06327
Mean 0.04406
Sigma 1.149
pullDz
Std Dev 1.604
Constant 0.0633
Mean 0.04568
Sigma 1.146
Ratio