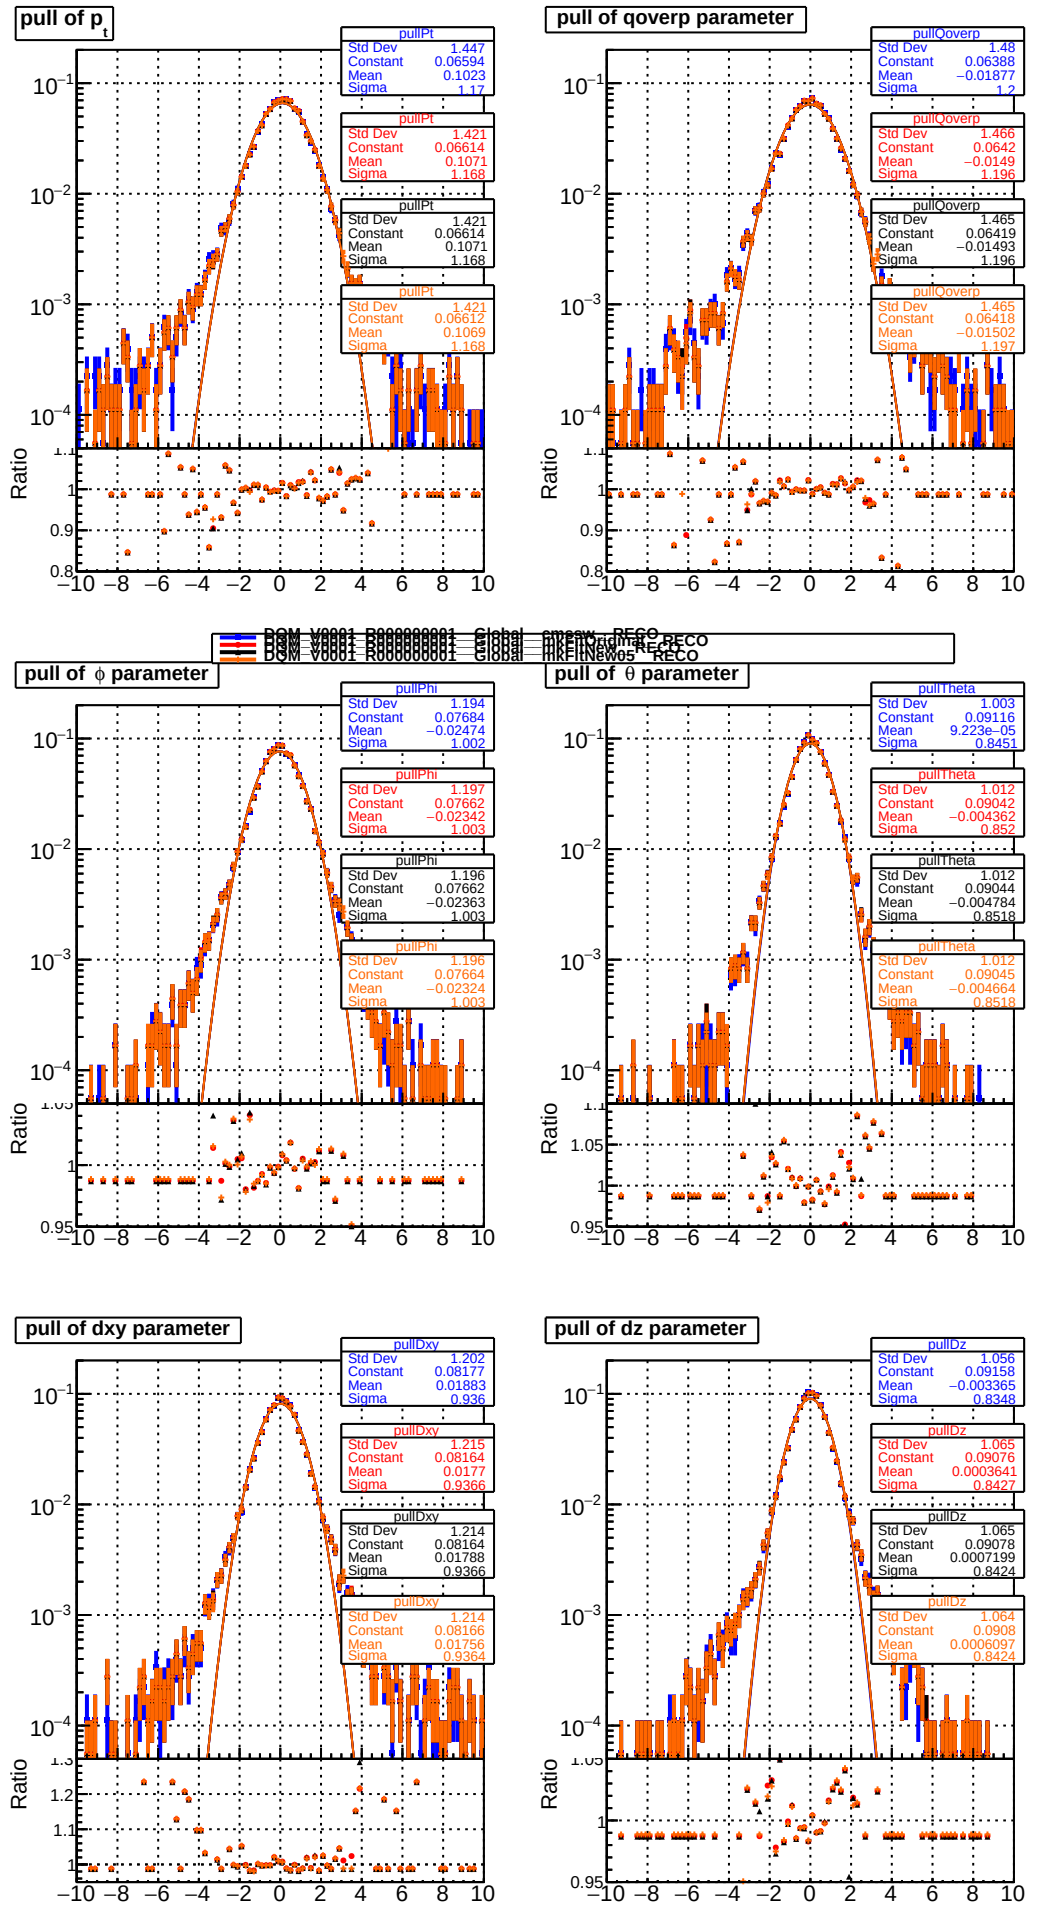
pull of p_t
pullPt
Std Dev 1.447
Constant 0.06594
Mean 0.1023
Sigma 1.17
pullPt
Std Dev 1.421
Constant 0.06614
Mean 0.1071
Sigma 1.168
pullPt
Std Dev 1.421
Constant 0.06614
Mean 0.1071
Sigma 1.168
pullPt
Std Dev 1.421
Constant 0.06612
Mean 0.1069
Sigma 1.168
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.48
Constant 0.06388
Mean −0.01877
Sigma 1.2
pullQoverp
Std Dev 1.466
Constant 0.0642
Mean −0.0149
Sigma 1.196
pullQoverp
Std Dev 1.465
Constant 0.06419
Mean −0.01493
Sigma 1.196
pullQoverp
Std Dev 1.465
Constant 0.06418
Mean −0.01502
Sigma 1.197
Ratio
DQM V0001 R000000001 Global cmsew RECO
DQM V0001 R000000001 Global hlkFitNew RECO
DQM V0001 R000000001 Global hlkFitNew05 RECO
pull of ϕ parameter
pullPhi
Std Dev 1.194
Constant 0.07684
Mean −0.02474
Sigma 1.002
pullPhi
Std Dev 1.197
Constant 0.07662
Mean −0.02342
Sigma 1.003
pullPhi
Std Dev 1.196
Constant 0.07662
Mean −0.02363
Sigma 1.003
pullPhi
Std Dev 1.196
Constant 0.07664
Mean −0.02324
Sigma 1.003
Ratio
pull of θ parameter
pullTheta
Std Dev 1.003
Constant 0.09116
Mean 9.223e−05
Sigma 0.8451
pullTheta
Std Dev 1.012
Constant 0.09042
Mean −0.004362
Sigma 0.852
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004784
Sigma 0.8518
pullTheta
Std Dev 1.012
Constant 0.09045
Mean −0.004664
Sigma 0.8518
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.202
Constant 0.08177
Mean 0.01883
Sigma 0.936
pullDxy
Std Dev 1.215
Constant 0.08164
Mean 0.0177
Sigma 0.9366
pullDxy
Std Dev 1.214
Constant 0.08164
Mean 0.01788
Sigma 0.9366
pullDxy
Std Dev 1.214
Constant 0.08166
Mean 0.01756
Sigma 0.9364
Ratio
pull of dz parameter
pullDz
Std Dev 1.056
Constant 0.09158
Mean −0.003365
Sigma 0.8348
pullDz
Std Dev 1.065
Constant 0.09076
Mean 0.0003641
Sigma 0.8427
pullDz
Std Dev 1.065
Constant 0.09078
Mean 0.0007199
Sigma 0.8424
pullDz
Std Dev 1.064
Constant 0.0908
Mean 0.0006097
Sigma 0.8424
Ratio