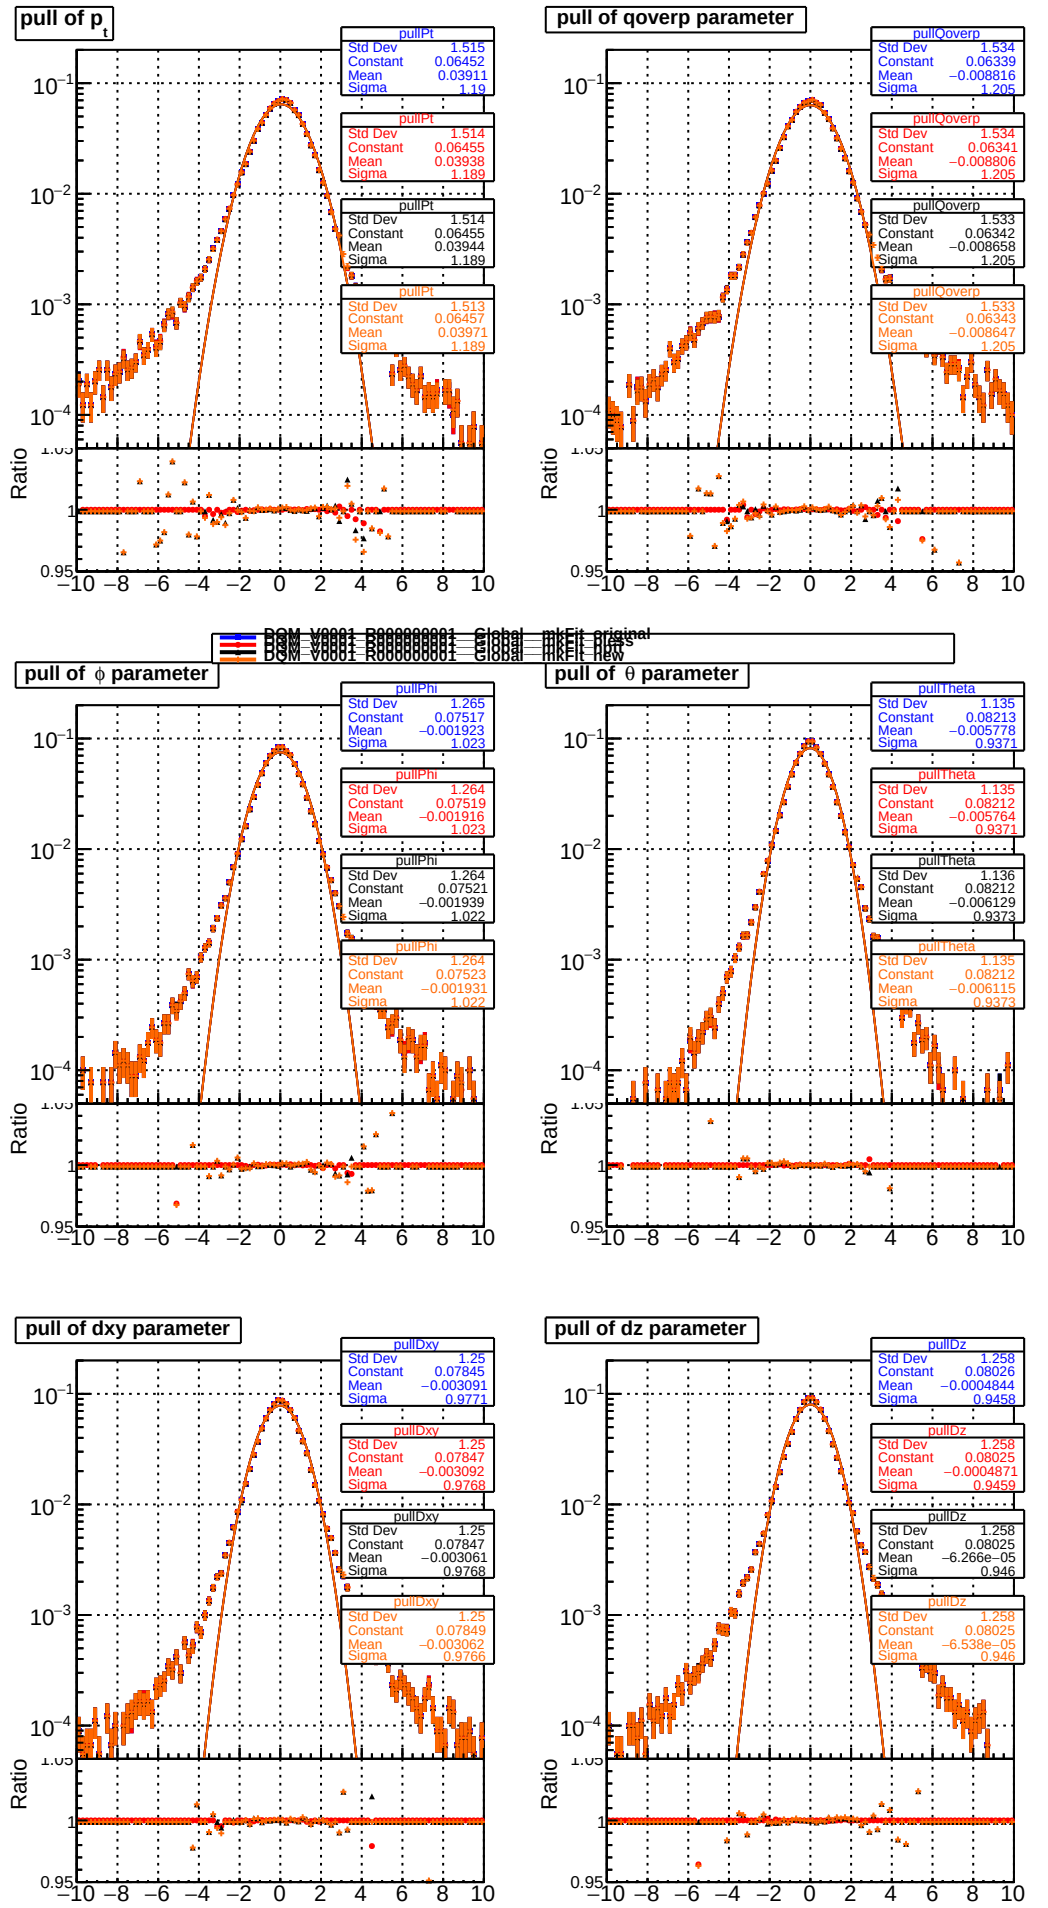
pull of p_t
pullPt
Std Dev 1.515
Constant 0.06452
Mean 0.03911
Sigma 1.19
pullPt
Std Dev 1.514
Constant 0.06455
Mean 0.03938
Sigma 1.189
pullPt
Std Dev 1.514
Constant 0.06455
Mean 0.03944
Sigma 1.189
pullPt
Std Dev 1.513
Constant 0.06457
Mean 0.03971
Sigma 1.189
pull of qoverp parameter
pullQoverp
Std Dev 1.534
Constant 0.06339
Mean −0.008816
Sigma 1.205
pullQoverp
Std Dev 1.534
Constant 0.06341
Mean −0.008806
Sigma 1.205
pullQoverp
Std Dev 1.533
Constant 0.06342
Mean −0.008658
Sigma 1.205
pullQoverp
Std Dev 1.533
Constant 0.06343
Mean −0.008647
Sigma 1.205
DQM V0001 R000000001 Global trkFit original
DQM V0001 R000000001 Global trkFit mass
DQM V0001 R000000001 Global trkFit new
pull of ϕ parameter
pullPhi
Std Dev 1.265
Constant 0.07517
Mean −0.001923
Sigma 1.023
pullPhi
Std Dev 1.264
Constant 0.07519
Mean −0.001916
Sigma 1.023
pullPhi
Std Dev 1.264
Constant 0.07521
Mean −0.001939
Sigma 1.022
pullPhi
Std Dev 1.264
Constant 0.07523
Mean −0.001931
Sigma 1.022
pull of θ parameter
pullTheta
Std Dev 1.135
Constant 0.08213
Mean −0.005778
Sigma 0.9371
pullTheta
Std Dev 1.135
Constant 0.08212
Mean −0.005764
Sigma 0.9371
pullTheta
Std Dev 1.136
Constant 0.08212
Mean −0.006129
Sigma 0.9373
pullTheta
Std Dev 1.135
Constant 0.08212
Mean −0.006115
Sigma 0.9373
pull of dxy parameter
pullDxy
Std Dev 1.25
Constant 0.07845
Mean −0.003091
Sigma 0.9771
pullDxy
Std Dev 1.25
Constant 0.07847
Mean −0.003092
Sigma 0.9768
pullDxy
Std Dev 1.25
Constant 0.07847
Mean −0.003061
Sigma 0.9768
pullDxy
Std Dev 1.25
Constant 0.07849
Mean −0.003062
Sigma 0.9766
pull of dz parameter
pullDz
Std Dev 1.258
Constant 0.08026
Mean −0.0004844
Sigma 0.9458
pullDz
Std Dev 1.258
Constant 0.08025
Mean −0.0004871
Sigma 0.9459
pullDz
Std Dev 1.258
Constant 0.08025
Mean −6.266e−05
Sigma 0.946
pullDz
Std Dev 1.258
Constant 0.08025
Mean −6.538e−05
Sigma 0.946
Ratio