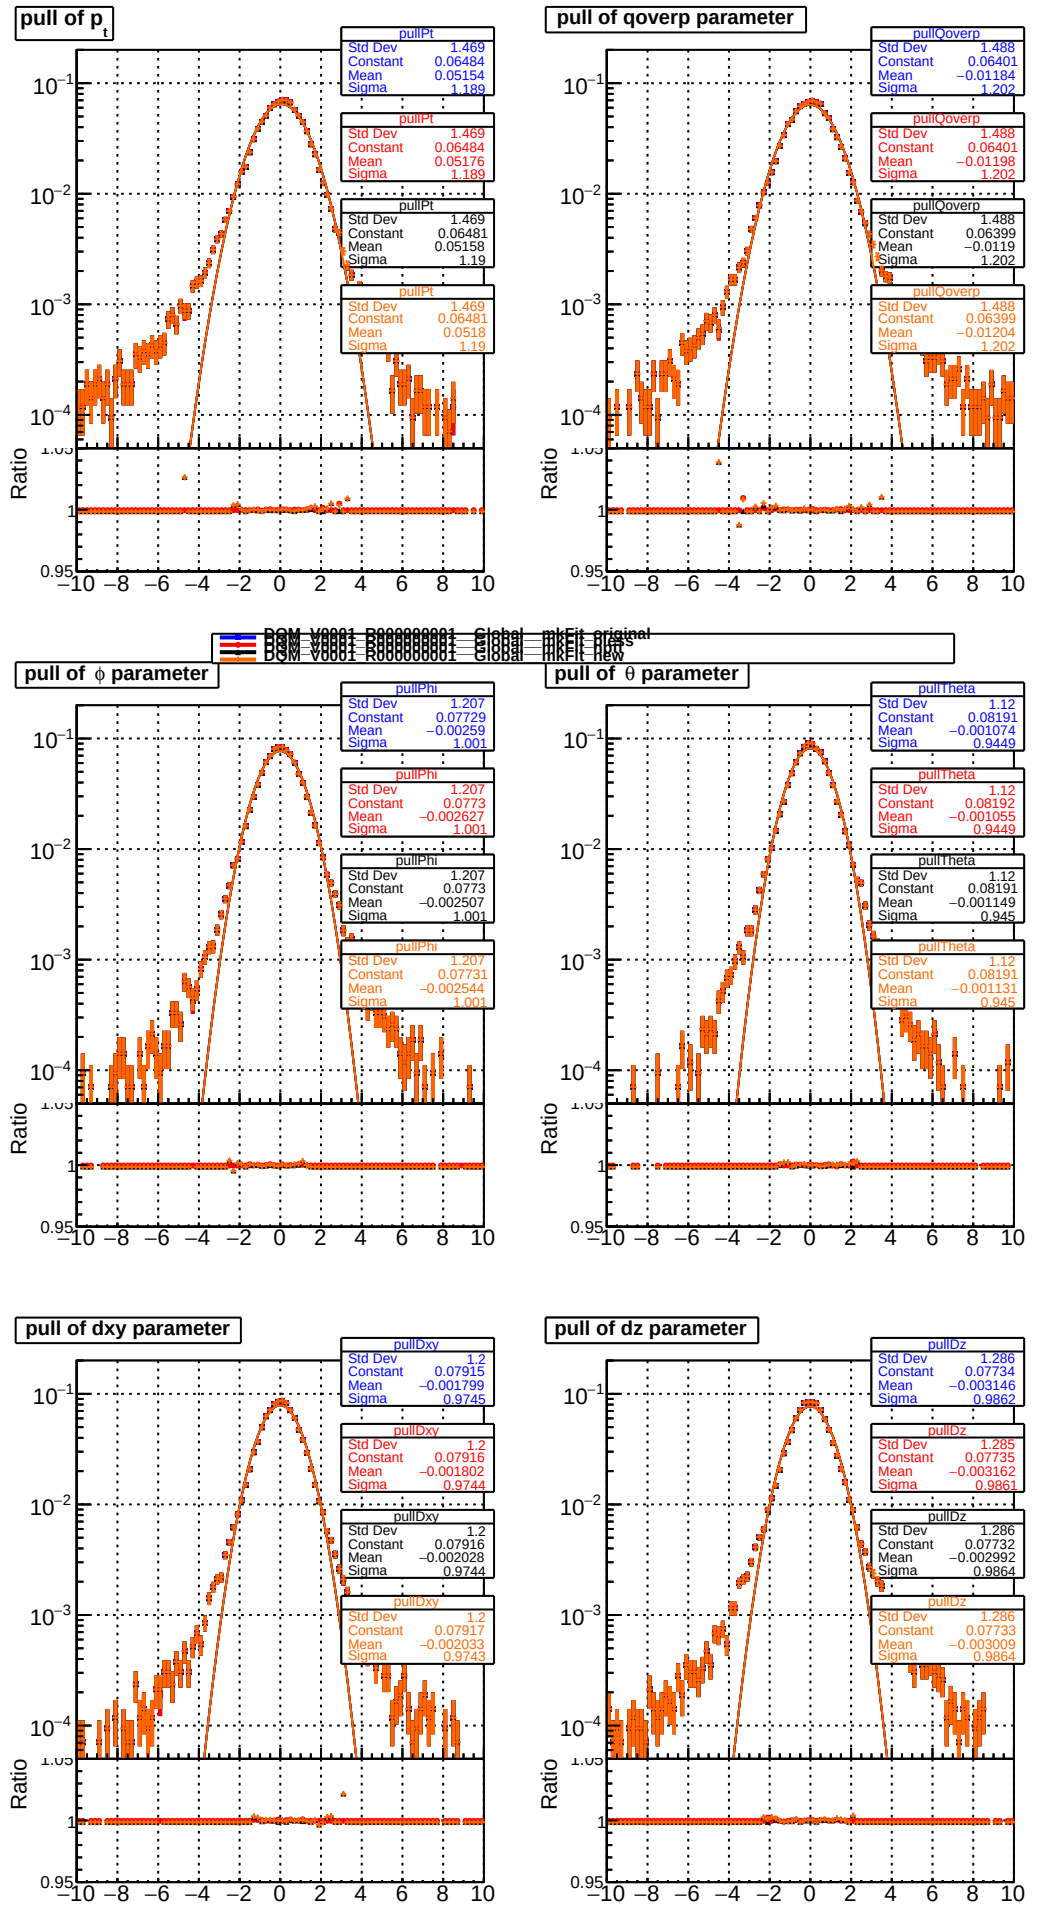
pull of p_t
pullPt
Std Dev 1.469
Constant 0.06484
Mean 0.05154
Sigma 1.189
pullPt
Std Dev 1.469
Constant 0.06484
Mean 0.05176
Sigma 1.189
pullPt
Std Dev 1.469
Constant 0.06481
Mean 0.05158
Sigma 1.19
pullPt
Std Dev 1.469
Constant 0.06481
Mean 0.0518
Sigma 1.19
pull of qoverp parameter
pullQoverp
Std Dev 1.488
Constant 0.06401
Mean −0.01184
Sigma 1.202
pullQoverp
Std Dev 1.488
Constant 0.06401
Mean −0.01198
Sigma 1.202
pullQoverp
Std Dev 1.488
Constant 0.06399
Mean −0.0119
Sigma 1.202
pullQoverp
Std Dev 1.488
Constant 0.06399
Mean −0.01204
Sigma 1.202
DQM V0001 R000000001 Global mkFit original
DQM V0001 R000000001 Global mkFit mass
DQM V0001 R000000001 Global mkFit duplicate
DQM V0001 R000000001 Global mkFit new
pull of ϕ parameter
pullPhi
Std Dev 1.207
Constant 0.07729
Mean −0.00259
Sigma 1.001
pullPhi
Std Dev 1.207
Constant 0.0773
Mean −0.002627
Sigma 1.001
pullPhi
Std Dev 1.207
Constant 0.0773
Mean −0.002507
Sigma 1.001
pullPhi
Std Dev 1.207
Constant 0.07731
Mean −0.002544
Sigma 1.001
pull of θ parameter
pullTheta
Std Dev 1.12
Constant 0.08191
Mean −0.001074
Sigma 0.9449
pullTheta
Std Dev 1.12
Constant 0.08192
Mean −0.001055
Sigma 0.9449
pullTheta
Std Dev 1.12
Constant 0.08191
Mean −0.001149
Sigma 0.945
pullTheta
Std Dev 1.12
Constant 0.08191
Mean −0.001131
Sigma 0.945
pull of dxy parameter
pullDxy
Std Dev 1.2
Constant 0.07915
Mean −0.001799
Sigma 0.9745
pullDxy
Std Dev 1.2
Constant 0.07916
Mean −0.001802
Sigma 0.9744
pullDxy
Std Dev 1.2
Constant 0.07916
Mean −0.002028
Sigma 0.9744
pullDxy
Std Dev 1.2
Constant 0.07917
Mean −0.002033
Sigma 0.9743
pull of dz parameter
pullDz
Std Dev 1.286
Constant 0.07734
Mean −0.003146
Sigma 0.9862
pullDz
Std Dev 1.285
Constant 0.07735
Mean −0.003162
Sigma 0.9861
pullDz
Std Dev 1.286
Constant 0.07732
Mean −0.002992
Sigma 0.9864
pullDz
Std Dev 1.286
Constant 0.07733
Mean −0.003009
Sigma 0.9864
Ratio