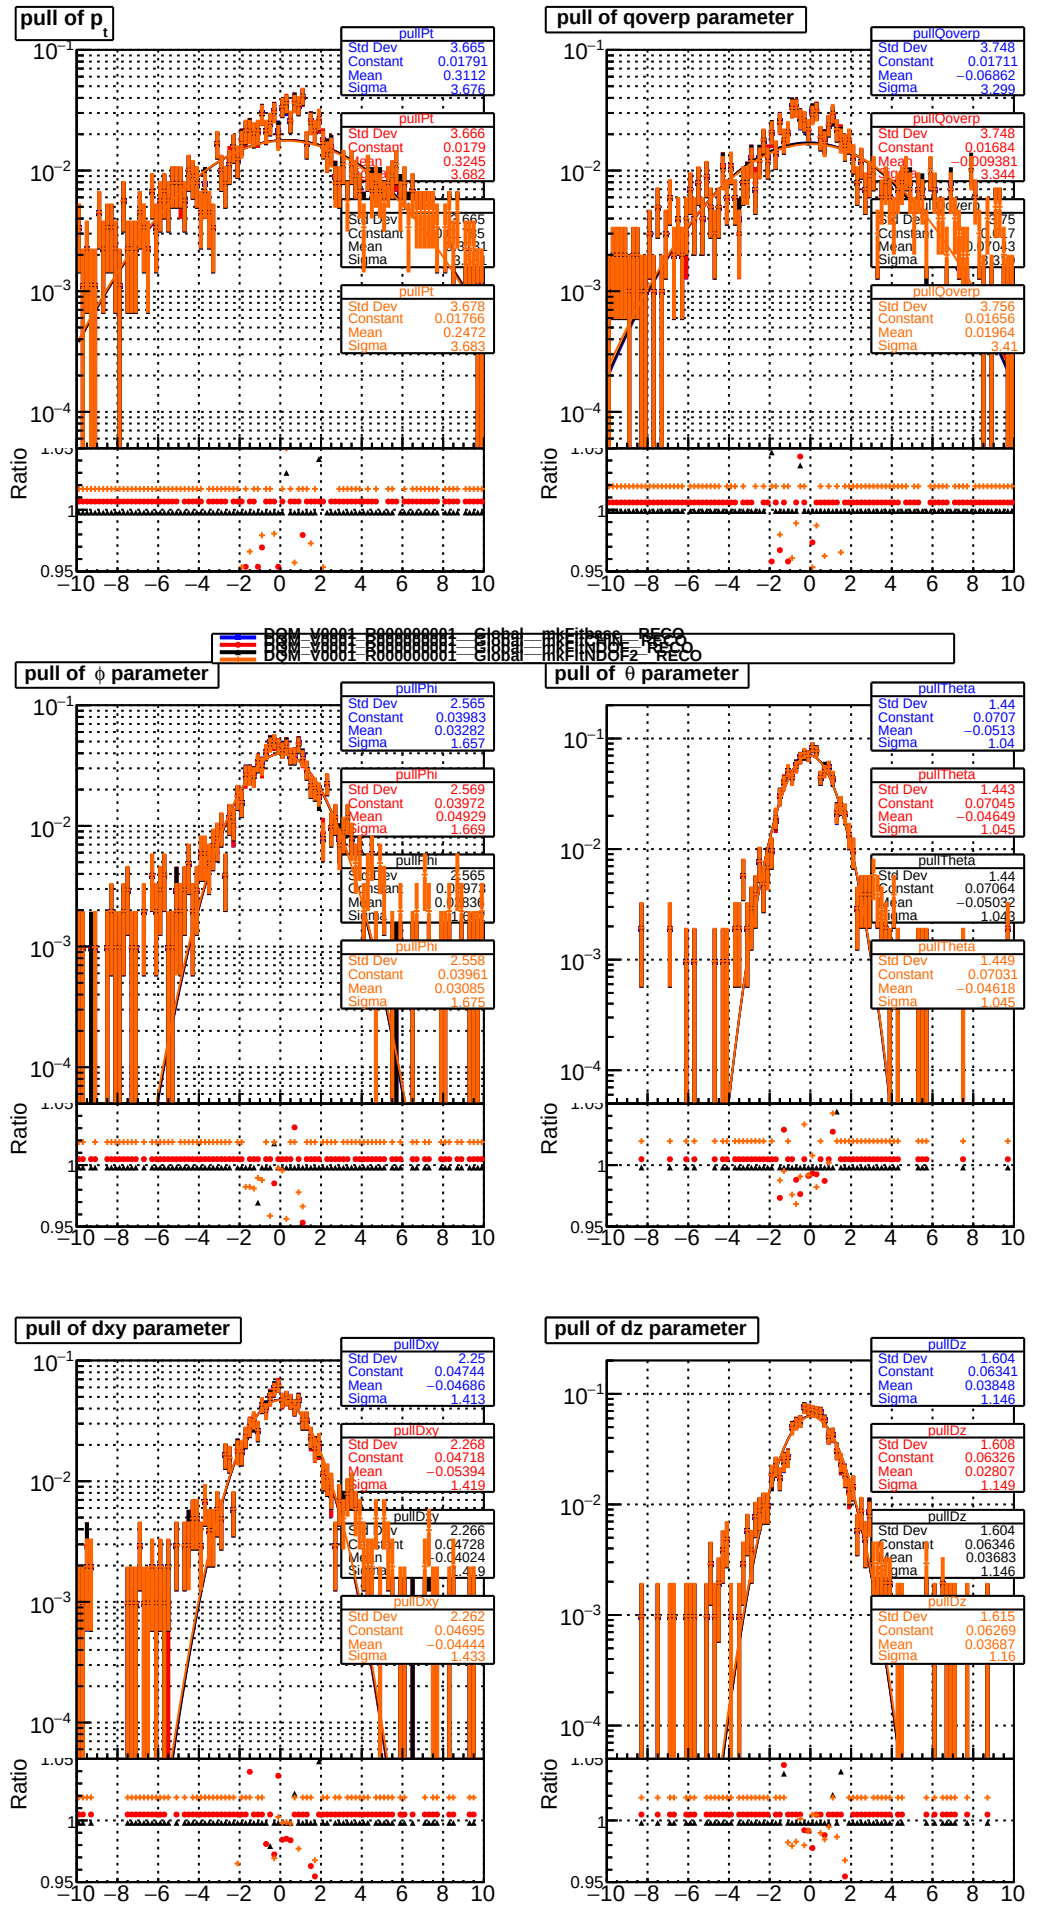
pull of p_t
pullPt
Std Dev 3.665
Constant 0.01791
Mean 0.3112
Sigma 3.676
pullPt
Std Dev 3.666
Constant 0.0179
Mean 0.3245
Sigma 3.682
pullPt
Std Dev 3.678
Constant 0.01766
Mean 0.2472
Sigma 3.683
pull of qoverp parameter
pullQoverp
Std Dev 3.748
Constant 0.01711
Mean −0.06862
Sigma 3.299
pullQoverp
Std Dev 3.748
Constant 0.01684
Mean −0.0009381
Sigma 3.344
pullQoverp
Std Dev 3.756
Constant 0.01656
Mean 0.01964
Sigma 3.41
DQM V0001 R000000001 Global mkFitIters RECO
DQM V0001 R000000001 Global mkFitNDOF2 RECO
pull of ϕ parameter
pullPhi
Std Dev 2.565
Constant 0.03983
Mean 0.03282
Sigma 1.657
pullPhi
Std Dev 2.569
Constant 0.03972
Mean 0.04929
Sigma 1.669
pullPhi
Std Dev 2.558
Constant 0.03961
Mean 0.03085
Sigma 1.675
pull of θ parameter
pullTheta
Std Dev 1.44
Constant 0.0707
Mean −0.0513
Sigma 1.04
pullTheta
Std Dev 1.443
Constant 0.07045
Mean −0.04649
Sigma 1.045
pullTheta
Std Dev 1.449
Constant 0.07031
Mean −0.04618
Sigma 1.045
pull of dxy parameter
pullDxy
Std Dev 2.25
Constant 0.04744
Mean −0.04686
Sigma 1.413
pullDxy
Std Dev 2.268
Constant 0.04718
Mean −0.05394
Sigma 1.419
pullDxy
Std Dev 2.262
Constant 0.04695
Mean −0.04444
Sigma 1.433
pull of dz parameter
pullDz
Std Dev 1.604
Constant 0.06341
Mean 0.03848
Sigma 1.146
pullDz
Std Dev 1.608
Constant 0.06326
Mean 0.02807
Sigma 1.149
pullDz
Std Dev 1.604
Constant 0.06346
Mean 0.03683
Sigma 1.146
pullDz
Std Dev 1.615
Constant 0.06269
Mean 0.03687
Sigma 1.16
Ratio