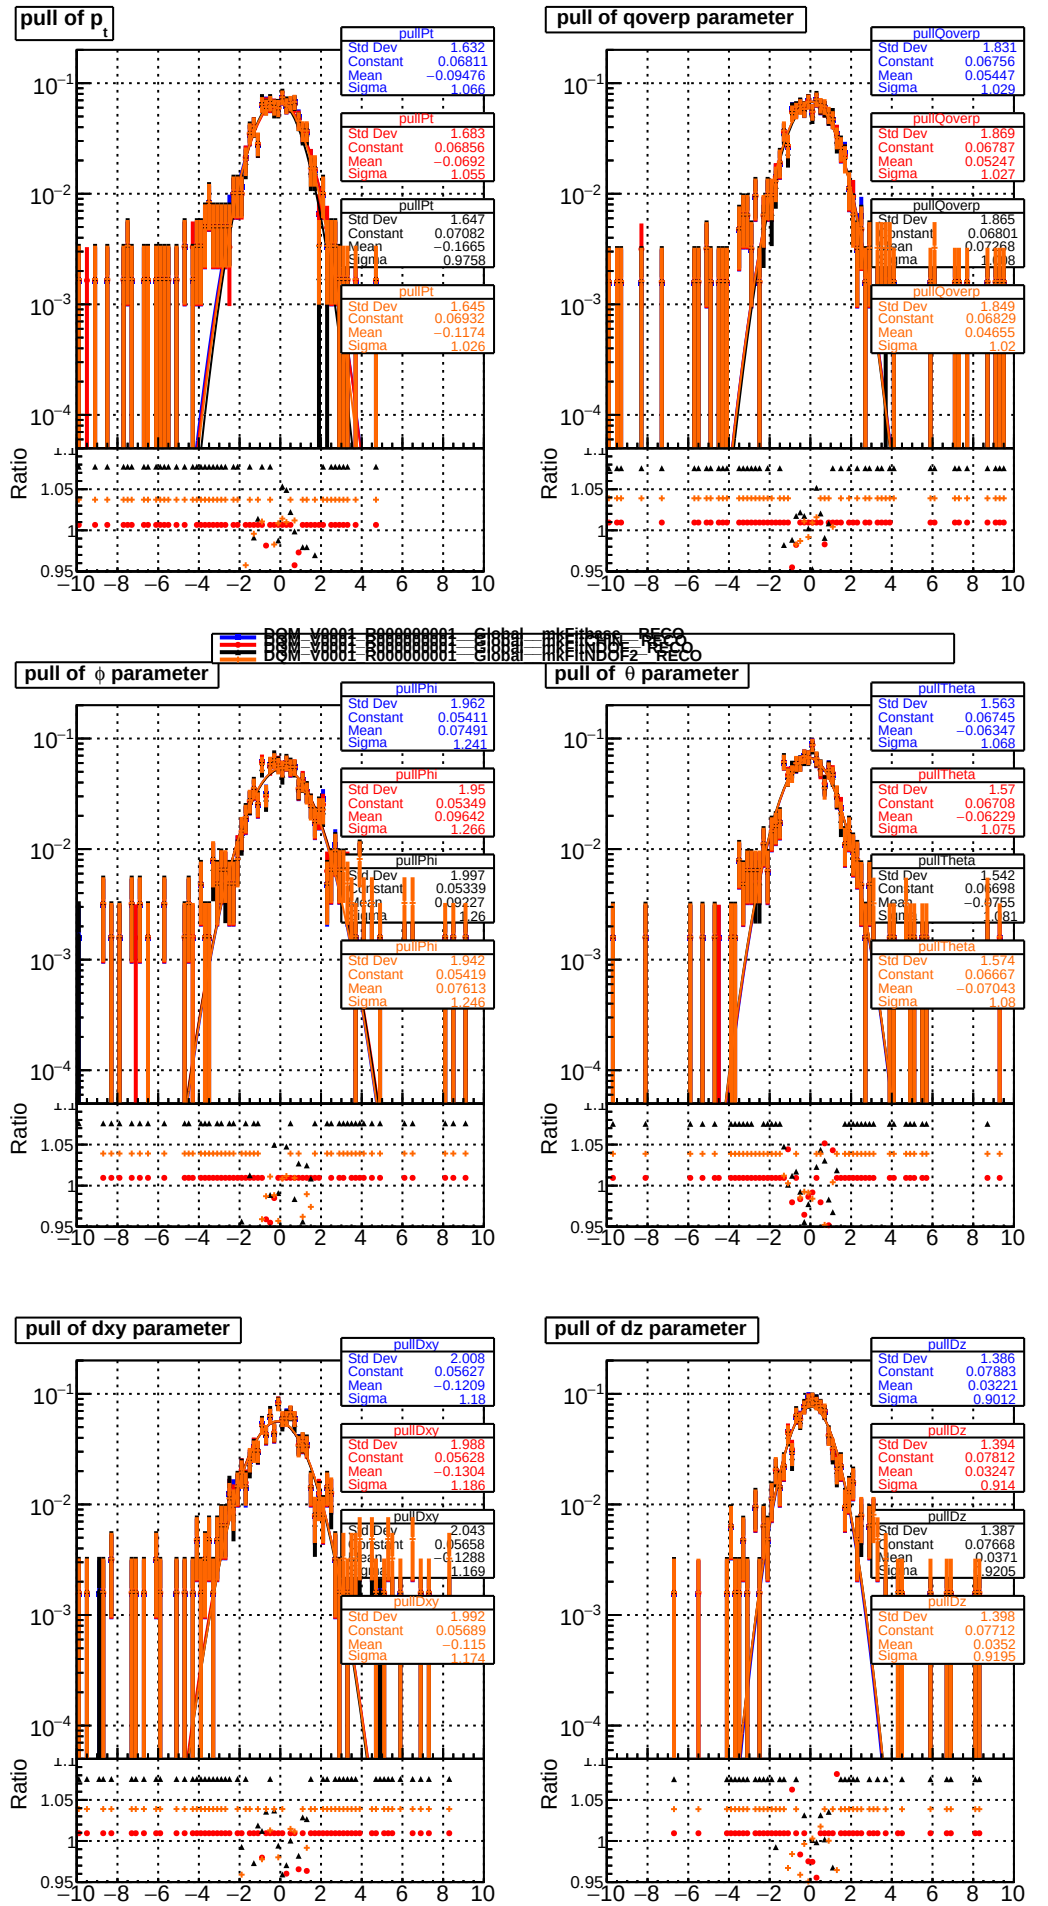
pull of p_t
pullPt
Std Dev 1.632
Constant 0.06811
Mean −0.09476
Sigma 1.066
pullPt
Std Dev 1.683
Constant 0.06856
Mean −0.0692
Sigma 1.055
pullPt
Std Dev 1.647
Constant 0.07082
Mean −0.1665
Sigma 0.9758
pullPt
Std Dev 1.645
Constant 0.06932
Mean −0.1174
Sigma 1.026
pull of qoverp parameter
pullQoverp
Std Dev 1.831
Constant 0.06756
Mean 0.05447
Sigma 1.029
pullQoverp
Std Dev 1.869
Constant 0.06787
Mean 0.05247
Sigma 1.027
pullQoverp
Std Dev 1.865
Constant 0.06801
pullQoverp
Std Dev 1.849
Constant 0.06829
Mean 0.04655
Sigma 1.02
DQM V0001 R000000001 Global mkFitIters RECO
DQM V0001 R000000001 Global mkFitNDOF RECO
DQM V0001 R000000001 Global mkFitNDOF2 RECO
pull of ϕ parameter
pullPhi
Std Dev 1.962
Constant 0.05411
Mean 0.07491
Sigma 1.241
pullPhi
Std Dev 1.95
Constant 0.05349
Mean 0.09642
Sigma 1.266
pullPhi
Std Dev 1.997
pullPhi
Std Dev 1.942
Constant 0.05419
Mean 0.07613
Sigma 1.246
pull of θ parameter
pullTheta
Std Dev 1.563
Constant 0.06745
Mean −0.06347
Sigma 1.068
pullTheta
Std Dev 1.57
Constant 0.06708
Mean −0.06229
Sigma 1.075
pullTheta
Std Dev 1.542
Constant 0.06698
pullTheta
Std Dev 1.574
Constant 0.06667
Mean −0.07043
Sigma 1.08
pull of dxy parameter
pullDxy
Std Dev 2.008
Constant 0.05627
Mean −0.1209
Sigma 1.18
pullDxy
Std Dev 1.988
Constant 0.05628
Mean −0.1304
Sigma 1.186
pullDxy
Std Dev 2.043
pullDxy
Std Dev 1.992
Constant 0.05689
Mean −0.115
Sigma 1.174
pull of dz parameter
pullDz
Std Dev 1.386
Constant 0.07883
Mean 0.03221
Sigma 0.9012
pullDz
Std Dev 1.394
Constant 0.07812
Mean 0.03247
Sigma 0.914
pullDz
Std Dev 1.387
Constant 0.07668
pullDz
Std Dev 1.398
Constant 0.07712
Mean 0.0352
Sigma 0.9195
Ratio