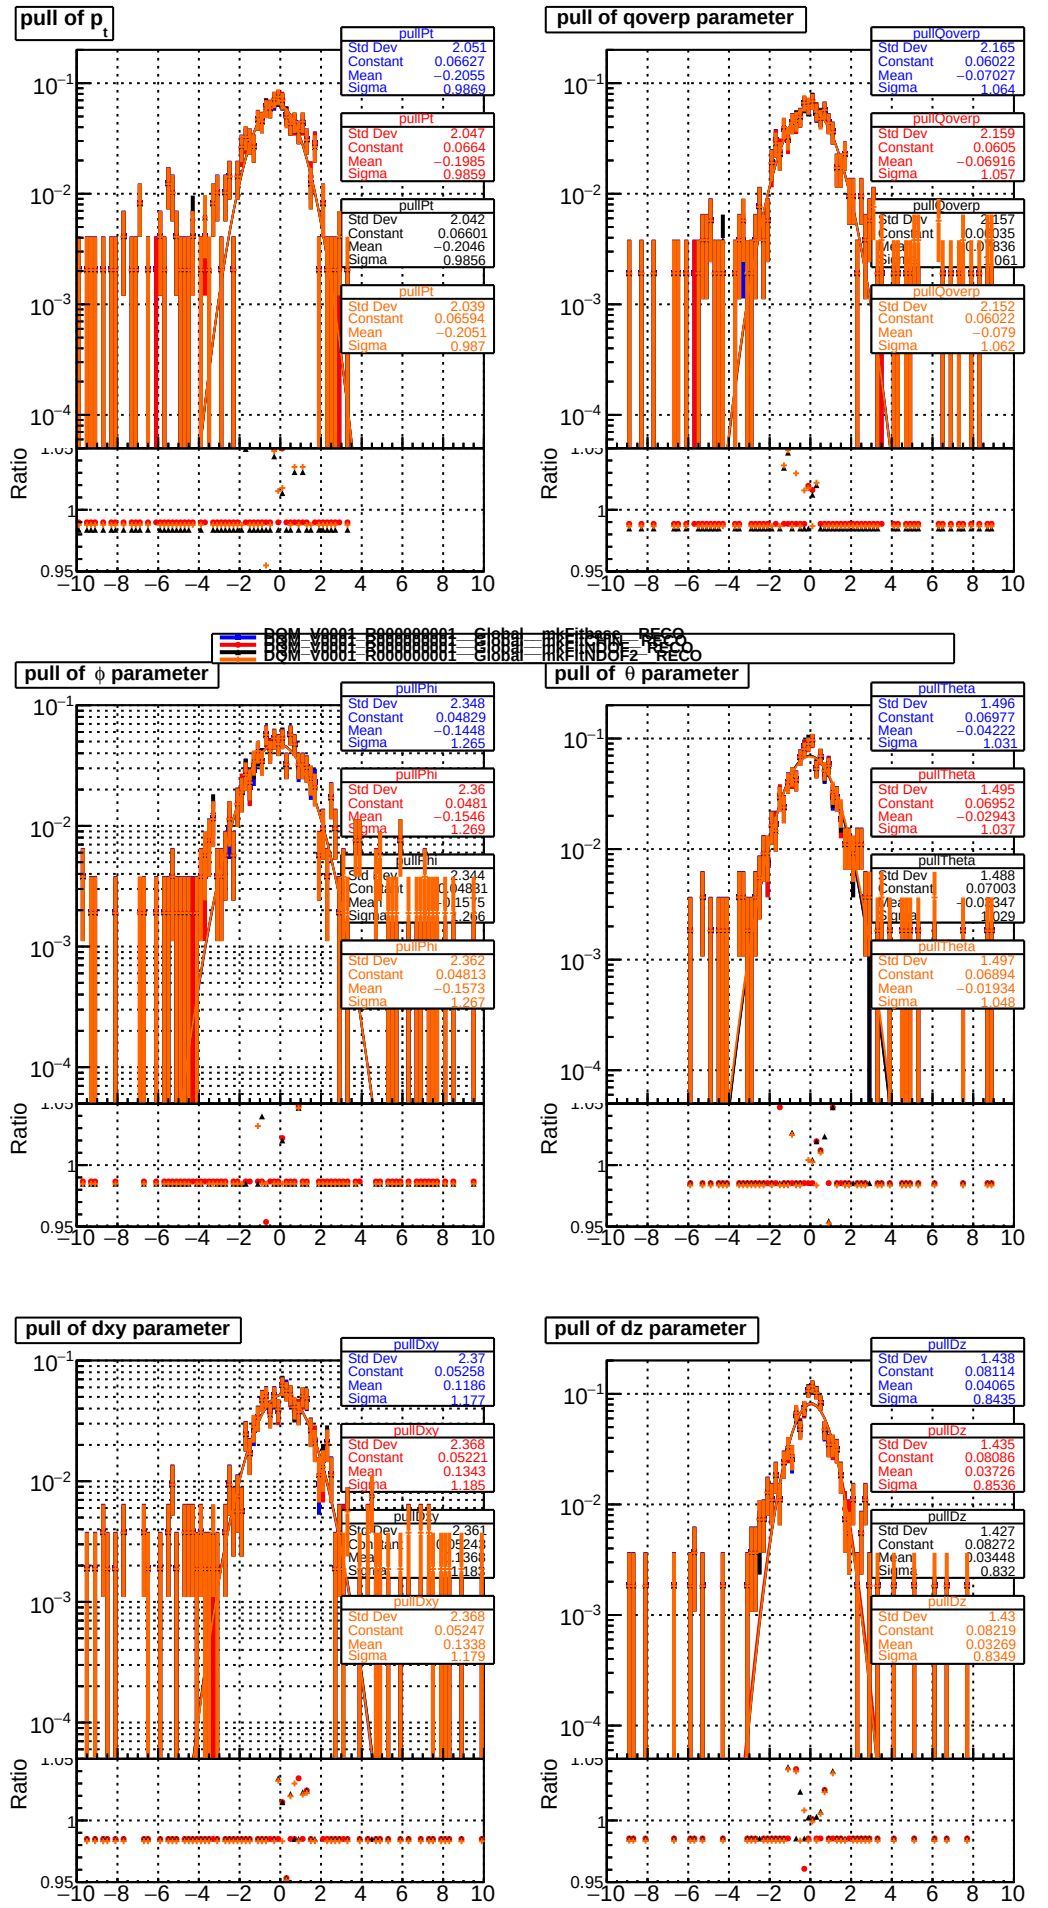
pull of p_t
pullPt
Std Dev 2.051
Constant 0.06627
Mean −0.2055
Sigma 0.9869
pullPt
Std Dev 2.047
Constant 0.0664
Mean −0.1985
Sigma 0.9859
pullPt
Std Dev 2.042
Constant 0.06601
Mean −0.2046
Sigma 0.9856
pullPt
Std Dev 2.039
Constant 0.06594
Mean −0.2051
Sigma 0.987
pull of qoverp parameter
pullQoverp
Std Dev 2.165
Constant 0.06022
Mean −0.07027
Sigma 1.064
pullQoverp
Std Dev 2.159
Constant 0.0605
Mean −0.06916
Sigma 1.057
pullQoverp
Std Dev 2.157
pullQoverp
Std Dev 2.152
Constant 0.06022
Mean −0.079
Sigma 1.062
DQM V0001 R000000001 Global mkFitIters RECO
DQM V0001 R000000001 Global mkFitNDOF2 RECO
pull of ϕ parameter
pullPhi
Std Dev 2.348
Constant 0.04829
Mean −0.1448
Sigma 1.265
pullPhi
Std Dev 2.36
Constant 0.0481
Mean −0.1546
Sigma 1.269
pullPhi
Std Dev 2.344
pullPhi
Std Dev 2.362
Constant 0.04813
Mean −0.1573
Sigma 1.267
pull of θ parameter
pullTheta
Std Dev 1.496
Constant 0.06977
Mean −0.04222
Sigma 1.031
pullTheta
Std Dev 1.495
Constant 0.06952
Mean −0.02943
Sigma 1.037
pullTheta
Std Dev 1.488
Constant 0.07003
pullTheta
Std Dev 1.497
Constant 0.06894
Mean −0.01934
Sigma 1.048
pull of dxy parameter
pullDxy
Std Dev 2.37
Constant 0.05258
Mean 0.1186
Sigma 1.177
pullDxy
Std Dev 2.368
Constant 0.05221
Mean 0.1343
Sigma 1.185
pullDxy
Std Dev 2.361
pullDxy
Std Dev 2.368
Constant 0.05247
Mean 0.1338
Sigma 1.179
pull of dz parameter
pullDz
Std Dev 1.438
Constant 0.08114
Mean 0.04065
Sigma 0.8435
pullDz
Std Dev 1.435
Constant 0.08086
Mean 0.03726
Sigma 0.8536
pullDz
Std Dev 1.427
Constant 0.08272
Mean 0.03448
pullDz
Std Dev 1.43
Constant 0.08219
Mean 0.03269
Sigma 0.8349
Ratio