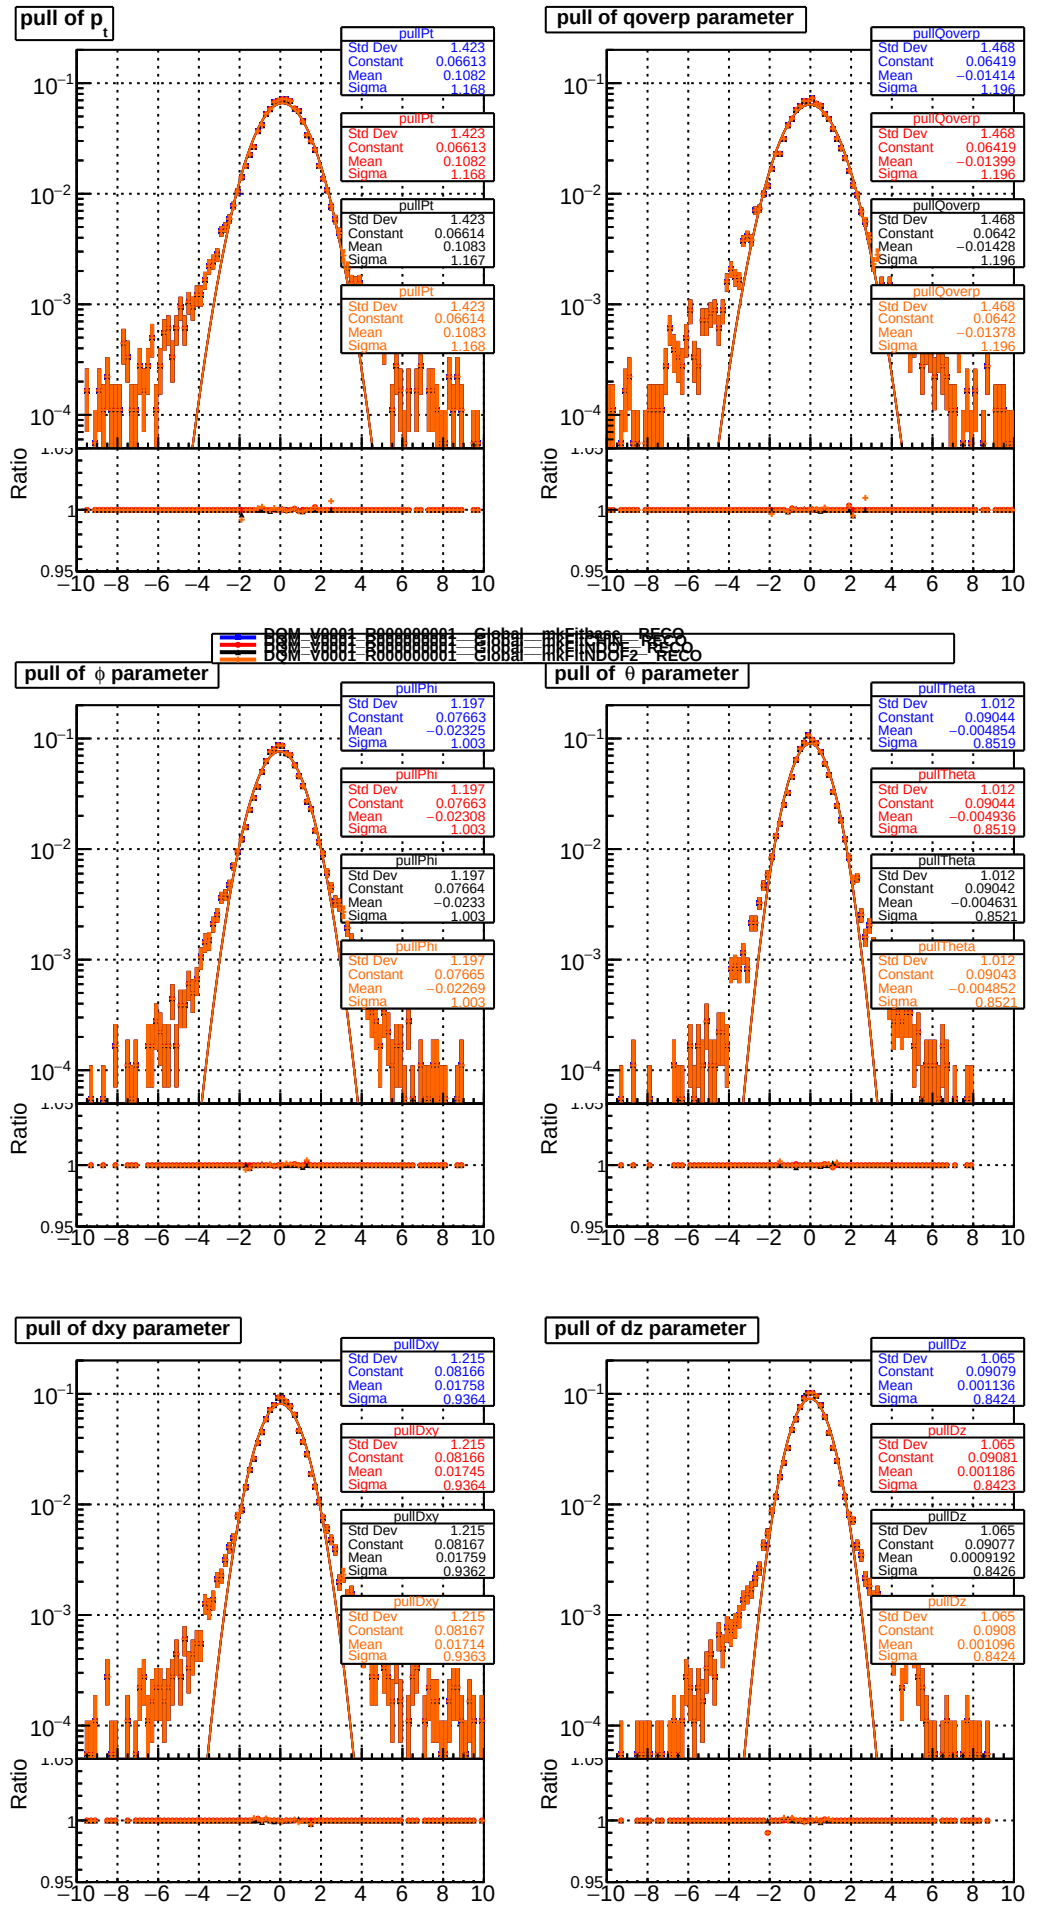
pull of p_t
pullPt
Std Dev 1.423
Constant 0.06613
Mean 0.1082
Sigma 1.168
pullPt
Std Dev 1.423
Constant 0.06613
Mean 0.1082
Sigma 1.168
pullPt
Std Dev 1.423
Constant 0.06614
Mean 0.1083
Sigma 1.167
pullPt
Std Dev 1.423
Constant 0.06614
Mean 0.1083
Sigma 1.168
pull of qoverp parameter
pullQoverp
Std Dev 1.468
Constant 0.06419
Mean −0.01414
Sigma 1.196
pullQoverp
Std Dev 1.468
Constant 0.06419
Mean −0.01399
Sigma 1.196
pullQoverp
Std Dev 1.468
Constant 0.0642
Mean −0.01428
Sigma 1.196
pullQoverp
Std Dev 1.468
Constant 0.0642
Mean −0.01378
Sigma 1.196
DQM V0001 R000000001 Global mkFitIter0 RECO
DQM V0001 R000000001 Global mkFitIter1 RECO
DQM V0001 R000000001 Global mkFitNDOF2 RECO
pull of ϕ parameter
pullPhi
Std Dev 1.197
Constant 0.07663
Mean −0.02325
Sigma 1.003
pullPhi
Std Dev 1.197
Constant 0.07663
Mean −0.02308
Sigma 1.003
pullPhi
Std Dev 1.197
Constant 0.07664
Mean −0.0233
Sigma 1.003
pullPhi
Std Dev 1.197
Constant 0.07665
Mean −0.02269
Sigma 1.003
pull of θ parameter
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004854
Sigma 0.8519
pullTheta
Std Dev 1.012
Constant 0.09044
Mean −0.004936
Sigma 0.8519
pullTheta
Std Dev 1.012
Constant 0.09042
Mean −0.004631
Sigma 0.8521
pullTheta
Std Dev 1.012
Constant 0.09043
Mean −0.004852
Sigma 0.8521
pull of dxy parameter
pullDxy
Std Dev 1.215
Constant 0.08166
Mean 0.01758
Sigma 0.9364
pullDxy
Std Dev 1.215
Constant 0.08166
Mean 0.01745
Sigma 0.9364
pullDxy
Std Dev 1.215
Constant 0.08167
Mean 0.01759
Sigma 0.9362
pullDxy
Std Dev 1.215
Constant 0.08167
Mean 0.01714
Sigma 0.9363
pull of dz parameter
pullDz
Std Dev 1.065
Constant 0.09079
Mean 0.001136
Sigma 0.8424
pullDz
Std Dev 1.065
Constant 0.09081
Mean 0.001186
Sigma 0.8423
pullDz
Std Dev 1.065
Constant 0.09077
Mean 0.0009192
Sigma 0.8426
pullDz
Std Dev 1.065
Constant 0.0908
Mean 0.001096
Sigma 0.8424
Ratio