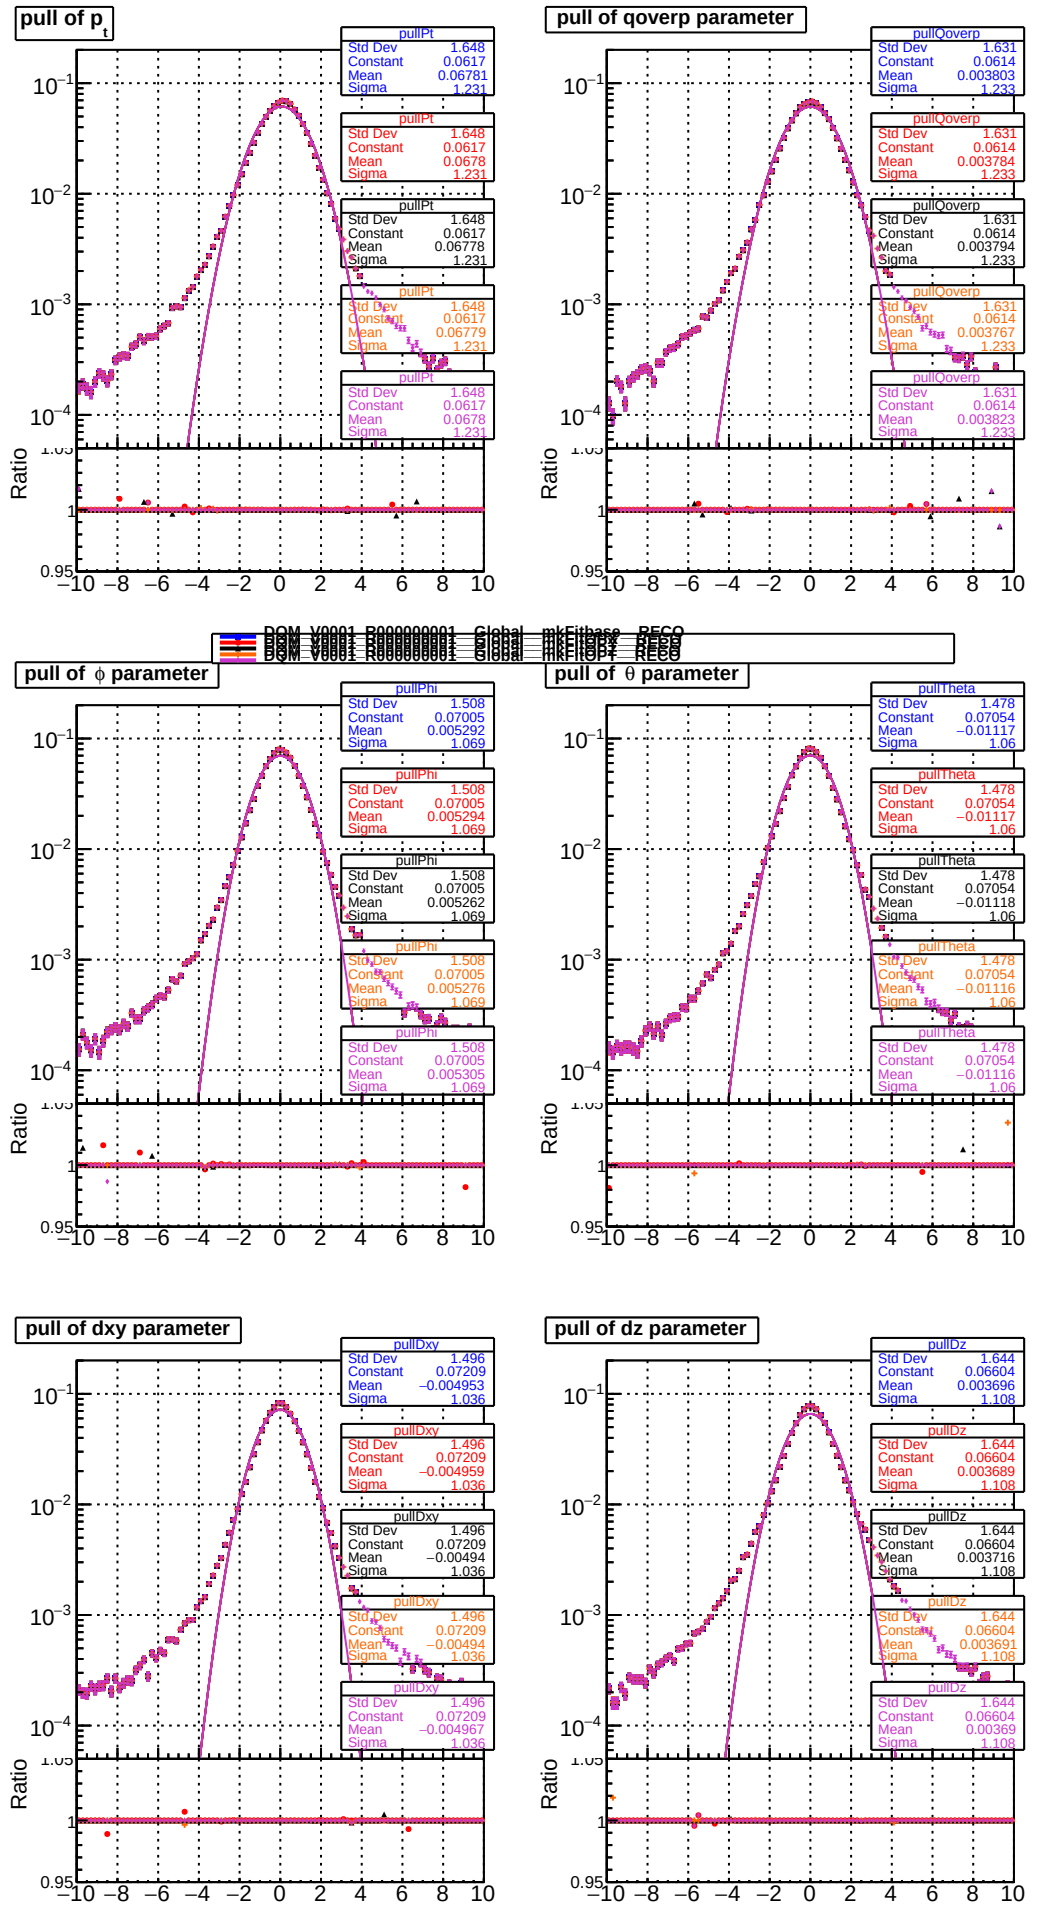
pull of p_t
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.06781
Sigma 1.231
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.0678
Sigma 1.231
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.06778
Sigma 1.231
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.06779
Sigma 1.231
pullPt
Std Dev 1.648
Constant 0.0617
Mean 0.0678
Sigma 1.231
Ratio
pull of qoverp parameter
pullQoverp
Std Dev 1.631
Constant 0.0614
Mean 0.003803
Sigma 1.233
pullQoverp
Std Dev 1.631
Constant 0.0614
Mean 0.003784
Sigma 1.233
pullQoverp
Std Dev 1.631
Constant 0.0614
Mean 0.003794
Sigma 1.233
pullQoverp
Std Dev 1.631
Constant 0.0614
Mean 0.003767
Sigma 1.233
pullQoverp
Std Dev 1.631
Constant 0.0614
Mean 0.003823
Sigma 1.233
Ratio
DQM_V0001_R000000001__Global__mkFitBase__RECO
DQM_V0001_R000000001__Global__mkFitIter0__RECO
DQM_V0001_R000000001__Global__mkFitIter1__RECO
DQM_V0001_R000000001__Global__mkFitIter2__RECO
pull of ϕ parameter
pullPhi
Std Dev 1.508
Constant 0.07005
Mean 0.005292
Sigma 1.069
pullPhi
Std Dev 1.508
Constant 0.07005
Mean 0.005294
Sigma 1.069
pullPhi
Std Dev 1.508
Constant 0.07005
Mean 0.005262
Sigma 1.069
pullPhi
Std Dev 1.508
Constant 0.07005
Mean 0.005276
Sigma 1.069
pullPhi
Std Dev 1.508
Constant 0.07005
Mean 0.005305
Sigma 1.069
Ratio
pull of θ parameter
pullTheta
Std Dev 1.478
Constant 0.07054
Mean −0.01117
Sigma 1.06
pullTheta
Std Dev 1.478
Constant 0.07054
Mean −0.01117
Sigma 1.06
pullTheta
Std Dev 1.478
Constant 0.07054
Mean −0.01118
Sigma 1.06
pullTheta
Std Dev 1.478
Constant 0.07054
Mean −0.01116
Sigma 1.06
pullTheta
Std Dev 1.478
Constant 0.07054
Mean −0.01116
Sigma 1.06
Ratio
pull of dxy parameter
pullDxy
Std Dev 1.496
Constant 0.07209
Mean −0.004953
Sigma 1.036
pullDxy
Std Dev 1.496
Constant 0.07209
Mean −0.004959
Sigma 1.036
pullDxy
Std Dev 1.496
Constant 0.07209
Mean −0.00494
Sigma 1.036
pullDxy
Std Dev 1.496
Constant 0.07209
Mean −0.00494
Sigma 1.036
pullDxy
Std Dev 1.496
Constant 0.07209
Mean −0.004967
Sigma 1.036
Ratio
pull of dz parameter
pullDz
Std Dev 1.644
Constant 0.06604
Mean 0.003696
Sigma 1.108
pullDz
Std Dev 1.644
Constant 0.06604
Mean 0.003689
Sigma 1.108
pullDz
Std Dev 1.644
Constant 0.06604
Mean 0.003716
Sigma 1.108
pullDz
Std Dev 1.644
Constant 0.06604
Mean 0.003691
Sigma 1.108
pullDz
Std Dev 1.644
Constant 0.06604
Mean 0.00369
Sigma 1.108
Ratio